

Appendix 15

Public authority referral responses

Council ref: RZ16/0010

Ms. Natalie Stanowski
Principal Planner, City Planning
Penrith City Council
PO Box 60
PENRITH NSW 2751

Dear Ms. Stanowski,

Planning Proposal for 33-43 Phillip Street, St Marys

Thank you for your letter dated 19 September 2019 requesting Transport for NSW (TfNSW) comments on the Planning Proposal which seeks to amend the *Penrith Local Environmental Plan 2010* (PLEP) for the subject site.

It is understood that seeks to amend the planning controls for the site by increasing the maximum building height from 32 metres to 61 metres and increase the floor-space-ratio (FSR) for the site from 3.5:1 to 5.5:1.

The relevant Planning Proposal documentation has been reviewed by TfNSW and the comments provided to Council is included overleaf in **TAB A**.

If you require any further information or wish to discuss, please contact do not hesitate to contact Ken Ho, Transport Planner, via email at ken.ho@transport.nsw.gov.au.

Yours sincerely



28/10/2019

Mark Ozinga
Principal Manager, Land Use Planning & Development
Customer Strategy & Technology

Objective reference: CD19/07708

TAB A: Comments on RZ16/0010

Site-specific controls to maintain development outcomes

A mixed use development in this location has the potential to make a positive contribution to the town centre, particularly should it have a suitable provision of retail/commercial uses. The land use mix as proposed could contribute to an active day and night time economy and increase passive surveillance in the station locality. The mix of uses also supports jobs growth, supporting the role of St Marys station as both a destination and origin station.

The growth of the strategic centre is likely to create increase demand for commercial floor space over time. While any additional commercial floor space may not be feasible at this time, the proximity of this site to the station warrants the need to preserve commercial development opportunities.

The development outcomes for this site should consider the transit oriented development context and could leverage the current and future levels of public transport connectivity by minimising parking provision on the site. This will improve sustainable transport outcomes which will benefit the amenity of the centre.

Notwithstanding, a future development application may not align with the current intended development outcomes (with the possibility of the site being sold to others), for the given set of amended controls.

As such, it is suggested that Council introduce development controls within the LEP or a site specific DCP to ensure the following:

- a. Full activation of all street frontages, including through site links, with a particular focus on night time activation and designing to CPTED principles. Activation of links to the station precinct is considered essential.
- b. Defining minimum requirements for the quantity of retail/commercial floor space for the site.
- c. Provision of maximum parking rates for the site.

Bus services to/from and surrounding St Marys

Bus services at St Marys Station are planned to increase to service the station's catchment area in response to projected population and employment growth, including surrounding suburbs, the University of Western Sydney and the corridor between St Marys and Penrith via the Nepean Hospital. Improvement of bus services in the area including higher frequency services will rely on quick and efficient bus access within the St Marys town centre, connecting to rail services at St Marys railway station.

Key intersections in the town centre that bus services currently utilise are Phillip Street with Glossop Street and Queen Street with Charles Hackett Drive. The assessment provided with the Planning Proposal documentation forecasts that the intersection at Phillip Street and Glossop Street would be overcapacity for the 2035 AM scenario due to the subject proposal's impact and background traffic growth. This presents a risk that the future operation of bus services would be impacted in terms of reliability, travel time and cost.

Improvements to the traffic signals at Chapel Street with Glossop Street have been included as part of a VPA commitment from the proponent, which were suggested by Council. These improvements have been suggested due to the land availability within the road reserve in comparison to the intersection with Phillip Street. Council should clarify whether there is the potential for any further improvements to the Philip Street/Glossop Street intersection in the future to ensure bus operations are not further delayed due to increasing volumes of traffic.

Should Council identify that there would be limited potential for further improvements to the Phillip Street/Glossop Street intersection, it is suggested that Council considers the need to review the wider traffic management and access principles for the St Marys town centre to:

- a. Accommodate growth in the St Marys town centre; and
- b. Maintain the reliability and efficiency of bus movements into and out of the town centre, which would be servicing future residents and employees.



13 November 2019

Our Reference: SYD18/01597/04
Council Ref: RZ16/0010

The General Manager
Penrith Council
PO Box 60
Penrith NSW 2751

Attention: Natalie Stanowski, Principal Planner, City Planning

Dear Natalie,

PLANNING PROPOSAL – AMENDMENT TO PENRITH LOCAL ENVIRONMENTAL PLAN 2010 (LEP) – 33-43 PHILLIP STREET, ST MARYS

Reference is made to Council's correspondence dated 19 September 2019 regarding the abovementioned Planning Proposal which was referred to Roads and Maritime Services (Roads and Maritime) for comment in accordance with the consultation requirements set out under Section 3.34 of the *Environmental Planning and Assessment Act, 1979* and Gateway determination. Roads and Maritime appreciates the opportunity to provide comment on the proposal.

It is noted the planning proposal seeks to amend the Penrith Local Environmental Plan 2010 (LEP) to increase the maximum building height from 32 metres to 61 metres and increase the floor space ratio (FSR) for the site from 3.5:1 to 5.5:1. Roads and Maritime has reviewed the Planning Proposal and provides comments at **Attachment A** for Council's consideration.

Thank you for the opportunity to provide comment on the subject Planning Proposal. Should you have any further inquiries in relation to this matter, please do not hesitate to contact Hans Pilly Mootanah, Land Use Planner, on telephone 8849 2076 or by email at development.sydney@rms.nsw.gov.au.

Yours sincerely,

Rachel Davis
Senior Strategic Land Use Coordinator
Sydney Planning, Greater Sydney Division

Attachment A: Detailed comments

- 1 Roads and Maritime supports and reiterates the comments provided by Transport for NSW in its submission dated 28 October 2019 (copy attached).
- 2 Given the considerable change in FSR, Council should be satisfied that the proposed uplift scheme is in line with the vision and objectives for St Marys in the context of the Greater Penrith to Eastern Creek Growth Area (GPEC) as identified in the Greater Sydney Commission – A Metropolis of Three Cities.

The GSC identifies St Marys as a major transport node in light of the North South Rail Link, from St Marys to Western Sydney Airport, as well as potential future connection from St Marys to Rouse Hill, intersecting with existing heavy rail corridors creating opportunities for renewal and revitalisation. As such, given the nature of the site and its proximity to the bus interchange and train station, Council may wish to consider appropriate maximum car parking rates for the site for inclusion in a site specific DCP or LEP controls, in order to encourage the use of public and active transport and reduce reliance on private vehicle travel in the longer term. Council may consider adopting the parking rates (or similar) from table 3.2 of the Parramatta Road Corridor Urban Transformation Strategy (PRCUTS) Planning and Design Guidelines for urban intensification, which considers accessibility factors in determining parking controls.

- 3 In addition, it is understood that it is the applicant's intention to enter into a Voluntary Planning Agreement (VPA) for the following works:
 - a. The signalisation of the intersection of Blair Avenue/Phillip Street/Site access
 - b. Capacity improvements at Chapel Street/Glossop Street intersection.

It is also noted the Traffic Impact Assessment recommends changes to signal phasing at Phillip Street/Glossop Street.

In this regard, Roads and Maritime advises that any proposed works on, or installation of, traffic signals on any road would require Roads and Maritime approval under Section 87 of the *Roads Act, 1993* and a Works Authorisation Deed.

The installation of new traffic signals will be subject to the intersection meeting the warrants as outlined under Section 2 (Warrants) of the *RMS Traffic Signal Design* manual. A warrant assessment should be provided, broken down to demonstrate that the proposed signals can meet the criteria based on the four one hour periods of an average day. If the site satisfies the warrants, it does not necessarily mean that traffic signals are the best solution. All traffic data should be analysed and alternative treatments considered determining the optimum treatment. Intersection modelling in SIDRA would be required for treatments considered to demonstrate optimal operation and design requirements.

At this stage, Roads and Maritime is unlikely to support the signalisation of Blair Avenue/Phillip Street/Site access.

Roads and Maritime requests the opportunity to review the strategic concept plans and supporting assessment (including electronic copies of the modelling), prior to public exhibition and finalisation of the proposed VPA for the proposed signal works.

It should also be noted that any costs associated with the works, including any land acquisition and utility adjustments required to facilitate the works, would be the responsibility of the proponent.

4. Roads and Maritime notes from the Traffic Impact Assessment that Council is in the process of undertaking a precinct-wide traffic and transport study for the St Marys Town Centre and that a package of works to support broader growth will be determined by that study. This approach is supported by Roads and Maritime. We recommend Council ensures that an appropriate funding mechanism is in place to ensure equitable developer contributions are obtained towards the local and regional infrastructure identified to support the broader growth.



Use public transport... plan your trip at transportnsw.info

From: Madison Foster [<mailto:madison.Foster@penrith.city>]

Sent: Tuesday, 10 December 2019 9:05 AM

To: Hans Pilly mootanah

Subject: RE: 20191113 - Roads and Maritime response: Planning Proposal for 33-43 Phillip Street, St Marys - request for comment - SYD18/01597/04

Good Morning,

Thank you for your response to the Planning Proposal for 33-43 Phillip Street, St Marys.

In regards to point 3, the traffic signals at Phillip Street and Blair Avenue is a critical component to the planning proposal. Due to the impact of the proposal on the local traffic network, Council is currently working with the proponent to enter into a VPA for intersection and traffic works in this area.

I have attached a copy of the warrant assessment completed in April 2019, as a result, development opening scenario's being considered, the warrants are met.

Please provide a response to this as Council requires this matter to be resolved before the planning proposal is finalised.

Kind Regards,

Madison Foster
Planner

E madison.Foster@penrith.city
T +612 4732 8577 | F +612 4732 7958 | M
PO Box 60, PENRITH NSW 2751
www.visitpenrith.com.au
www.penrithcity.nsw.gov.au



Signal Warrant Assessment: Phillip Street and Blair Avenue, St Marys

Date: 18 April 2019

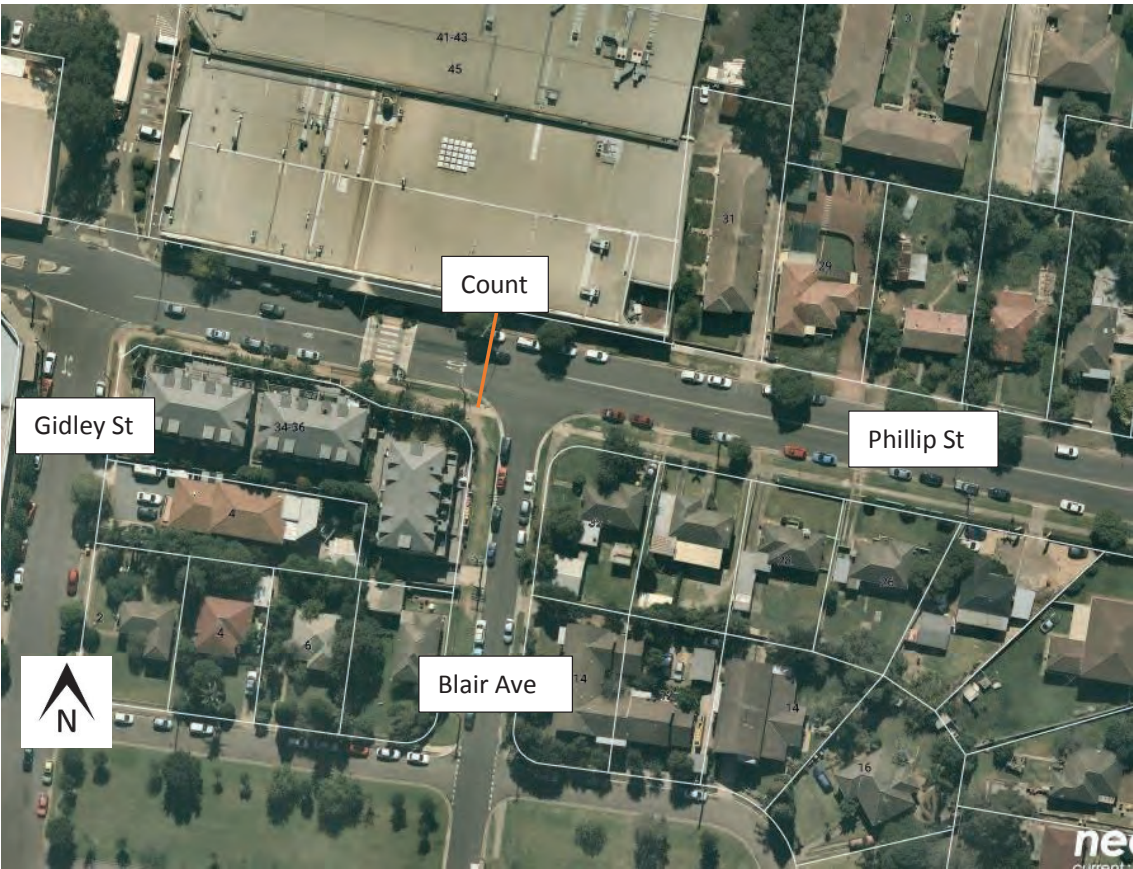


Figure 1

Forecasted Traffic Usage

A Council Traffic Speed and Volume count was conducted in 2012 on Phillip Street west of Blair Avenue (Figure 1). Weekday AM and PM peak counts are presented in Table 1.

Table 1: 2012 AM and PM peak counts on Phillip Street (1hr)

	Phillip St	
	East	West
AM Peak	300	285
PM Peak	389	359

In keeping with the high growth rates of town centres, road usage can be expected to increase by a rate of 2% pa. 2% pa growth is applied the 2012 counts (Table 2).

Table 2: 2026 and 2031 counts with a growth rate of 2% pa

	Phillip St			
	2026		2031	
	East	West	East	West
AM Peak	396	376	437	415
PM Peak	513	474	567	523

Predicted development traffic generation is described in asongroup's Traffic Assessment Report (2019) section 4.2. According to asongroup, in 2026, total additional traffic volumes generated from the site are 584 and 931 for the AM and PM peak respectively. In 2031, additional traffic volumes are 543 and 890 for the AM and PM peak respectively. Below are development traffic tables copied from the asongroup Traffic Assessment Report.

Development Traffic Tables (Taken from asongroup Traffic Assessment Report)

Land use	Units / Area		2026		2031	
			AM	PM	AM	PM
Residential	584	units	193	193	152	152
Commercial	2,210	m ²	35	27	35	27
Retail – Specialty Shops	1,615	m ²	45	90	45	90
Retail – Supermarket	4,500	m ²	311	621	311	621
Total			584	931	543	890

Land use	2026				2031			
	AM In	AM Out	PM In	PM Out	AM In	AM Out	PM In	PM Out
Residential	39	154	154	39	30	121	121	30
Commercial	28	7	5	21	28	7	5	21
Retail – Specialty Shops	23	23	45	45	155	155	311	311
Retail – Supermarket	155	155	311	311	23	23	45	45
Total	245	339	515	415	237	306	482	407

From the above values and vehicle movement data provided to Council, the distribution of additional traffic can be forecasted. It is assumed **35%** of additional vehicles will head west bound along Phillip St, **55%** will head east bound along Phillip St, and **10%** will head along Blair Ave.

Furthermore, development in the St Marys town centre will create higher traffic demand on Blair Avenue. Values presented in Table 3 are based on the RMS generation rates for residential areas, as well as development capacity estimates.

Using the information above, Table 3 presents the forecasted traffic usage on Phillip Street, Blair Avenue, and the access driveway.

Table 3: Forecasted traffic usage for Philip Street, Blair Avenue and the Access Driveway, St Marys

	Phillip St			
	2026		2031	
	East	West	East	West
AM Peak	717	580	736	605
PM Peak	1025	800	1056	834
	Access Driveway			
	2026		2031	
	North	South	North	South
AM Peak	245	339	237	306
PM Peak	515	415	482	407
	Blair Ave			
	2026		2031	
	North	South	North	South
AM Peak	124	102	106	89
PM Peak	158	137	140	123

RMS Warrants

The RMS warrants for traffic signals are as follows:

2.3 SIGNALISED INTERSECTIONS

As a guide, a signalised intersection may be considered if one of the following warrants is met.

(a) Traffic demand:

For each of four one-hour periods of an average day:

- (i) the major road flow exceeds 600 vehicles/hour in each direction; and
- (ii) the minor road flow exceeds 200 vehicles/hour in one direction.

According Table 3, Phillip Street exceeds the major road flow requirement for both the AM and PM peak in 2031. Additionally, the access driveway exceeds the minor road flow requirement on all occasions. According to the above data, the proposed intersection presents a strong potential for meeting RMS signal warrants.

Madison Foster

From: Marc Desmond <marc.j.desmond@transport.nsw.gov.au>
Sent: Wednesday, 8 January 2020 2:56 PM
To: Madison Foster
Subject: TfNSW response to SYD18/01597/05 - Planning Proposal for 33-43 Phillip Street, St Marys

EXTERNAL EMAIL: This email was received from outside the organisation. Use caution when clicking any links or opening attachments.

Hello Madison

Thank you for referring the Signal Warrant Assessment for the proposed signalisation of Phillip Street and Blair Avenue, St Mary's.

Please note, legislation to bring Roads and Maritime Services and Transport for NSW (TfNSW) together as one organisation came into effect on 1 December 2019 so we can deliver more integrated transport services across modes and better outcomes to customers and communities across NSW. Other than a name change from Roads and Maritime to TfNSW, it's business as usual and you can continue to enjoy the same service.

TfNSW have reviewed the submitted Signal Warrant Assessment, and provide the following comments:

- The Signal Warrant Assessment does not show which 4 hour periods meet the warrant, and rather refers to a peak period in the future.
- The traffic volumes are also generated from a 2012 survey, which is 7 to 8 years old, and assumes a growth rate of 2% p.a.
- Whilst it is noted that growth rates were provided from the EMME model, it is unlikely that the growth rates within the model (which applies from 2016 on) have been realised at this time, and it is not appropriate to apply this to the 2012 survey. It is recommended that a new survey be undertaken.
- A warrant assessment form (attached) is provided for the developer to complete, to demonstrate to TfNSW whether the warrant for traffic signals has been met or not.
- If the site does meet the warrant, it does not necessarily mean that traffic signals are the optimal solution.
- Alternative treatments should be considered to determine the appropriate outcome for this location, with options to be modelled in Sidra and provided within an options report. Options are to include non-signalised alternatives.

TfNSW recommend that the above be reviewed with updated information to be submitted for further assessment.

Should you require any further information, please contact me on the number below.

Regards,

Marc Desmond
Strategic Land Use Planner
Sydney Planning | Greater Sydney
Transport for NSW

M 0475 825 820
Level 6, 27 Argyle Street, Parramatta

Mr Warwick Winn
General Manager
Penrith City Council
PO Box 60
Penrith NSW 2751

Via Email: city.planning@penrith.city

Re Planning Proposal 33-43 Phillip Street, St Marys

Dear Mr Winn

Thank you for your correspondence of requesting comment on the planning proposal for 33-43 Phillip Street, St Marys.

We note that the site is in close vicinity (approx. 60metres) to St Marys Railway Station Group listed on the State Heritage Register under the NSW Heritage Act 1977 (SHR No 01249) Despite this, a heritage impact assessment has not been included with the planning proposal.

It is understood that the current proposal seeks to increase the height to 32 to 61 metres.

Formal consideration should be given to the visual impact a building of the heights proposed may have on the setting of the St Marys Railway Station Group, and whether the proposed height increase and subsequent building will impact on significant views to and from the group. A better outcome is generally achieved where these matters are given consideration in the early planning stages and not at the time of the development proposal.

The potential for the proposal to act as a precedent for height of building increases should also be considered as the potential increase for building height requests across a range of sites in the future may incrementally impact on St Marys setting and views.

Preparation of a heritage impact statement may assist Council to answer any concerns raised about the proposal by the public. If issues of visual impact are considered early in the planning process, this may assist future building design and development proposals.

If you have any questions please contact Nicole Secomb Heritage, Programs Officer on 02 9873 8532 (Tues, Thurs, Fri) or via email at nicole.secomb@environment.nsw.gov.au.

Yours sincerely



Tim Smith OAM
Director, Heritage Operations
Heritage NSW
17 October 2019

Madison Foster

From: Nicole Secomb <Nicole.Secomb@environment.nsw.gov.au>
Sent: Tuesday, 29 October 2019 3:46 PM
To: Madison Foster
Subject: RE: Planning Proposal 33-43 Phillip Street, St Marys.

EXTERNAL EMAIL: This email was received from outside the organisation. Use caution when clicking any links or opening attachments.

Hi Maddison

We consider our response a comment/recommendation rather than objection

Warm regards
Nicole

From: Madison Foster <madison.Foster@penrith.city>
Sent: Tuesday, 29 October 2019 1:28 PM
To: Nicole Secomb <Nicole.Secomb@environment.nsw.gov.au>
Subject: RE: Planning Proposal 33-43 Phillip Street, St Marys.

Hi Nicole,


Thank you for returning my phone call earlier, could I clarify with you if this response is an objection to the planning proposal from the Office of Environment and Heritage?

Kind Regards,

Madison Foster
Planner

E madison.Foster@penrith.city
T +612 4732 8577 | F +612 4732 7958 | M
PO Box 60, PENRITH NSW 2751
www.visitpenrith.com.au
www.penrithcity.nsw.gov.au

PENRITH
CITY COUNCIL

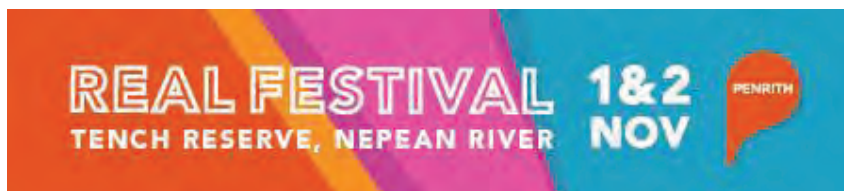

From: Amy Conway <Amy.Conway@environment.nsw.gov.au> **On Behalf Of** OEH HD Heritage Mailbox
Sent: Friday, 18 October 2019 9:30 AM
To: Local Plan Team <city.planning@penrith.city>
Cc: Nicole Secomb <Nicole.Secomb@environment.nsw.gov.au>
Subject: Planning Proposal 33-43 Phillip Street, St Marys.

EXTERNAL EMAIL: This email was received from outside the organisation. Use caution when clicking any links or opening attachments.

Dear Mr Winn

Please refer to the attached correspondence relating to ***Planning Proposal 33-43 Phillip Street, St Marys.***

Kind regards

Amy

Heritage Support Officer

Heritage NSW, Community Engagement, Department of Premier and Cabinet
Level 6, 10 Valentine Avenue, Parramatta | Locked Bag 5020, NSW 2124
T: 02 9873 8500 | heritagemailbox@environment.nsw.gov.au



This email is intended for the addressee(s) named and may contain confidential and/or privileged information.
If you are not the intended recipient, please notify the sender and then delete it immediately.
Any views expressed in this email are those of the individual sender except where the sender expressly and with authority states them to be the views of the NSW Office of Environment and Heritage.

PLEASE CONSIDER THE ENVIRONMENT BEFORE PRINTING THIS EMAIL

This email is intended for the addressee(s) named and may contain confidential and/or privileged information.
If you are not the intended recipient, please notify the sender and then delete it immediately.
Any views expressed in this email are those of the individual sender except where the sender expressly and with authority states them to be the views of the NSW Office of Environment and Heritage.

PLEASE CONSIDER THE ENVIRONMENT BEFORE PRINTING THIS EMAIL

From: Cornelis Duba
Sent: Wed, 2 Oct 2019 08:53:29 +1000
To: Penrith City Council - RECORDS
Cc: Natalie Stanowski; Jeff Smith
Subject: Penrith City Council Planning Proposal RZ16/0010 RE Station Plaza 33-43 Phillip Street, St Marys
Attachments: Penrith CC Planning Proposal RZ16-0010 Easement & Lease Plans.pdf, SW08773 Work near underground assets.pdf, EE Fact Sheet Building Construction.pdf, EE FPJ 4015 Relocation Removal July 2013.pdf, EE FPJ 4603 Permission to Remove Service July 2007.pdf, EE FPJ 6007 Technical Review Request July 2018.pdf, EE Guide for Padmount Substations.pdf, EE MDI0044 Easements and Property Tenure.pdf, EE Safety on the job.pdf, EE Safety Plumbing.pdf, ENA EMF What We Know.pdf

EXTERNAL EMAIL: This email was received from outside the organisation. Use caution when clicking any links or opening attachments.



The General Manager
Penrith City Council

ATTENTION: Natalie Stanowski, Principal Planner, City Planning

Dear Sir or Madam

I refer to Council's letter of 19 September 2019 regarding Planning Proposal RZ16/0010 at Station Plaza 33-43 Phillip Street, St Marys (Lot 7 DP 734738) to amend the Penrith Local Environmental Plan 2010 (LEP) to increase the maximum building height from 32 metres to 61 metres and increase the floor space ratio for the site from 3.5:1 to 5.5:1. The proposed redevelopment, which would also require Council's development consent, could be up to 20 storeys high and contain 600 apartments, 8,300m² of retail and commercial floor space, and car parking to service the development. Submissions need to be made to Council by 18 October 2019.

As shown in the below site plan from Endeavour Energy's G/Net master facility model (and extract from Google Maps Street View) there are:

- Easements benefitting Endeavour Energy over the western adjoining Lot 9 DP 840717 (Gidley Street / Veness Place Car Parking) for low voltage and 11,000 volt / 11 kilovolt (kV) high voltage underground cables going to indoor substation no. 18006 (indicated by the symbol ) which was held under an expired lease and adjoins a padmount substation (indicated by the symbol ) with 11 kV high voltage underground cables. Please refer to the attached copies of the relevant plans.
- Low voltage and 11 kV high voltage underground cables to the Phillip Street road verge / roadway.
- Low voltage underground cables to the Station Street road verge / roadway.

Please note the location, extent and type of any electricity infrastructure, boundaries etc. shown on the plan is indicative only. Generally (depending on the scale and/or features selected), low voltage (normally not exceeding 1,000 volts) is indicated by blue lines and high voltage (normally exceeding 1,000 volts but for Endeavour Energy's network not exceeding 132,000 volts / 132 kV) by red lines (these lines can appear as solid or dashed and where there are multiple lines / cables only the higher voltage may be shown). This plan only shows the Endeavour Energy network and does not show electricity infrastructure belonging to other authorities or customers owned electrical equipment beyond the customer connection point / point of supply to the property. This plan is not a 'Dial Before You Dig' plan under the provisions of Part 5E 'Protection of underground electricity power lines' of the Electricity Supply Act 1995 (NSW).

Although the indoor substation and padmount substation and associated cabling on the site are not held under easement, they are protected assets under the Electricity Supply Act 1995 (NSW) Section 53 'Protection of certain electricity works'. The owner or occupier of the land cannot take any action by reason of the presence or operation of the electricity works in, on or over the land ie. they cannot remove the electricity infrastructure from the property. These protected assets are managed on the same basis as if an easement was in existence – please refer to the blow point 'Easement Management / Network Access'.

In accordance with the attached copy of Endeavour Energy's Mains Design Instruction MDI 0044 'Easements and Property Tenure Rights', and as shown in the following extract of Table 1 – 'Minimum easement widths':

Table 1 - Minimum easement widths

	Voltage	Asset Type	Construction	Minimum Easement (m)
Underground Assets	400V - 22kV	Cables	Underbore / Ducted / Direct buried	3
			Ducted < 100m and with concrete protection (min 50 mm concrete cover at standard burial depth)	1
Other	-	Padmount Substation		2.75 x 5.5 (see clause 5.3.6)
		Indoor Substation		See clause 5.3.5

- The padmount substation requires a minimum easement of 2.75 x 5.5 metres.

Padmount substations also have the additional restrictions for fire rating (which usually extends 3 metres horizontally from the base of the substation footing, and 6 metres vertically from the same point and also has regard to any structures etc. attached to the building that may spread a fire) and swimming pools and spas (which usually extends 5 metres from the easement but in this instance does not appear to be applicable).

- The 11 kV high voltage underground cables (assumed to have no concrete protection unless proven otherwise) requires a 3 metre minimum easement width ie. 1.5 metres to both sides of the centre line of the cable ducts.
- The indoor substation:

5.3.5 Indoor substations

The boundaries of an easement for indoor substation must be defined by the internal face of the walls, ceiling, floor, and cable trenches of the substation room.

An easement for the cables that enter and exit the substation room will also be required if they are not installed within public roads and/or existing Endeavour Energy easements.

A right of access may also be required to give Endeavour Energy employees, vehicles, and equipment unrestricted access to the indoor substation at all times.

Subject to the foregoing and the following recommendations and comments Endeavour Energy has no objection to the Planning Proposal.

- Network Capacity / Connection

Endeavour Energy has noted the following in the Planning Proposal

Section D – State and Commonwealth Interests

Note: This part of the planning proposal may be updated following consultation with Public Authorities.

Infrastructure Provision

The site is within an urban area and should be adequately serviced by all required infrastructure and utilities, including public transport. This section will be developed following consultation with the public authorities responsible for the provision of that infrastructure. This work will confirm if the existing infrastructure has the capacity to accommodate the proposed development. If it identifies that there may be an expected shortfall in service provision, extra studies will be undertaken to identify the extent of the shortfall and potential mechanisms to address that shortfall.

State and Commonwealth Public Authorities

Council will consult with the following State and Commonwealth public authorities in accordance with the requirements of the Gateway Determination:

- Transport for NSW – Sydney Trains
- Roads and Maritime Services
- Office of Environment and Heritage
- Sydney Water and other relevant service providers.

The Urban Design Report does not show any provision being made for a replacement substation.



Figure 23 Indicative Street Level Floor Plan

Endeavour Energy's Asset Strategy & Planning Branch whilst not having undertaken a detailed analysis of the Planning Proposal have provided the following advice:

Endeavour Energy's G/Net master facility model indicates that the indoor substation currently has 9 customer connection points servicing 15 premises and the padmount substation currently has 1 customer connection points servicing 15 premises – being the supply for Station Plaza.

These substations / transformers would need to be removed during the demolition of the site. This asset removal will need to be dealt with as part of a separate network connections Asset Relocation project and alternative supply provided for the other premises currently connected to the substations.

From a high voltage planning perspective, the further increase in building height represents a further substantial increase in electrical load. The supply of this additional load may require a new 11 kV distribution feeder to be developed from a nearby Endeavour Energy zone substation, possibly Werrington Zone Substation located approximately 2.5 kilometres by road to the north at 242-246 Forrester Road, St Marys (Lot 102 DP 31911).

The foregoing depends on the actual required load for the proposed redevelopment of the site. A proper load assessment by the customer's Level 3 Accredited Service Provider (ASP) or Consultant Engineer and Endeavour Energy's Capacity Planner will be needed to determine the best method of connection and any reconfigurations and upgrades. The customer will need to make application for the connection of the additional load as per Endeavour Energy's normal customer connection processes.

In due course the applicant for the proposed development of the site will need to submit an application for connection of load via Endeavour Energy's Network Connections Branch to carry out the final load assessment and the method of supply will be determined. Depending on the outcome of the assessment, any required padmount or indoor substation/s

will need to be located within the property (in a suitable and accessible location) and be protected (including any associated cabling) by an easement and associated restrictions benefiting and gifted to Endeavour Energy. Please refer to Endeavour Energy's Mains Design Instruction MDI 0044 'Easements and Property Tenure Rights'. Further details are available by contacting Endeavour Energy's Network Connections Branch via Head Office enquiries on telephone: 133 718 or (02) 9853 6666 from 8am - 5:30pm or on Endeavour Energy's website under 'Home > Residential and business > Connecting to our network' via the following link:

<http://www.endeavourenergy.com.au/>

Advice on the electricity infrastructure required to facilitate the proposed development (including asset relocations) can be obtained by submitting a Technical Review Request to Endeavour Energy's Network Connections Branch, the form for which FPJ6007 is attached and further details (including the applicable charges) are available from Endeavour Energy's website under 'Our connection services'. The response to these enquiries is based upon a desktop review of corporate information systems, and as such does not involve the engagement of various internal stakeholders in order to develop a 'Connection Offer'. It does provide details of preliminary connection requirements which can be considered by the applicant prior to lodging a formal application for connection of load.

Alternatively the applicant should engage an Accredited Service Provider (ASP) of an appropriate level and class of accreditation. The ASP scheme is administered by NSW Planning & Environment and details are available on their website via the following link or telephone 13 77 88:

<https://energysaver.nsw.gov.au/households/you-and-energy-providers/installing-or-altering-your-electricity-service> .

Endeavour Energy is urging applicants /customers to engage with an Electrical Consultant prior to finalising plans to in order to assess and incorporate any required electricity infrastructure. In so doing the consideration can also be given to its impact on the other aspects of the proposed development. This can assist in avoiding the making of amendments to the plan or possibly the need to later seek modification of an approved development application.

- Location of Electricity Easements

Endeavour Energy's preference is to have continuity of its easements over the most direct and practicable route affecting the least number of lots as possible. The incorporation of electricity easements into privately owned lots is generally problematic for both Endeavour Energy and the future landowners and requires additional easement management to ensure no uncontrolled activities / encroachments occur within the easement area.

Proposed distribution substation locations on a site will require a detailed assessment to consider the suitability of access, safety clearances, fire ratings, impact on adjoining properties etc. For example, to avoid the creation of restrictions on the adjoining site the development shown in the following extract of Google Maps Street View is of a site at 18 Copeland Street Liverpool required the installation of a fire wall next to the padmount substation. Whilst meeting the fire rating requirements etc. from an aesthetics perspective this is not an attractive outcome.



Fire wall constructed for padmount substation at 18 Copeland Street Liverpool. Source: Google Maps Street View.

- Urban Network Design

Endeavour Energy's Company Policy 9.2.5 'Network Asset Design', includes the following requirements for electricity connections to new urban subdivision / development:

5.11 Reticulation policy

5.11.1 Distribution reticulation

In order to improve the reliability performance of and to reduce the operating expenditure on the network over the long term the company has adopted the strategy of requiring new lines to be either underground cables or where overhead is permitted, to be predominantly of covered or insulated construction. Notwithstanding this strategy, bare wire overhead construction is appropriate and permitted in some situations as detailed below.

In areas with the potential for significant overhanging foliage, CCT is used to provide increased reliability as it is less susceptible to outages from wind-blown branches and debris than bare conductors. CCT must only be used in treed² areas as the probability of a direct lightning strike is low. In open areas where the line is not shielded from a direct lightning strike, bare conductors must generally be used for 11kV and 22kV reticulation.

Non-metallic Screened High Voltage Aerial Bundled Cable (NMSHVABC) must be used in areas which are heavily treed and where it is not practicable to maintain a tree clearing envelope around the conductors.

² A "treed" area is one with a substantial number of trees adjacent to the line, in each span. In these situations CCT is used to provide increased reliability as it is less susceptible to outages from wind-blown

5.11.1.1 Urban areas

Reticulation of new residential subdivisions will be underground. In areas of low bushfire consequence, new lines within existing overhead areas can be overhead, unless underground lines are cost justified or required by either environmental or local council requirements.

Where underground reticulation is required on a feeder that supplies a mixture of industrial, commercial and/or residential loads, the standard of underground construction will apply to all types of load within that development.

Where ducting is used, adequate spare ducts and easements must be provided at the outset to cover the final load requirements of the entire development plan.

Extensions to the existing overhead 11kV/22kV network must generally be underground. Bare wire will be used for conductor replacements and augmentations except in treed areas where CCT or NMSHVABC must be used.

Extensions to the existing overhead LV network and augmentations must either be underground or ABC. Conductor replacements greater than 100m in route length must utilise aerial bundled cable.

- Streetlighting

With the increase in both vehicular and pedestrian traffic, the streetlighting for the proposed development should be reviewed and if necessary upgraded to comply with the series of standards applying to the lighting of roads and public spaces set out in with Australian/New Zealand Standard AS/NZS 1158: 2010 'Lighting for roads and public spaces' as updated from time to time.

Whilst the determination of the appropriate lighting rests with the road controlling authority, Endeavour Energy as a Public Lighting Service Provider is responsible for operating and maintaining the streetlights on behalf of local councils, Roads and Maritime Services and other utilities in accordance with the NSW Public Lighting Code, January 2006 (Code).

Endeavour Energy recognises that well designed, maintained and managed Public Lighting offers a safe, secure and attractive visual environment for pedestrians and drivers during times of inadequate natural light.

For any Code implementation and administration / technical matters please contact Endeavour Energy's Substation Mains Assets Section via Head Office enquiries on telephone: 133 718 or (02) 9853 6666 from 8am - 5:30pm or email mainsenquiry@endeavourenergy.com.au .

- Earthing

The construction of any building or structure (including fencing, signage, flag poles, hoardings etc.) whether temporary or permanent that is connected to or in close proximity to Endeavour Energy's electrical network is required to comply with Australian/New Zealand Standard AS/NZS 3000:2018 'Electrical installations' as updated from time to time. This Standard sets out requirements for the design, construction and verification of electrical installations, including ensuring there is adequate connection to the earth. Inadequate connection to the earth to allow a leaking/fault current to flow into the grounding system and be properly dissipated places persons, equipment connected to the network and the electricity network itself at risk from electric shock, fire and physical injury.

- Easement Management / Network Access

The following is a summary of the usual / main terms of Endeavour Energy's electrical easements requiring that the land owner:

- Not install or permit to be installed any services or structures within the easement site.
- Not alter the surface level of the easement site.
- Not do or permit to be done anything that restricts access to the easement site without the prior written permission of Endeavour Energy and in accordance with such conditions as Endeavour Energy may reasonably impose.

Endeavour Energy's preference is for no activities or encroachments to occur within its easement areas. Most activities are prohibited within the padmount substation easement area. However, if any proposed works (other than those approved / certified by Endeavour Energy's Network Connections Branch as part of an enquiry / application for load or asset relocation project) will encroach/affect Endeavour Energy's easements or protected assets, contact must first be made with the Endeavour Energy's Easements Officer, Jeffrey Smith, on direct telephone 9853 7139 or alternately email Jeffrey.Smith@endeavourenergy.com.au or Easements@endeavourenergy.com.au .

For further information please refer to Endeavour Energy's Mains Design Instruction MDI 0044 'Easements and Property Tenure Rights'. Please also find attached for the applicant's reference a copy Endeavour Energy's 'Guide to Fencing, Retaining Walls and Maintenance Around Padmount Substations'.

It is imperative that the access to the existing electrical infrastructure on and in proximity of the site be maintained at all times. To ensure that supply electricity is available to the community, access to the electricity infrastructure may be required at any time. Restricted access to electricity infrastructure by maintenance workers causes delays in power restoration and may have severe consequences in the event of an emergency.

- Prudent Avoidance

The electricity network is operational 24/7/365 ie. all day, every day of the year. The electricity industry has adopted a policy of prudent avoidance by doing what can be done without undue inconvenience and at modest expense to avert the possible risk to health from exposure to emissions from electricity infrastructure such as electric and magnetic fields (EMF) and noise which generally increase the higher the voltage ie. Endeavour Energy's network ranges from low voltage (normally not exceeding 1,000 volts) to high voltage (normally exceeding 1,000 volts but not exceeding 132,000 volts / 132 kV). In practical terms this means that when designing new transmission and distribution facilities, consideration is given to locating them where exposure to the more sensitive uses is reduced and increasing separation distances.

Endeavour Energy believes that likewise applicants (and Council) should also adopt a policy of prudent avoidance by the siting of more sensitive uses away from any electricity infrastructure – including any possible future electricity infrastructure required to facilitate the proposed development. Where development is proposed in the vicinity of electricity infrastructure, Endeavour Energy is not responsible for any amelioration measures for such emissions that may impact on the nearby proposed development.

Even with less sensitive non-residential development, Endeavour Energy believes that a policy of prudent avoidance should be considered eg. those parts of the site regularly occupied by people such as office components of a building, away from any electricity infrastructure.

Please find attached a copy of Energy Networks Association's 'Electric & Magnetic Fields – What We Know' which can also be accessed via their website at <https://www.energynetworks.com.au/electric-and-magnetic-fields> and provides the following advice:

Electric fields are strongest closest to their source, and their strength diminishes rapidly as we move away from the source.

The level of a magnetic field depends on the amount of the current (measured in amps), and decreases rapidly once we move away from the source.

Typical magnetic field measurements associated with Endeavour Energy's activities and assets given the required easement widths, safety clearances etc. and having a maximum voltage of 132,000 volt / 132 kV, will with the observance of these separation distances not exceed the recommended magnetic field public exposure limits.

- Vegetation Management

The planting of large trees in the vicinity of electricity infrastructure is not supported by Endeavour Energy. Suitable planting needs to be undertaken in proximity of electricity infrastructure (including any new electricity infrastructure required to facilitate the proposed development). Larger trees should be planted well away from electricity infrastructure and even with underground cables, be installed with a root barrier around the root ball of the plant. Landscaping that interferes with electricity infrastructure could become a potential safety risk, restrict access, reduce light levels from streetlights or result in the interruption of supply may become subject to Endeavour Energy's Vegetation Management program and/or the provisions of the Electricity Supply Act 1995 (NSW) Section 48 'Interference with electricity works by trees' by which under certain circumstances the cost of carrying out such work may be recovered.

- Dial Before You Dig

Before commencing any underground activity the applicant is required to obtain advice from the **Dial Before You Dig 1100** service in accordance with the requirements of the Electricity Supply Act 1995 (NSW) and associated Regulations.

This should be obtained by the applicant not only to identify the location of any underground electrical and other utility infrastructure across the site, but also to identify them as a hazard and to properly assess the risk.

- Removal of Electricity Supply

Approval for the permanent disconnection and removal of supply must be obtained from Endeavour Energy's Network Connections Branch (contact via Head Office enquiries on telephone: 133 718 or (02) 9853 6666 from 8am - 5:30pm) by Accredited Service Providers (ASP) with the relevant class of Authorisation for the type of work being carried out. The work could involve:

- The disconnection and removal of an underground service cable or overhead service line,
- Removal of metering equipment.

The written request must be submitted to Endeavour Energy using Form FPJ4603 'Permission to Remove Service / Metering by Authorised Level 2 Accredited Service Provider' which must be accompanied by Notification of Service Works (NOSW) forms provided as a result of service work activity performed by a Level 2 ASP. The retailer must also provide written agreement for the permanent removal of supply.

For details of the ASP scheme please refer to the above point 'Network Capacity / Connection'.

- Demolition

Demolition work is to be carried out in accordance with Australian Standard AS 2601—2001: 'The demolition of structures' as updated from time to time. All electric cables or apparatus which are liable to be a source of danger, other than a cable or apparatus used for the demolition works shall be disconnected ie. the existing customer service lines will need to be isolated and/or removed during demolition. Appropriate care must be taken to not otherwise interfere with any electrical infrastructure on or in the vicinity of the site eg. streetlight columns, power poles, overhead power lines and underground cables etc.

- Asbestos

Endeavour Energy's G/Net master facility model indicates that the site is in an area identified or suspected of having asbestos or asbestos containing materials (ACM) present in the electricity network. Whilst Endeavour Energy's underground detail is not complete within G/Net in some areas, in older communities, cement piping was regularly used for the electricity distribution system and in some instances containing asbestos to strengthen the pipe; for insulation; lightness and cost saving.

When undertaking works on or in the vicinity of Endeavour Energy's electricity network, asbestos or ACM must be identified by a competent person employed by or contracted to the applicant and an asbestos management plan, including its proper disposal, is required whenever construction works has the potential to impact asbestos or ACM.

The company's potential locations of asbestos to which construction / electricity workers could be exposed include:

- o customer meter boards;
- o conduits in ground;
- o padmount substation culvert end panels; and
- o joint connection boxes and connection pits.

Further details are available by contacting Endeavour Energy's Health, Safety & Environment Assurance Section via Head Office enquiries on telephone: 133 718 or (02) 9853 6666 from 8am - 5:30pm.

- Excavation

The applicant should be advised of the following object of Section 49A 'Excavation work affecting electricity works' of the of Electricity Supply Act 1995 (NSW) covering the carrying out or proposed carrying out of excavation work in, on or near Endeavour Energy's electrical infrastructure.

Electricity Supply Act 1995 No 94

Current version for 1 August 2018 to date (accessed 4 September 2018 at 08:54)

Part 5 > Division 2 > Section 49A

< >

49A Excavation work affecting electricity works

- (1) This section applies if a network operator has reasonable cause to believe that the carrying out or proposed carrying out of excavation work in, on or near its electricity works:
 - (a) could destroy, damage or interfere with those works, or
 - (b) could make those works become a potential cause of bush fire or a potential risk to public safety.
- (2) In those circumstances, a network operator may serve a written notice on the person carrying out or proposing to carry out the excavation work requiring the person:
 - (a) to modify the excavation work, or
 - (b) not to carry out the excavation work, but only if the network operator is of the opinion that modifying the excavation work will not be effective in preventing the destruction or damage of, or interference with, the electricity works concerned or in preventing those works becoming a potential cause of bush fire or a potential risk to public safety.

With the increased number of developments incorporating basements often being constructed to the property boundaries or immediately adjacent to easements, the integrity of the nearby electricity infrastructure can be placed at risk.

If any excavation work affects Endeavour Energy's electricity infrastructure, prior contact must be made to Endeavour Energy's Regional Services North via Head Office enquiries on telephone: 133 718 or (02) 9853 6666 from 8am - 5:30pm or alternately email Regional.ServicesNorth@endeavourenergy.com.au.

- Public Safety

Workers involved in work near electricity infrastructure run the risk of receiving an electric shock and causing substantial damage to plant and equipment. I have attached Endeavour Energy's public safety training resources, which were developed to help general public / workers to understand why you may be at risk and what you can do to work safely. The public safety training resources are also available via Endeavour Energy's website via the following link:

<http://www.endeavourenergy.com.au/wps/wcm/connect/ee/nsw/nsw+homepage/communitynav/safety/safety+brochures>.

If the applicant has any concerns over the proposed works in proximity of the Endeavour Energy's electricity infrastructure to the road verge / roadway, as part of a public safety initiative Endeavour Energy has set up an email account that is accessible by a range of stakeholders across the company in order to provide more effective lines of communication with the general public who may be undertaking construction activities in proximity of electricity infrastructure such as builders, construction industry workers etc. The email address is Construction.Works@endeavourenergy.com.au.

- Emergency Contact

In case of an emergency relating to Endeavour Energy's electrical network, the applicant should note the Emergencies Telephone is 131 003 which can be contacted 24 hours/7 days. Endeavour Energy's contact details should be included in any relevant risk and safety management plan.

I appreciate that not all the foregoing issues may be directly or immediately relevant or significant to the Planning Proposal. However, Endeavour Energy's preference is to alert proponents / applicants of the potential matters that may arise should development within closer

proximity of the existing and/or required electricity infrastructure needed to facilitate the proposed development on or in the vicinity of the site occur.

Could you please pass on a copy of this submission and the attached resources to the proponent? Should you wish to discuss this matter, or have any questions, please do not hesitate to contact me or the contacts identified above in relation to the various matters. Due to the high number of development application / planning proposal notifications submitted to Endeavour Energy, to ensure a response contact by email to property.development@endeavourenergy.com.au is preferred.

Yours faithfully

Cornelis Duba

Development Application Specialist

Network Environment & Assessment


T: 9853 7896

E: cornelis.duba@endeavourenergy.com.au


51 Huntingwood Drive, Huntingwood NSW 2148

www.endeavourenergy.com.au




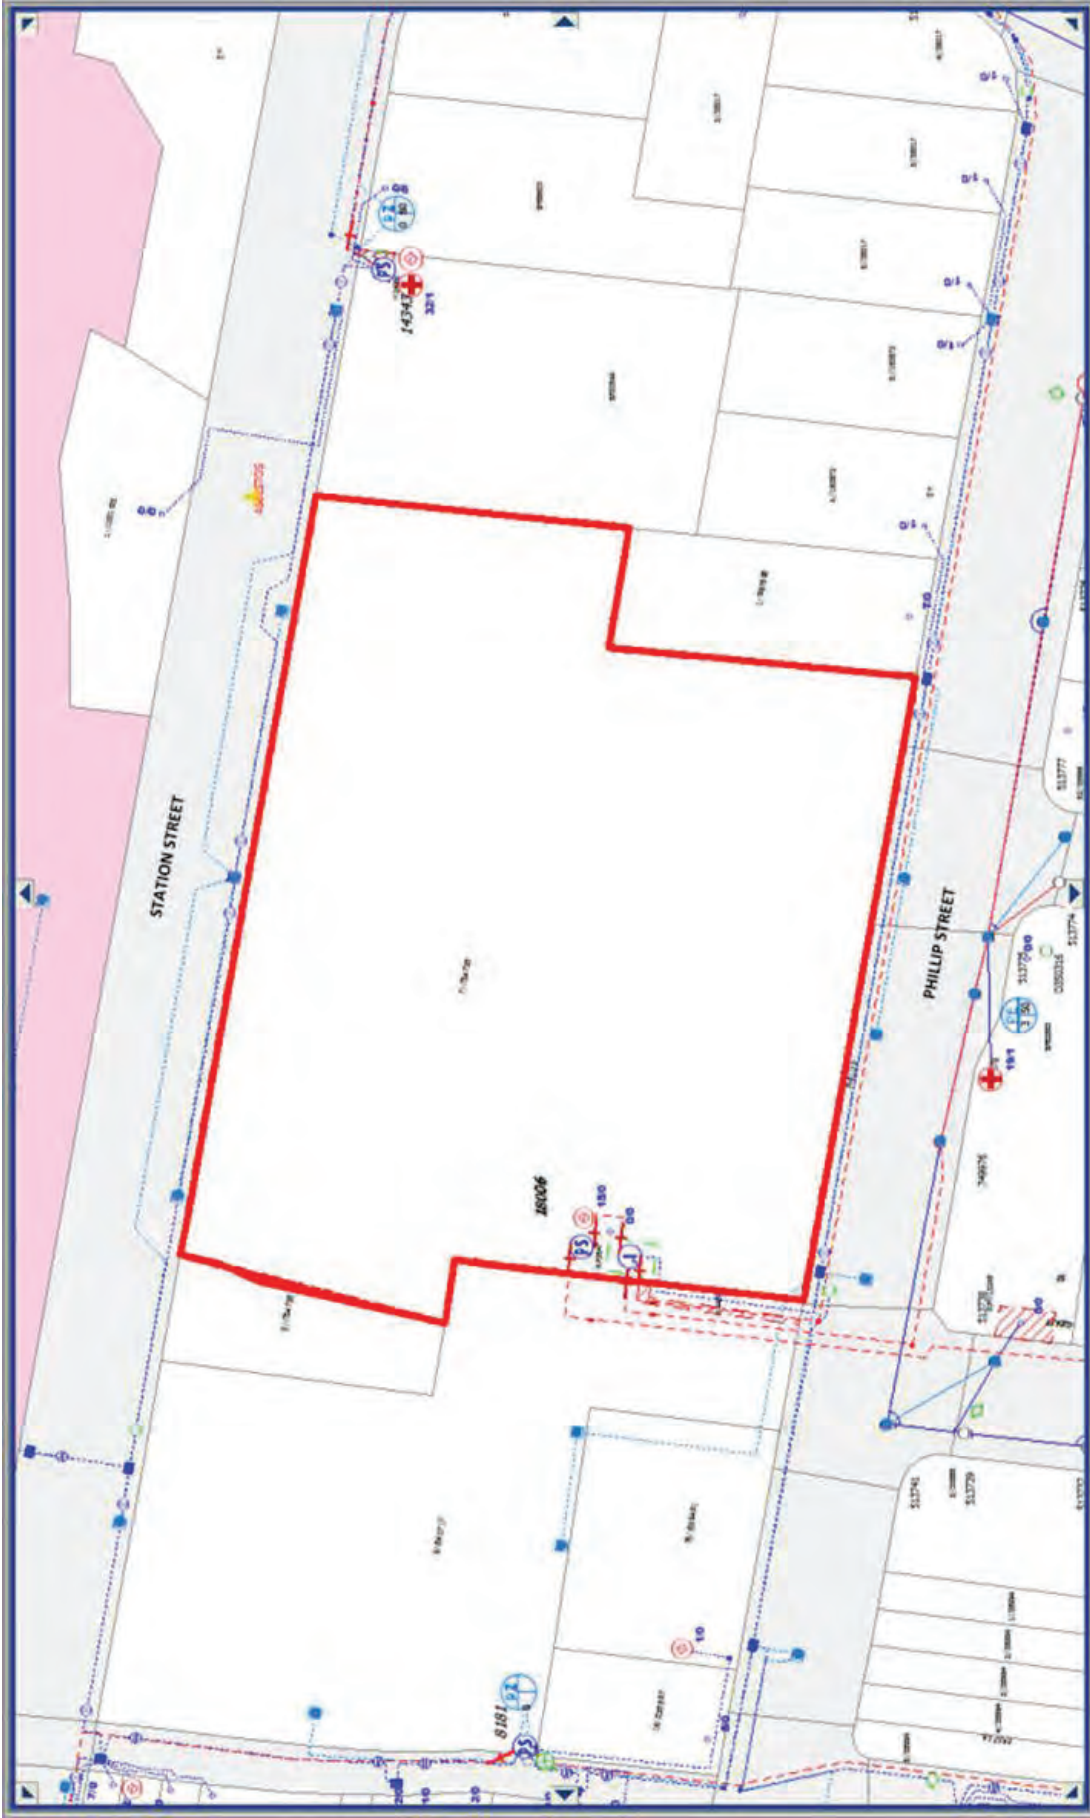

GSE_FID		Feature Name	Component Name	GSE_CID	GSE_ID	LOT	SECTION	DP
65949814		Crown Parcel	Crown Parcel Find	1	1795653	7		734738
63806812		Crown Parcel	Crown Parcel Find	1	1669220	7		734738

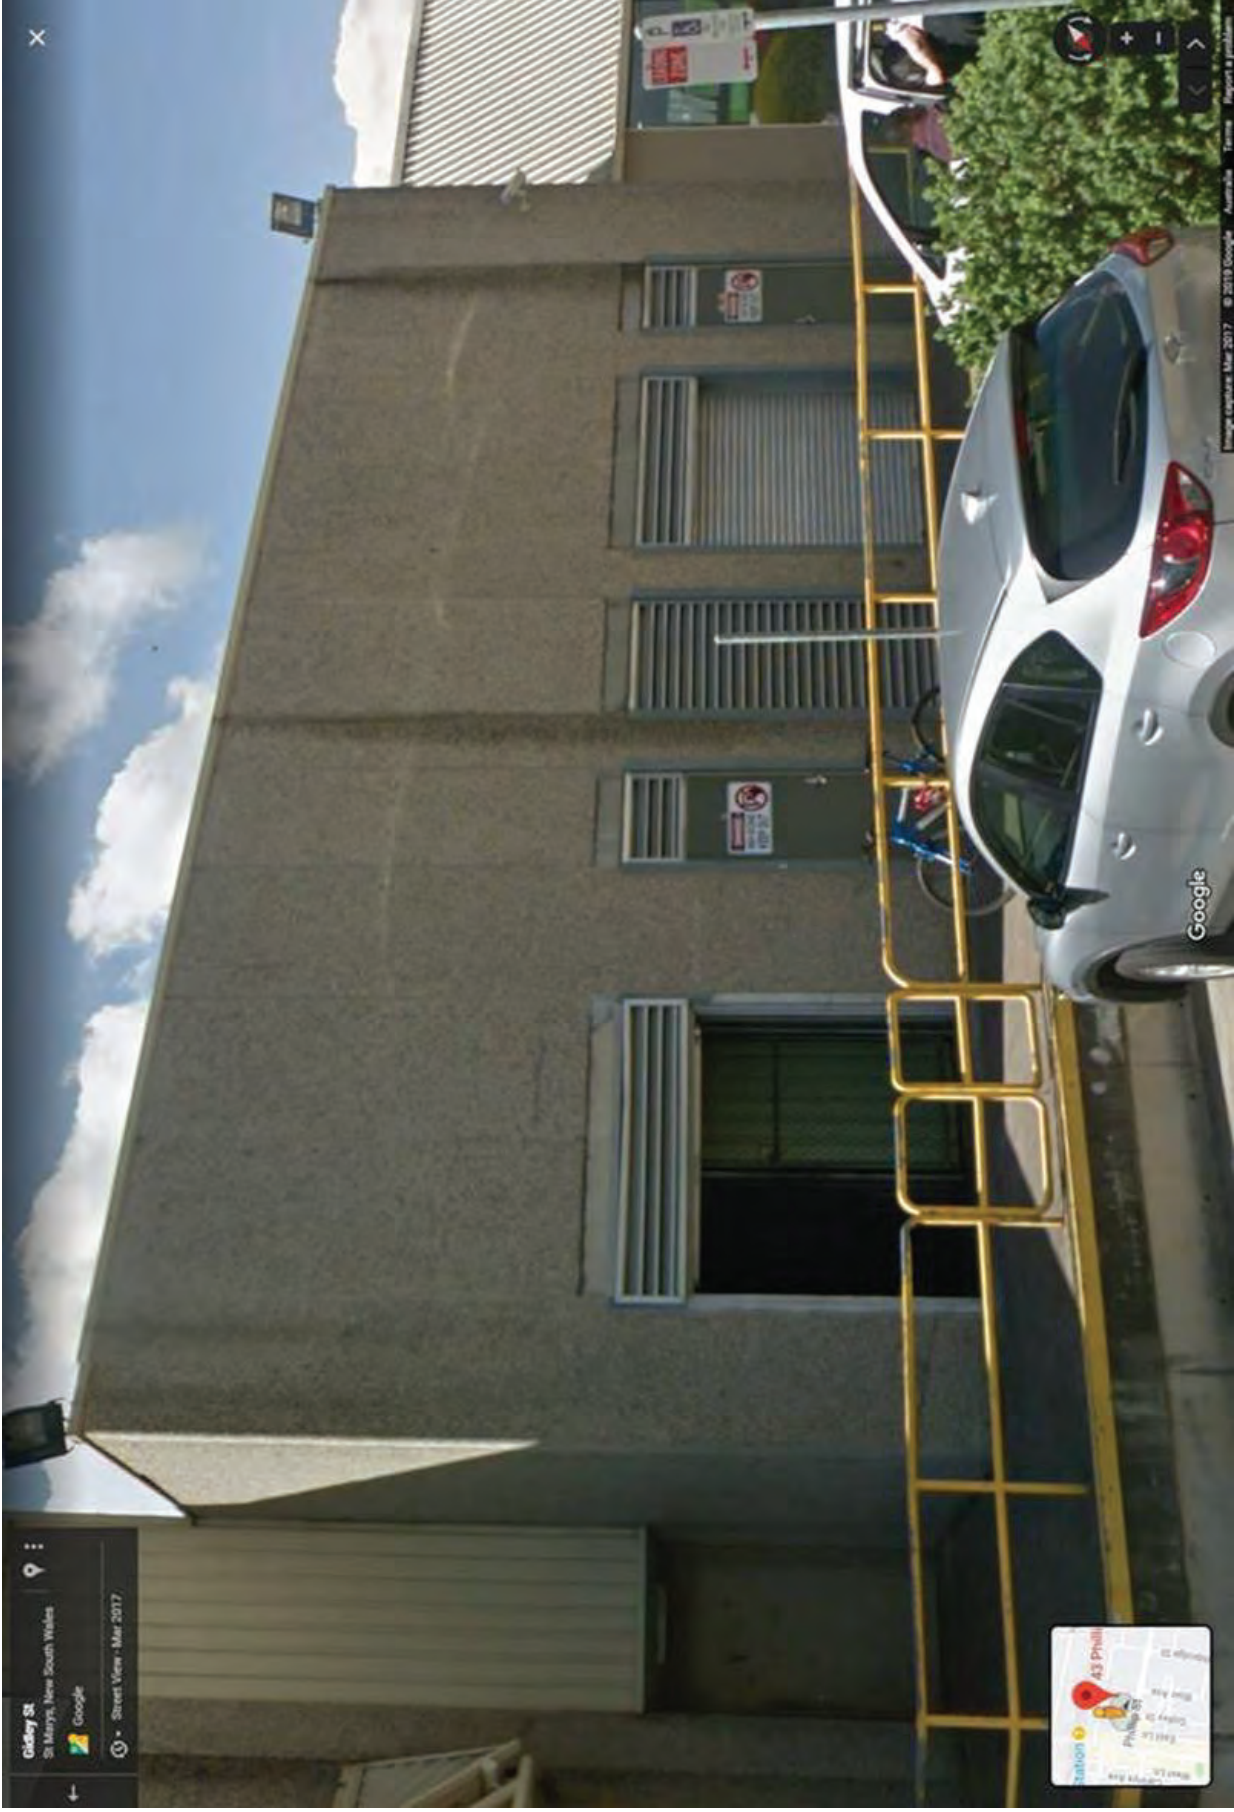

Signatures and seals only

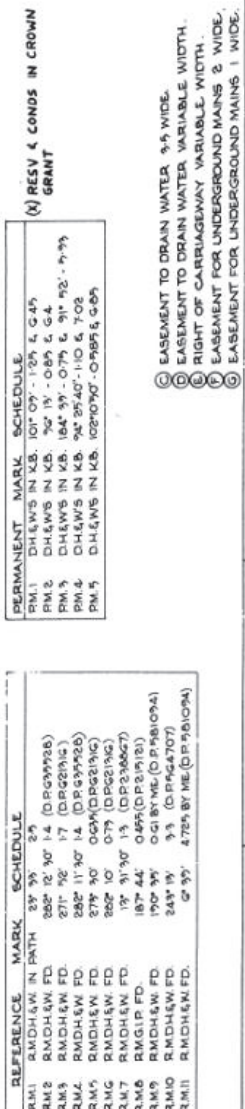[illegible]


1/6577

SUBJECT'S REFERENCE 201/65 P.C.

This negative is a photograph made as a permanent record of a document in the custody of the Registrar General this day. 20 July 1994

	10	20	30	40	50	60	70	Table of mm	110	120	130	140
--	----	----	----	----	----	----	----	-------------	-----	-----	-----	-----

Document: [REDACTED]
Version: 1, Version Date: 02/10/2019

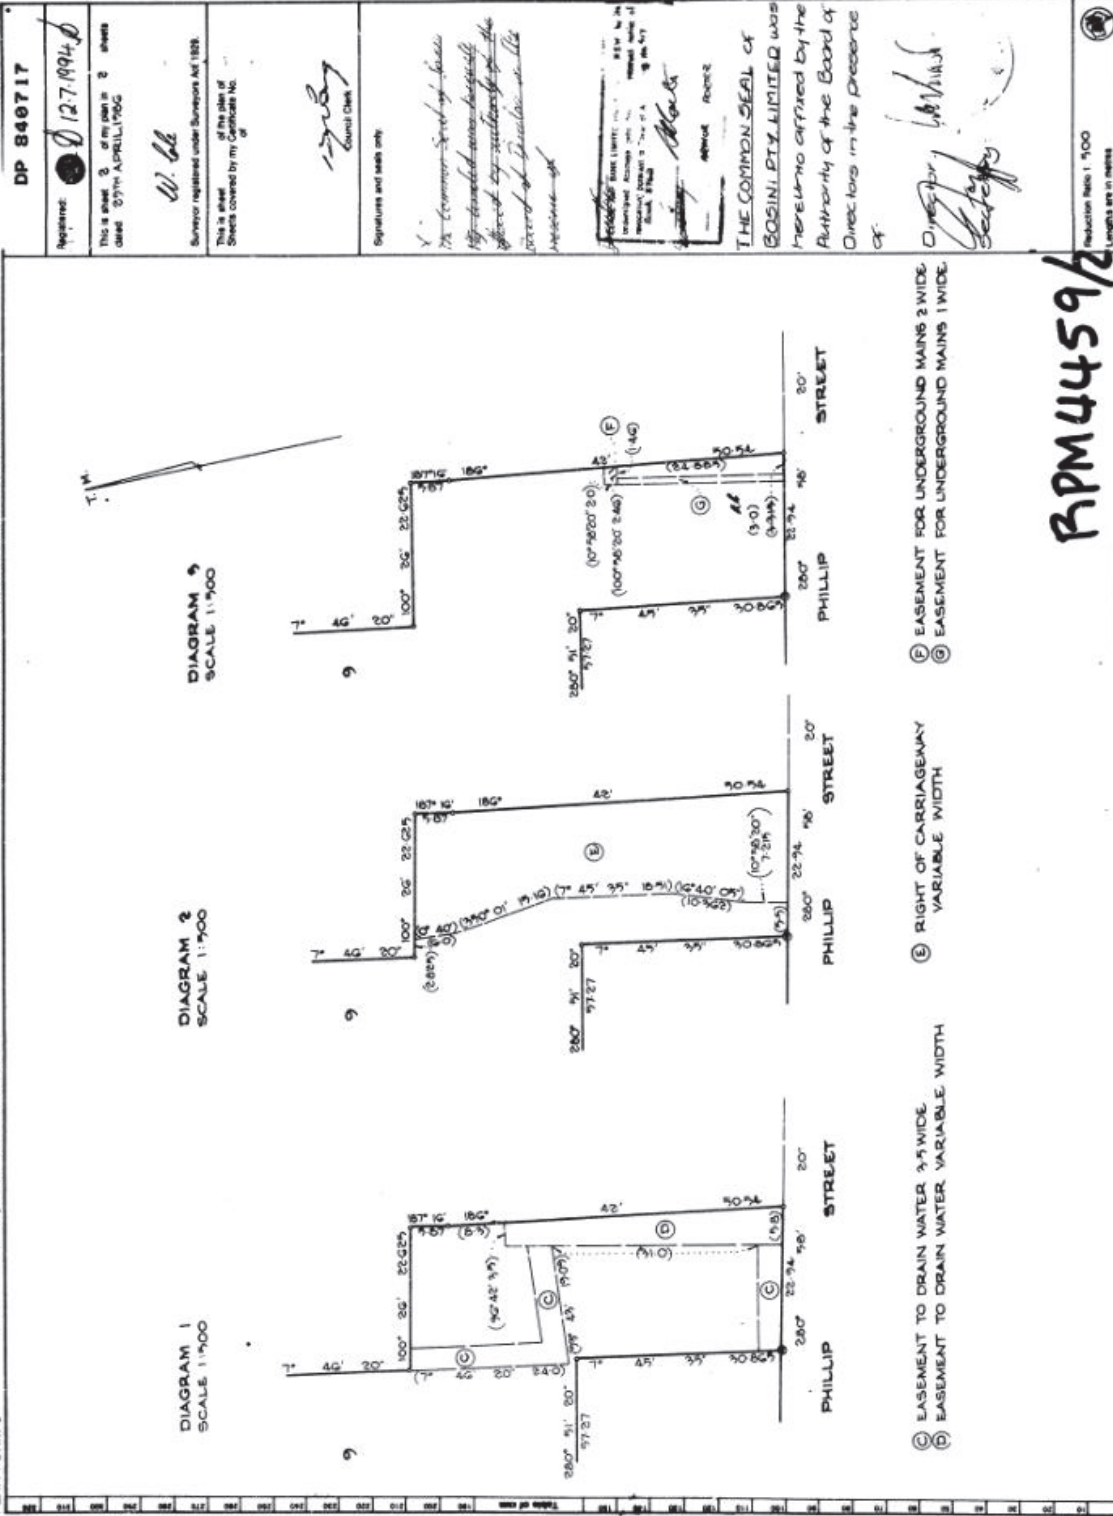

RPM4459/k

This negative is a photograph made as a permanent record of a document in the custody of the Registrar General this day, 20 July 1994

10 20 30 40 50 60 70 Table of mm 110 120 130 140


PLAN FORM 2

SYMBOLS, SEALS AND STATEMENTS OF LIABILITY TO BE COMPLETED BY THE SURVEYOR AND TO BE PLACED ON THE DRAWING. THESE STATEMENTS OF LIABILITY ARE NOT TO BE USED FOR ANY OTHER PURPOSES.



- NOTES:
1. THE INNER FACES OF WALLS OF THE STRUCTURE SHOWN HEREON AS SUBSTATION PREMISES N°1800G FORM THE BOUNDARIES OF THE PROPOSED LEASE.
 2. THE BOUNDARIES OF THE PROPOSED LEASE HAVE NOT BEEN MARKED.

"A"-B: R.M.-R.M.: 52° 42' 05" - 147-02 BY D.P. 734-738 & BY ME

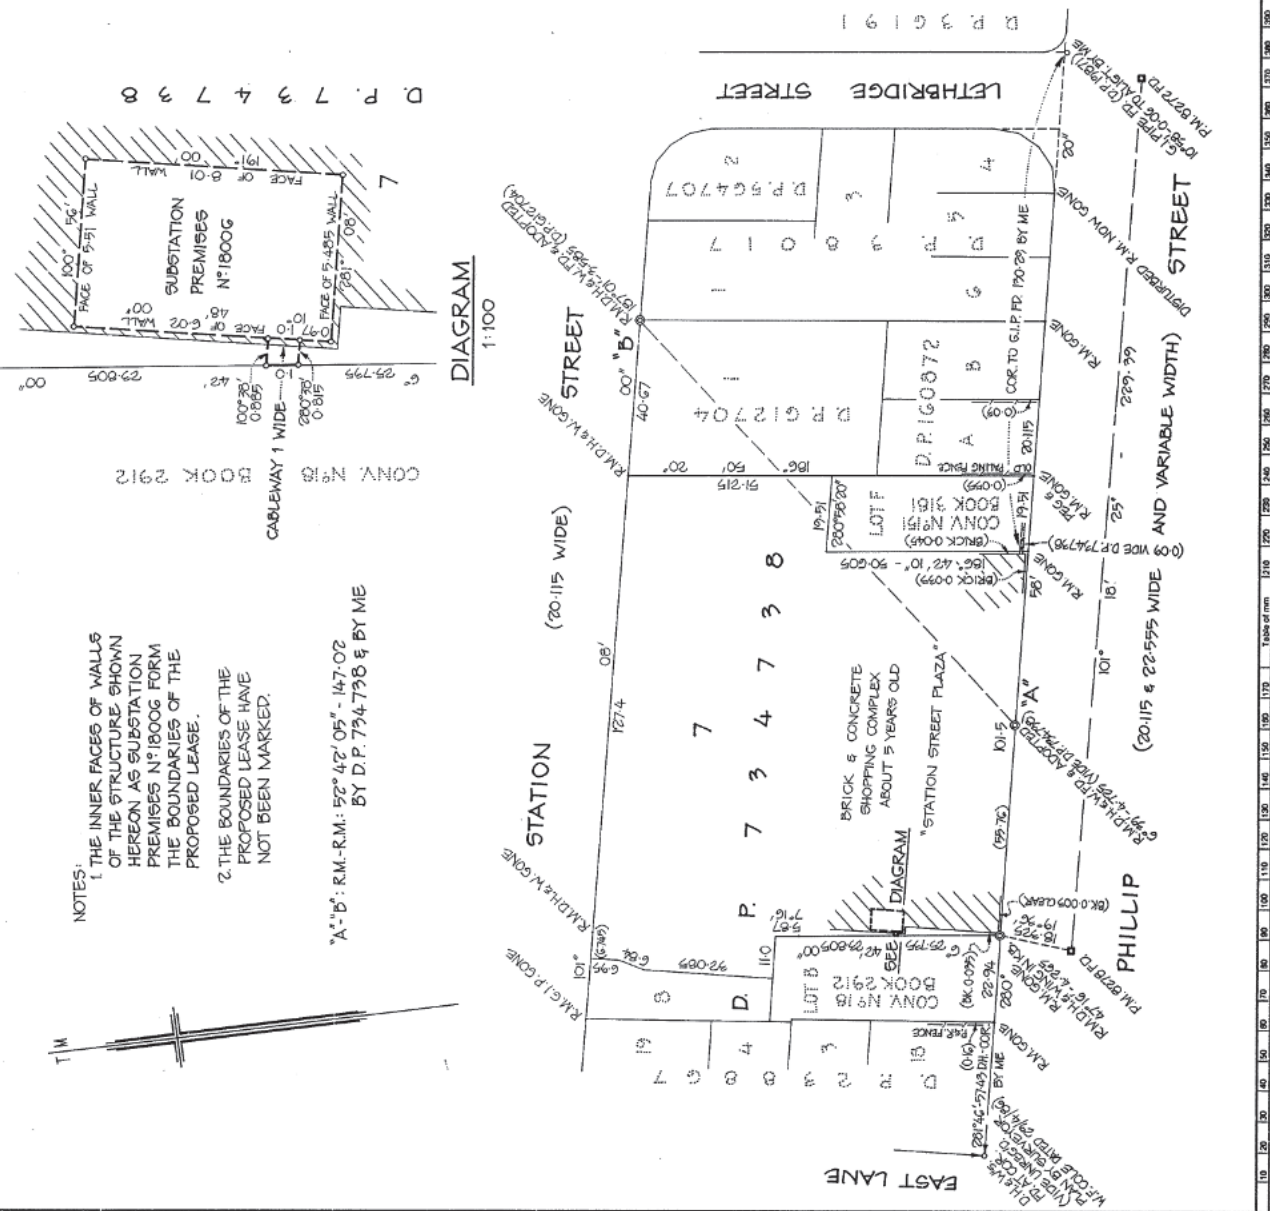

WARNING: CREASING OR FOLDING WILL LEAD TO REJECTION

SURVEYOR'S REFERENCE R.P. 9647 (CHECK LIST)

OFFICE USE ONLY

Registered:	
C.A.	
Title System:	TORRANS
Purpose:	LEASE
Ref. Map:	U7300-63
Last Plan:	D.P. 734-738
PLAN OF SUBSTATION PREMISES N°1800G AND ASSOCIATED CABLEWAY (1 WIDE) WITHIN LOT 7 D.P. 734-738.	
Lengths are in metres.	Reduction Ratio 1:800
Municipality:	PENRITH
Locality:	ST. MARKS
Parish:	ROOTY HILL
County:	CUMBERLAND
This is a sketch of a survey plan for the purpose of registration only. It is not to be used for any other purpose.	
I, JAN STEWART COUSIN, of the County of Cumberland, do hereby certify that I am a duly qualified and registered Surveyor under the Surveyors Act, 1925, as amended, and that I have prepared this plan in accordance with the provisions of the said Act, and that it is a true and correct copy of the original plan on which it is based.	
Signed: 27th SEPTEMBER, 1991.	
Surveyor registered under the Surveyors Act, 1925, as amended.	
Plats used in preparation of survey: D.P. 5007, 160072, 230067, 564707, 61704, 734-738, 999019, 19871.	
PANEL FOR USE ONLY for statements of liability to be completed by the Surveyor and to be placed on the drawing. THESE STATEMENTS OF LIABILITY ARE NOT TO BE USED FOR ANY OTHER PURPOSES.	



WORK NEAR UNDERGROUND ASSETS – GUIDE

SAFEWORK NSW

2007

This is a Utilities Industry Reference Group (IRG) project in partnership with SafeWork NSW and Industry. The Utilities IRG working party consisted of representatives from the following organisations:

- Alinta
- Australian Workers Union – Technical Administrative Professional Staff Branch
- Civil Contractors Federation
- Department Energy, Utilities and Sustainability
- EnergyAustralia
- Integral Energy
- Local Government Engineer's Association
- Local Government and Shires Association
- Roads and Traffic Authority
- Sydney Water
- Telstra
- SafeWork NSW.

Acknowledgement

The Working Party wishes to acknowledge that some references in this document are sourced from the *WorkSafe Victoria Guide for Undertaking Work Near Underground Assets*, the *Utility Providers Code of Practice for Western Australia* and the *NSW Streets Opening Conference Guide to Codes and Practices for Streets Opening*.

Disclaimer

This publication may contain information about the regulation and enforcement of work health and safety in NSW. It may include some of your obligations under some of the legislation that SafeWork NSW administers. To ensure you comply with your legal obligations you must refer to the appropriate legislation.

Information on the latest laws can be checked by visiting the NSW legislation website www.legislation.nsw.gov.au

This publication does not represent a comprehensive statement of the law as it applies to particular problems or to individuals or as a substitute for legal advice. You should seek independent legal advice if you need assistance on the application of the law to your situation.

This material may be displayed, printed and reproduced without amendment for personal, in-house or non-commercial use.

Catalogue No. SW08773

SafeWork NSW, 92–100 Donnison Street, Gosford, NSW 2250

Locked Bag 2906, Lisarow, NSW 2252 | Customer Experience 13 10 50

Website www.safework.nsw.gov.au

© Copyright SafeWork NSW 0118

CONTENTS

Preface	6	3.2.3 Eliminate or control the risk	17
What do the symbols in the Guideline mean?	6	3.2.4 Review risk assessment and control measures	17
1. Establishment	7	3.2.5 When must employers undertake risk management?	17
1.1 Title	7	3.2.6 Strategies for developing effective risk management procedures	17
1.2 Purpose	7	3.2.7 Personal protective equipment (PPE)	17
1.3 Scope	7	3.2.8 Incident reporting	18
1.3.1 Encouraging compliance	7	3.2.9 First aid	19
1.4 Commencement	7	3.2.10 Emergency response	19
1.5 Interpretation	7	3.2.11 Record keeping	19
1.5.1 Recommended practices	7		
1.5.2 Legal requirements	7		
1.6 Definitions	7		
2. Planning and preparation	12	4. Accurate installation and information	21
2.1 Understanding responsibilities	12	4.1 Introduction	21
2.1.1 Clients	12	4.2 Ensuring accuracy of plans and records	21
2.1.2 Controllers of work premises, plant or substances	12	4.3 Underground asset owners include:	21
2.1.3 Principal contractors	13	4.4 Electricity cables	22
2.1.4 Contractors	13	4.4.1 Cable records	22
2.1.5 Employees	13	4.4.2 Cable installation	22
2.1.6 Self-employed persons	13	4.4.3 Cable ancillary equipment	22
2.2 Coordination of responsibilities	14	4.5 Gas pipes	22
3. Consultation and risk management	15	4.5.1 Gas reticulation systems	22
3.1 Consultation at the workplace	15	4.5.2 Pipe records	22
3.1.1 Consultation arrangements	15	4.5.3 Pipe installation	22
3.1.2 Consultation procedures	15	4.6 Water and sewer pipes	23
3.1.3 When should consultation be undertaken?	15	4.6.1 Pipeline types	23
3.1.4 How should consultation be undertaken?	16	4.6.2 Depth and location	23
3.2 Risk management at the workplace	16	4.7 Telecommunication cables	24
3.2.1 Identify hazards	16	4.8 Abandoned and retired underground assets left in-situ	24
3.2.2 Assess risks	16	4.9 Table A: The installation of various types of underground assets	25

5. Hazard identification	29	6.15 Asset separation distances	39
5.1 Safety information	29	7. Safe systems of work	40
5.1.1 Some of the dangers when working near underground assets	29	7.1 Excavation using non-powered hand tools	40
5.1.2 Safety considerations for Low, High or Extra High Voltage electrical cables	30	7.1.1 Work on top of or below an underground asset	40
5.1.3 Electrical earthing of metallic pipes	30	7.1.2 Work beside an underground asset	41
5.2 Table B: Types of Assets and Limits of Underground Approach	31	7.2 Accidental contact with underground assets	41
5.3 On-site checking	34	7.2.1 Electrical assets	41
5.4 Plan or drawing reading	34	7.2.2 Gas assets	41
6. Managing the risks	35	7.2.3 Sewerage assets	42
6.1 Managing risks in the workplace	35	7.2.4 Water assets	42
6.1.1 Monitor and review risk assessments and control measures	35	7.2.5 Telecommunications assets	42
6.1.2 Safe work method statements (SWMS)	35	7.3 Cooperation with authorities	42
6.1.3 Consultation with relevant parties prior to commencing work	35	7.3.1 Obligations of asset owners and contractors	42
6.1.4 Planning and liaising with other authorities	36	7.4 Documented systems of work	42
6.2 Railway assets	37	7.5 Training of managers and employees	43
6.3 Service tunnels	37	7.6 Asset owner plans and 'Dial Before You Dig'	43
6.4 Excavation and trenching	37	7.7 Cable/Pipe identification devices	43
6.5 Assets near bridge approaches	37	7.8 Ground penetrating radar (GPR)	43
6.6 Assets around poles	37	7.9 Pot-holing	44
6.7 Traffic controls	38	7.10 Air and water lancing	44
6.8 Emergency work	38	7.11 Trenchless techniques	44
6.9 Vertical boring	38	7.12 Safety observers	44
6.10 Directional boring	38	7.13 Confined spaces	44
6.11 Mechanical excavating plant	38	7.14 Global positioning system (GPS)	45
6.12 Explosives	39	7.15 Above ground identification devices	45
6.13 Pile driving	39	8. Training, instruction and information	46
6.14 Identification of assets not on plans	39	8.1 Training requirements	46
		8.2 Induction training	46
		8.3 Training topics	46
		8.4 Who should receive training?	46

8.5	Provision of information and instruction	47
9.	Case studies and check lists	48
9.1	Repairing sewerage pipes	48
9.2	Country telecommunications cable damage case study	49
	Site observations	49
9.3	City telecommunications cable damage case study	50
9.4	Example of an Incident Report Used by an Electricity Asset Owner	52
9.5	Case Study: Construction of the M7 Motorway	53
10.	Further information	54
10.1	Australian Standards	54
10.2	SafeWork NSW Codes of Practice	54
10.3	Other Standards and References	54
10.4	Legislation	55
11.	Appendix A – Underground asset location checklist	56
12.	Appendix B – Workers compensation insurance	58
13.	Appendix C – Typical footway allocations for utility services and depth of cover in road reserves	59
13.1	Nominal depth of cover of utility services in road reserves	59
13.1.1	In footways	59
13.1.2	In carriageways	60
13.2	Utility/service provider allocation of space in footways	61
13.2.1	Streets dedicated prior to 1 January 1991	61
13.2.2	Streets dedicated after 1 January 1991	62

PREFACE

This Guideline is for employers, employees, contractors, subcontractors and other parties involved in construction work near underground assets. Note: This Guideline is not designed to impact on mining legislation.

The aim of this Guideline is to assist employers in deciding appropriate measures to eliminate or control risks to workers and other people on construction sites. It provides practical advice on implementing the requirements of the *Occupational Health and Safety Act 2000* (OHS Act) and the *Occupational Health and Safety Regulation 2001* (OHS Regulation).

At times, construction work may be carried out near underground assets on greenfield construction sites as well as on or near public roads and pedestrians. Where construction and maintenance work is carried out on or near public roads, work should be carried out in

accordance with the AS 1742 set of Standards – *Manual of uniform traffic control devices*. These Standards are supported by a set of field guides (HB 81) *Field guide for traffic control at works on roads*.

Use this Guideline to assess the effectiveness of your present arrangements for dealing with safety issues associated with working near underground assets, and to check that sources of risk have been identified and dealt with. If you are setting up a new business, this Guideline can serve as your step-by-step guide to establishing a program to manage the hazards arising from work near underground assets.

Work on, near or adjacent to gas and electricity services are deemed to be high risk construction work. Also water and sewerage assets may be deemed to be high risk construction work.

WHAT DO THE SYMBOLS IN THE GUIDELINE MEAN?

To help you work out what you require, a number of symbols are used to highlight things you need to take into account and tools to help you undertake the activity.



Assess the risks in your workplace



Processes of finding things that cause harm, work out how serious the problems are and then to fix them



Legal obligations that must be followed



Questions you (or others) might ask to clarify issues



The process of finding things that cause harm, working out how big a problem they are and fixing them

1. ESTABLISHMENT

1.1 TITLE

This is the Work Near Underground Assets Guideline.

1.2 PURPOSE

This Guideline provides practical guidance to prevent injury to people and damage to underground assets.

1.3 SCOPE

This Guideline informs asset owners, contractors, employers, workers and industry as to their obligations to:

- accurately install and record the location of the asset
- operate and maintain utility assets
- foster co-operation between underground utility owners and industry so as to eliminate or control the risk to individuals and the community, as well as damage to underground assets
- manage the risks involving underground assets at a workplace
- provide safe systems of work for individuals dealing with works near underground assets
- encourage the use of agreed practices for such work
- carry out JSA/Risk assessment and develop safe work method statements prior to commencing high risk construction work.

Note: This Guideline relates to underground utility assets on public land, within easements and on private property. While the principles may be similar, this Guideline does not specifically relate to underground assets on private property.

1.3.1 Encouraging compliance

All worksite controllers within NSW have a duty of care to persons within their worksite or those who may be affected by actions or omissions arising from their work activities.

The adoption of this Guideline when dealing with underground assets should help ensure that this duty of care is met.

All persons working near underground assets are encouraged to adopt this Guideline.

All asset owners must promote and encourage the adoption of this Guideline, not only within their own workplaces but to sub-contractors and all persons performing work near underground assets.

1.4 COMMENCEMENT

This Guideline takes effect on 05/07.

1.5 INTERPRETATION

1.5.1 Recommended practices

Words such as 'should' indicate recommended courses of action. 'Consider' indicates a possible course of action that the Guideline is indicating the duty holder should think about. However, you may choose an alternative method of achieving a safe system of work.

1.5.2 Legal requirements

Words such as 'must', 'requires' or 'mandatory' indicate that legal requirements exist which must be complied with.

1.6 DEFINITIONS

access authority a written authorisation, issued by an asset owner, which allows persons to work within a specified proximity of the asset.

accredited person a person who has successfully completed a recognised training course relating to the specific job, the training having been conducted by a registered or accredited training organisation.

approach distance the minimum separation in air from an exposed conductor that shall be maintained by a person, or any object held by or in contact with that person.

approved having appropriate endorsement in writing for a specific activity.

asset owner the owner, controller or operator of an underground asset. For the purpose of this Guideline an underground asset includes electrical, water, sewage and drainage, gas, telecommunications, petrochemicals and hazardous substances.

authorised person a person with technical knowledge or sufficient experience who has been approved, or has the delegated authority to act on behalf of the organisation, to perform the duty concerned.

cable an insulated conductor or two or more such conductors laid together, whether with or without fillings, reinforcements or protective coverings.

competent person a person who has acquired through training, qualification or experience, or a combination of them, the knowledge and skills to carry out the task.

confined space confined space as defined in Australian Standard AS 2865 *Safe working in a confined space*.

construction work means any of the following:

- excavation, including the excavation or filling of trenches, ditches, shafts, wells, tunnels and pier holes, and the use of caissons and cofferdams
- building, construction (including the manufacturing of prefabricated elements of a building at the place of work concerned), alteration, renovation, repair, maintenance and demolition of all types of buildings
- civil engineering, including the construction, structural alteration, repair, maintenance and demolition of – for example, airports, docks, harbours, inland waterways, dams, rivers, avalanche and sea defence works, roads and highways, railways, bridges and tunnels, viaducts – and works related to the provision of services such as communications, drainage, sewerage, water and energy supplies.

consumer services the supply to individual houses or premises, as opposed to “mains” which form part of the utility’s distribution system.

- **water** the cold water supply pipework from the water main up to and including the outlet valves at fixtures and appliances. The water service is owned by the consumer.

- **electricity** consumer services means the conductors from the supply authorities’ distribution mains (overhead or underground) to the customers’ premises.

- **gas** the pipe used to supply gas to the property, which runs from the distribution main to the meter position.

the Network Operator, also known as the Asset Owner, owns the section of the pipe between the distribution main and the property. The property owner owns the section of pipe between the property line and the meter.

- **telecommunications** the conduit and cabling controlled by the Carrier from the Network Point of Presence to the Network Boundary Point (NBP). Cabling beyond the NBP is customer owned cabling.

contaminated ground a contaminated site that poses a significant risk of harm to human health or the environment and is regulated by the EPA (NSW) under *Contaminated Land Management Act 1997*. Refer to <http://www.epa.nsw.gov.au/clm/searchregister.aspx>

control measures measures taken to minimise a risk to the lowest level reasonably practicable.

crane an appliance intended for raising or lowering a load and moving it horizontally. Includes the supporting structure of the crane and its foundations, but does not include industrial lift trucks, earth moving machinery, amusement devices, tractors, industrial robots, conveyors, building maintenance equipment, suspended scaffolds or lifts.

earthed direct electrical connection to the general mass of earth so as to ensure and maintain the effective dissipation of electrical energy.

earth moving machinery an operator controlled item of plant used to excavate, load or transport, compact or spread earth, overburden, rubble, spoil, aggregate or similar

material, but does not include a tractor or industrial lift truck.

electrical apparatus any electrical equipment, including overhead power lines and underground cables, the conductors of which are live or can be made live.

electricity network transmission and distribution systems consisting of electrical apparatus which are used to convey or control the conveyance of electricity between generators' points of connection and customers' points of connection.

emergency work work to rectify or prevent imminent danger to human life or physical injury.

work to rectify or prevent imminent or continuing damage to, or destruction of, property or the environment.

work to rectify or prevent an unscheduled outage which has or is likely to have a significant impact on the Distribution Network or the Carrier's network.

employee an individual who works under a contract of employment or apprenticeship.

employer a person who employs persons under contracts of employment or apprenticeship.

energised connected to any source of energy.

excavating the movement or placement of soil or other surface materials by removing, boring or forcing objects into the ground or surface of the earth.

exposed conductor an electrical conductor, approach to which is not prevented by a barrier of rigid material or by insulation that is adequate under a relevant Australian Standard specification for the voltage concerned.

extra high voltage (EHV) in NSW, means a transmission system cable with a nominal voltage of 132,000V a.c. (132kV) or above.

hazard anything (including work practices and procedures) that has the potential to harm the health and safety of a person.

high pressure gas (HP) 210kPa – 1050kPa.

Note: Transmission Pressure gas is equal to or greater than 1050kPa.

high-risk construction work means any of the following construction work:

- involving structural alterations that require temporary support
- at a height above 3 metres
- involving excavation to a depth greater than 1.5 metres
- demolition work for which a licence is not required
- in tunnels
- involving the use of explosives
- near traffic or mobile plant
- in or around gas or electrical installations
- over or adjacent to water where there is a risk of drowning.

high voltage (HV) a nominal voltage exceeding 1000V a.c. or exceeding 1500V d.c.

insulated separated from adjoining conducting material by a non-conducting substance which provides resistance to the passage of current, or to disruptive discharges through or over the surface of the substance at the operating voltage, and to mitigate the danger of shock or injurious leakage of current.

instructed person a person adequately advised or supervised by an Authorised Person to enable them to avoid the dangers which electricity may create.

isolated disconnected from all possible sources of energy by means that prevent unintentional energisation of the apparatus.

lancing using water or air aided by vacuum extraction to achieve non-destructive excavation.

live energised.

low pressure gas (LP) pressure less than or equal to 7kPa.

low voltage (LV) a nominal voltage exceeding 50V a.c. or 120V d.c. but not exceeding 1000V a.c. or 1500V d.c.

mains part of the utility's distribution system as opposed to "services" which are the take-offs for individual properties.

- **water/sewerage** a conduit or pipeline controlled and maintained by a network utility operator or water authority.

- **electricity** aerial or underground wires or cables from 400/230V to 330kV a.c
- **gas** a pipe installed in a street to convey gas to individual services.
- **telecommunications** any facility owned by the carrier – typical underground plant consists of conduits, cables, pits and manholes linking exchanges, or exchanges to distribution points.

medium pressure gas (MP) pressures greater than 7kPa and up to 210kPa.

mobile plant includes plant that:

- moves either under its own power or is pulled or pushed by other mobile plant
- moves on or around the worksite, enters or leaves the site, or moves past the site
- includes road vehicles operating at a worksite.

Note: This definition has been adopted for the purposes of this Guideline. This includes items such as earthmoving machinery, concrete boom pumps and tipper trucks operating at a worksite.

network operator also known as the asset owner.

nominal voltage (U) the a.c. or d.c. voltage by which a system of supply is designated.

OHS act the Occupational Health and Safety Act 2000.

OHS regulation the Occupational Health and Safety Regulation 2001.

overhead power line any bare or covered aerial conductors and other associated electrical parts that make up an aerial line for the distribution and transmission of electrical energy.

other cable systems telecommunications cables, optic fibre cables, control cables, earth cables or electrolysis drainage cables.

personal protective equipment (PPE) items that workers can use to protect themselves against hazards. PPE includes insulating gloves, mats or sheeting, glasses and face protection.

Note: A number of items of PPE are made and tested to Australian Standards.

PPE that is not designated as meeting a recognised Standard may be unreliable in service, as its performance is unknown.

place of work premises where people work.

plant any machinery, equipment or appliance.

Note: For the purposes of this Guideline the definition includes a broad range of machinery and equipment, but not limited to, cranes, mobile plant, scaffolding, load shifting equipment, industrial lift trucks, earth moving machinery, amusement devices, tractors, rural machinery, vehicles, conveyors, building maintenance equipment, suspended scaffolds or lifts, implements or tools and any component or fitting of those things.

polymeric made from polymers otherwise known as plastics.

pot-holing excavating with hand tools to a pre-determined depth to establish if assets exist in the immediate location.

premises includes any place, and particularly includes:

- any land, building or part of a building
- any vehicle, vessel or aircraft
- any installation on land, on the bed of any waters or floating on any waters
- any tent or movable structure.

permit conditions permission conditions stipulated by asset owner.

pressurised a constrained flow of a substance in a pipeline which may be of varying diameters and thicknesses, the flow of which may or may not be directly controlled by an asset owner.

procedure the documentation of a systematic series of actions (or activities) directed to achieve a desired result.

property line the boundary line between the road reserve and the adjacent property.

railway assets electrical, signalling and communications infrastructure owned and maintained by the rail entity. Assets also included but are not limited to, drainage lines and compressed air line.

safety observer a competent person who has been specifically assigned the duty

of observing and warning against unsafe approach to the asset.

supervisor a representative of the principal for a worksite, who has the delegated responsibility for a task or range of tasks being undertaken at the worksite.

underground assets part of an underground network such as water/drainage/sewerage, electricity, gas or communications etc.

underground services the supply to individual houses or premises as opposed to underground assets which form part of the utility's distribution system.

works planned or programmed any work which has followed the normal planning process prior to work commencing ie where the worksite has been physically inspected and assessed in advance of the work crew arriving on site.

2. PLANNING AND PREPARATION



The OHS Act and the OHS Regulation require employers to address workplace health and safety through a process of risk management and consultation.

Under the OHS Act and the OHS Regulation, employers have an obligation to ensure the health, safety and welfare of employees at work and that other people are not exposed to risks to their health and safety. When contracting out work, employers must ensure that contractors are planning and carrying out work in a safe manner. The work should be conducted according to this Guideline.

To effectively implement this Guideline, employers need to be aware of these requirements and have procedures in place to apply them. Employees, self-employed persons, subcontractors and controllers of premises, plant and substances also have responsibilities under OHS legislation. Each individual should ensure that they work safely and that their work does not expose others to health and safety risks.

The way to systematically plan and manage health and safety in the workplace is to build risk management and consultation into all those activities that may have OHS implications. This will involve activities such as purchasing, work methods or procedures, using contractors, reporting OHS problems, investigating incidents and planning emergency procedures.

2.1 UNDERSTANDING RESPONSIBILITIES

2.1.1 Clients

The client's responsibilities under the OHS Act and OHS Regulation will depend on their role in the design and construction. They are usually a "controller of premises" at least to some extent and may also have other roles such as designer, principal contractor or an employer in relation to the project.

The client is also in the best position to influence others to consider that constructability and maintainability are included in the design and

thus to reduce construction and ongoing maintenance risks at the design stage. Setting realistic timeframes for tendering, planning and project execution can also assist planning and execution of construction work.

However, the client is not always aware of all the complexities, such as the range of construction techniques, ground conditions and their effect on safety. It is therefore often appropriate for consultation between the client and other parties at an early stage to take advantage of the opportunity to identify the best concept design.

2.1.2 Controllers of work premises, plant or substances



Controllers of work premises, plant or substances also have health and safety legal responsibilities.

They must make sure that the premises used as a place of work are safe and without risks to health and that the plant and substances used in the work process are safe and without risks to health when properly used. For persons who have only limited control of the premises, plant or substances, their responsibilities apply only to the matters over which they have control.

Designers should ensure that:

- to the extent that they have control over the design work, the structure (or plant) can be safely constructed, used, repaired, cleaned, maintained, and demolished, such that the health and safety of any person is not put at risk by the design
- information is provided to the client about the health and safety aspects of the design.

Designers should also ensure that, as far as practicable, hazards associated with the following are identified before commencement of the construction work:

- the design of the structure (whether permanent or temporary)
- systems of work required to construct, repair and maintain the structure
- the intended use of the structure

- materials required to be used in the construction of the structure
- the demolition (or abandonment) of the structure.

Note: In relation to the design of plant, the OHS Regulation contains more detailed risk control requirements on designers, manufacturers and suppliers.

Where there is more than one designer, critical aspects of the project should be documented and liaison should occur between the principal contractor and relevant designers so that the work can be coordinated to ensure the safe interaction of the different design aspects. When risks remain in the design work, information should be included with the design to alert others to the risks.

2.1.3 Principal contractors



The principal contractor, whether as an employer or as the person in control of the workplace, must provide and maintain in relation to those matters over which he or she has control, a workplace that is safe and without risks to health for their employees and other persons present at the workplace or affected by the work. To fulfil these obligations the principal contractor must plan for the work to be done safely.

The principal contractor must ensure that a site specific OHS management plan is prepared and documented for each place of work where construction work is to be carried out, before the work commences. This plan must be developed in consultation with the contractor/s and their employees or representatives. The plan must include safe work method statements (SWMS), provided by the contractors where they are used, for all work activities assessed as having risks. It must also include the following details:

- arrangements for OHS induction training
- arrangements for managing OHS incidents including response persons
- site safety rules and arrangements for informing persons affected
- details where persons have specific site OHS responsibilities.

The health and safety management plan must be monitored to ensure that work is carried out

safely, according to that plan and that the plan is effective. The plan must be maintained and up to date during the course of the construction work and must be made available for inspection. The principal contractor must stop work immediately, or as soon as it is safe to do so, where there is a risk to the health or safety of a person.

2.1.4 Contractors



The contractor(s) doing the work, whether the principal contractor themselves or sub-contractors, must provide and maintain a workplace that is safe and without risks to health for their employees in relation to those matters over which they have control.

In addition to consultation with the principal contractor in the overall job planning, the contractor must develop written SWMS including an assessment of the risks and the controls used to carry out the work safely.

2.1.5 Employees



Employees must take reasonable care of the health and safety of themselves and others. Employees must cooperate with employers in their efforts to comply with OHS requirements. This means that employees must notify their employer of safety and security hazards, risks and incidents in line with the requirements of the OHS Act. These requirements should be outlined by the employer's OHS policy, procedures and safety related instructions.

Employees must not be required to pay for anything done or provided to meet specific requirements made under the OHS Act or OHS Regulation.

2.1.6 Self-employed persons



Self-employed persons must ensure that their undertakings do not expose others to health or safety risks.

2.2 COORDINATION OF RESPONSIBILITIES

There may be a number of parties involved in a project, such as:

- the client
- the principal contractor
- controllers of premises, plant or substances
- designers
- employers (contractor or subcontractors) who employ persons at the site, including labour hire agencies providing persons to the site
- self-employed persons
- suppliers of plant, materials or prefabricated components.



Where more than one party has responsibilities at a specific workplace, each party retains their legal responsibilities and must discharge their responsibilities in a coordinated manner.

3. CONSULTATION AND RISK MANAGEMENT



The OHS Act and the OHS Regulation require employers to address workplace health and safety through a process of risk management and consultation.

To effectively implement this Guideline, employers need to be aware of these requirements and have procedures in place to apply them.

Employers are advised to consult the OHS Act and the OHS Regulation as well as the *Code of Practice: Occupational Health and Safety Consultation* and the *Code of Practice: Risk Assessment* for details of these requirements and how they can be met. The following information is designed to provide an overview of legislative requirements.

3.1 CONSULTATION AT THE WORKPLACE



Employers must consult with employees when taking steps to assess and control workplace risks.

In order to consult with employees, employers are required to set up consultation arrangements and develop consultation procedures.

3.1.1 Consultation arrangements

The OHS Act provides three options for consultation arrangements:

Arrangement	Workplace	Requirement
OHS Committee	20 or more employees	requested by a majority of employees or direction by SafeWork NSW
OHS Representative	any size	at least one employee requests an election or directed by SafeWork NSW

Arrangement	Workplace	Requirement
Other agreed arrangements	any size	agreed to by both the employer and employees (in a small workplace it may be a regular safety meeting with employees)

Before using this Guideline, an employer should ensure that consultation arrangements are in place. An employer may initiate the establishment of an OHS Committee or the election of an OHS Representative if the employees have not made such a request. When the consultation arrangements have been decided, clause 27 of the OHS Regulation requires employers to record them and advise all existing and new employees.

3.1.2 Consultation procedures

After setting up the consultation arrangements employers need to consider when and how these consultation arrangements need to be applied.

3.1.3 When should consultation be undertaken?

Under section 13 of the OHS Act, employers have the general duty to consult employees when decisions are being considered that may affect their employees' health and safety. Therefore, employers are required to consult with their OHS Committee, OHS Representative or other agreed arrangement when such decisions are being considered. Decisions which could affect health and safety include:

- planning for new premises or modifying existing premises
- purchasing new plant, equipment or substances
- planning, designing or changing work tasks or jobs
- using contractors in the workplace
- investigating incidents or accidents

- developing emergency procedures
- determining or reviewing workplace amenities
- determining or reviewing consultation arrangements.

Note: Any procedures that are developed to encompass these activities should incorporate consultation.

It may not be practical or reasonable to involve the OHS Committee or the OHS Representative in every purchase decision or task change. However, the employers and committee or representative should agree on what process is needed to ensure that affected employees are consulted.

3.1.4 How should consultation be undertaken?

When engaged in consultation, the OHS Act requires employers to:

- **share all relevant information with employees.** For example, if an employer is going to change a work task, employees need to be told of any risk to health and safety that may arise and what will be done to eliminate or control these risks.
- **give employees reasonable time to express their views.** Employees need adequate time to assess the information given to them, obtain relevant safety information and consult with fellow employees to enable them to form their views.
- **value the views of employees and take them into account when the decision is made to resolve the matter.** In many cases, agreement will be reached on how the safety issues are to be addressed. When agreement cannot be reached, the employer should explain how the employees' concerns have been addressed.

3.2 RISK MANAGEMENT AT THE WORKPLACE



Employers and self-employed persons must identify any foreseeable hazards, assess their risks and take action to eliminate or control them.

When addressing health and safety issues, besides consulting employees, employers must adopt the process of risk management. This process requires employers to:

3.2.1 Identify hazards

To ensure a safe and healthy workplace, employers must identify all the foreseeable health and safety hazards, which could harm their employees or other persons in the workplace. Hazards may arise from the work process, the equipment and materials in use, the work environment, or other people involved.

3.2.2 Assess risks

Once hazards have been identified the risk they pose to health and safety needs to be assessed. Some hazards pose a greater risk than others do, and the frequency and duration of exposure can also affect the risk. Risk assessment involves considering the likelihood and severity of injury or illness being caused by exposure to the risk. Therefore the factors that need to be considered in a risk assessment should include the:

- harm that can be caused by exposure to the hazard
- number of people and the duration and frequency of exposure to the hazard
- capability, skill and experience of people exposed to the hazard.

The risk assessment process provides information on the factors which contribute to the risk. This information will assist in determining what needs to be done to eliminate or control the hazard.

3.2.3 Eliminate or control the risk

The first responsibility is to investigate how the risk can be eliminated. Before implementing the control measures described in this Guideline, an employer should investigate possible strategies for eliminating the hazard from the work system.

If it is not reasonably practicable to do so, the risks associated with the hazard must then be controlled. This Guideline has been developed to provide advice on the most effective control measures.

3.2.4 Review risk assessment and control measures

Control measures should be reviewed on a regular basis. The frequency of their review should be determined by considering the significance of the risks associated with the hazard. However, a review should be undertaken in the following circumstances:

- new information is made available about the risks associated with the hazard
- an accident or incident occurs
- significant changes are proposed to the workplace or work system.

3.2.5 When must employers undertake risk management?

The OHS Regulation requires employers to incorporate the process of risk management into procedures.

These are the same activities for which employers are required to consult with employees.

3.2.6 Strategies for developing effective risk management procedures

When risk management activities are undertaken the following strategies should be considered to inform the process:

- visual checks through workplace inspections
- analysing the types of work being performed and the way work is performed
- inspections of plant and equipment
- analysing workplace records on accidents, incidents or 'near misses'
- risk management information provided by suppliers or manufacturers of equipment or, in the case of hazardous substances, Material Safety Data Sheets (MSDS)
- industry codes of practice for particular hazards or work processes
- Australian Standards, which set safety standards for a range of equipment products and materials
- guidance material from SafeWork NSW or industry or professional organisations.

Further advice is provided in the *Code of Practice: Risk Assessment*.

3.2.7 Personal protective equipment (PPE)

The use of PPE to control risks is lowest on the hierarchy of control measures. The measures at the lower levels are less effective and they require more frequent reviews of the hazards and systems of work. They should only be used when other control measures are impracticable or when, after implementing other controls, a residual risk remains.

- **PPE selection and suitability**

Where PPE is to be used it should be appropriate for the risk and comply with the relevant Australian Standard or SafeWork NSW approval. Employees should be competent in the proper selection, use and maintenance of the PPE. There should be sufficient supervision and monitoring conducted to ensure PPE is used and employees are competent in its use. PPE should be regularly inspected, maintained and replaced as necessary.

- **Eye protection**

Dust, flying objects and sunlight are the most common sources of eye damage in excavation work.

Where persons are carrying out cutting, grinding or chipping of concrete or metal, or welding they must be provided with eye protection complying with AS/NZS 1337:1992 – *Eye protectors for industrial applications*. Eye protection complying with AS/NZS 1337 should also be provided where persons carry out other work, such as carpentry or handling of chemicals, where there is a risk of eye injury. Selection, use and management systems should comply with AS/NZS 1336:1997 – *Recommended practices for occupational eye protection*.

- **Hearing protection**

Where personal hearing protection is provided it should conform with AS 1270:1988 – *Acoustics – Hearing protectors*. Control measures including training should comply with AS/NZS 1269.3:1998 – *Occupational noise management – Hearing protector program*.

- **High visibility garments/safety reflective vests**

Persons working underground or near traffic, mobile plant or equipment under operator control, should be provided with and use high visibility garments. Such garments should be selected, used and maintained in accordance with AS/NZS 4602:1999 – *High Visibility Safety Garments*. Other clothing not covered by the high visibility garment should be light coloured and all garments should be selected for best contrast with the surrounding background.

- **Safety helmets**

The use of safety helmets may prevent or lessen a head injury from falling objects or a person hitting their head against something. Where there is a likelihood of persons being injured by falling objects and overhead protection is not provided, persons must be provided with and must use an appropriate safety helmet. Appropriate safety helmets should also be provided and used where a person may strike their head against a fixed or protruding object or where there is a risk of accidental head contact with electrical hazards.

All persons on excavation sites should wear head protection that conforms to AS/NZS 1801:1997 – *Occupational protective helmets* and be used in accordance with AS/NZS 1800:1998 – *Occupational protective helmets – Selection, care and use*.

- **Safety gloves**

Where there is a risk of hand injury, such as exposure to a harmful substance, excessive heat or cold, or to a mechanical device, hand protection appropriate to the risk and that complies with AS/NZS 2161:1998 – *Occupational protective gloves* should be provided and used.

- **Waterproof clothing**

Waterproof clothing provided as a system of work relating to weather or site conditions should be effective and suitable for the task. Waterproof clothing should also incorporate light reflective features in accordance with the requirements of the section above.

3.2.8 Incident reporting

Hazards and OHS problems should be reported as soon as they are noticed so that the risks can be assessed and addressed as quickly as possible. Records of reported hazards should be kept and should include details of the action taken to remove the hazard or control the risk arising from the hazard.

The OHS Regulation also prescribes a number of workers compensation and OHS legal requirements concerning incident and injury reporting.

3.2.9 First aid



The OHS Regulation requires that employers must provide first aid facilities that are adequate for the immediate treatment of injuries and illnesses that may arise at the place of work and, if more than 25 people are employed, trained first aid personnel.

To ensure adequate first aid provisions, employers must identify their potential problems, assess their requirements and consult with employees in the process.



When determining the nature, number and location of first aid facilities and the number of trained first aid personnel, employers must take into account the location and type of work being undertaken. The type of work performed will influence the hazards and the possible harmful consequences for employees. For example, office workers will have different first aid requirements from construction workers. Workplaces using hazardous substances may require specialised first aid facilities, such as eyewash stations and emergency showers. The risk assessment process will assist in identifying the particular needs of the workplace.

Further information regarding such matters as contents of first aid kits, who qualifies as 'trained first aid personnel', and other requirements relating to first aid rooms, consult the OHS Regulation or the *First Aid in the Workplace Guide*.

3.2.10 Emergency response



The OHS Regulation specifies that an employer must ensure that, in the event of an emergency at the workplace, arrangements have been made for:

- the safe and rapid evacuation of persons from the place of work
- emergency communications
- appropriate medical treatment of injured persons
- appointment of appropriately trained persons to oversee any such evacuation and, if appropriate, the use of on-site fire fighting equipment.

3.2.11 Record keeping



The OHS Regulation requires records to be kept in the following areas:

- induction training
- hazardous substances
- confined spaces
- plant
- electricity
- asbestos
- atmospheric monitoring
- notification of accidents.

Refer to the relevant chapters of the OHS Regulation for further information.

DON'T RISK IT



- Dial Before You Dig is a free referral service for receiving information on underground pipes and cables before you start work.
- All major utilities are members including Energy Australia, Integral Energy, Telstra, Optus, Alinta and Sydney Water.
- Digging without maps means exposing yourself and your contractors to danger.
- Unexpected cable strikes can slow your job down.
- Damage to underground utilities can affect your insurance.

Visit www.dialbeforeyoudig.com.au any time

Dial **1100 between **8am and 5pm** on working days**

Fax **1300 652 077 anytime**

THIS IS A FREE SERVICE

4. ACCURATE INSTALLATION AND INFORMATION

4.1 INTRODUCTION

Asset owners are required to capture and maintain accurate and up-to-date (as built) records of their underground assets.

When planning a job requiring excavation, a complete record search must be undertaken by lodging an enquiry with the central call service 'Dial Before You Dig'. Asset owners who are not members of this service must also be contacted. When an asset location is requested, asset owners may provide information on the recommended practices for work near that location or asset.

Lodging an enquiry with 'Dial Before You Dig' is as simple as visiting www.dialbeforeyoudig.com.au, phoning 1100 or faxing an enquiry to 1300 652 077. Once the records are obtained, they should remain in the work area and be accessible to all. When carrying out emergency work, every effort should be made to obtain records as soon as possible. If work must commence prior to the records being obtained, it should be carried out on the basis that underground assets are present even if an Electronic Service Detector gives the 'all clear'.

It should be also remembered that as technologies and work practices change over time, features such as the presence of warning tape may not be where you expect (see Table A). For example, the majority of telecommunication assets at joint locations are now housed in pits or manholes. However, the line between these may not be straight if obstructions were encountered during installation. Direct buried cable in rural areas may be identified by pits/manholes and marker posts. However, it cannot be assumed that a cable follows a direct path between these items.

WARNING: Asset owners' plans may not show the presence of all cables, pipes and plant. They may only show their position relative to road boundaries, property fences etc at the time of installation and the asset owners do not guarantee that such plans are accurate thereafter due to changes that may occur over time.

Do not assume depth or alignment of cables as these vary significantly. For example, road and building alignments and levels may change.

4.2 ENSURING ACCURACY OF PLANS AND RECORDS

Asset owners shall have a system of work which ensures the accuracy of plans. The system of work should be included in the asset owners' audit processes.

Improving the accuracy of existing asset plans relies on cooperation between asset owners and contractors. If during work activities, underground assets are found to be not on the plans or are in a different location, contact should be made with the source of the plans to notify of the missing information.

4.3 UNDERGROUND ASSET OWNERS INCLUDE:

- electricity generation, transmission and distribution
- rail
- Roads and Traffic Authority
- local authorities
- telecommunications
- private (eg privately owned water pipelines)
- gas transmission and distribution
- petrochemical (oil, petrol, LPG etc)
- oil
- water
- drainage
- sewerage.

(See Table A).

4.4 ELECTRICITY CABLES

4.4.1 Cable records

Cable records are in the form of plans drawn to scale or on computer based Geographic Information Systems (GIS).

The detail of the records will vary with the type of installation. For cable installed in a standard allocation, the records may provide only general cross sectional arrangements of cable and conduits together with road crossing and street lighting information.

It is common practice to negotiate a special alignment on the roadway for high voltage transmission cables. For this type of installation, the records are more detailed with reduced level and offset information provided. The details of local area distribution and of transmission cables are typically shown on separate plans.

Older installations may not be accurately recorded or reference details may have changed.

4.4.2 Cable installation

The cover for underground electricity cables and underground control cables may vary in depth. Always assume a cable may be present. See Table B.

Note: Underground electrical cables are not necessarily covered with slabs, marker tapes or other indicators of their presence and are frequently not enclosed in conduits. Some underground electrical cables may have been encased in bitumen. Hence a full risk assessment must be undertaken prior to carrying out any excavation work so as to accurately establish the exact locations of underground electrical cables.

4.4.3 Cable ancillary equipment

Associated with many cable installations are ancillary assets and pits. These may include cable joint pits, cable link pits, oil or gas pits, inspection pits and other ancillary pits. These pits will have cables or pipes that connect them to the main cables and care should be exercised when excavating between the cables and the ancillary pits. The presence of ancillary pits shall be confirmed with the electricity asset owner prior to any work.

4.5 GAS PIPES

4.5.1 Gas reticulation systems

Several methods of gas reticulation are used, from low-pressure services through to transmission systems. These systems have been constructed from materials including coated welded steel, cast iron, and a variety of plastics. In most areas, the systems are buried directly in a suitable stone-free backfill. The systems are not designed to resist the impact of tools or mechanical plant or to be left unsupported over any great distance. The operating pressures range from as low as 2kPa up to as high as 15MPa for a transmission pipeline system.

4.5.2 Pipe records

The records for all high and low pressure gas distribution mains are maintained in the form of plans drawn using Computer Aided Design system (CAD). The detail of the records will show the size of pipe and the type of material, changes in direction. Please note gas consumer services are generally not shown on plans. High-pressure transmission pipelines are generally located within a pipeline easement, therefore records of these pipelines are in the form of alignment sheets specific to the individual pipeline.

The location of high and low-pressure distribution mains on the plans are shown at a nominal distance from the building line. The actual pipe alignment will be shown in text as an offset distance in metres from the Building Line (MBL) – also could be known as the ‘property boundary’. When locating gas distribution pipes always reference the offset distance from the building line as minor changes in alignment will not be shown graphically.

4.5.3 Pipe installation

Most pipes laid in recent years may have a marking tape or polymeric plastic slab laid above the pipes for identification when excavating. However, these tapes or slabs may have been damaged by other excavations in the area since the initial construction and not replaced. For location purposes, plastic pipe may have been laid with a trace wire to enable the main to be located using a cable locator. Again, it is

important these tracer wires are not interfered with or broken, as it makes future location of these pipes very difficult. If you do break the trace wire, please ensure that the wire is rejoined and coated with electrical tape. Steel mains and pipelines will not have a trace wire as they are metallic and can be detected. Other structures, such as siphon points, valve pits, regulator pits and other varied components may be installed in the pipeline. Care needs to be taken to locate these before excavation.

While the plans may show the expected location of underground distribution mains, consumer services are not shown. Properties should be checked to ascertain whether gas meters are present. If so, the services normally run at right angles to the distribution main to the service connection at the meter. However, it cannot be assumed that a pipe follows a direct path between these items. Be aware the consumer service may receive its supply from a distribution main on the opposite side of the road. The installed depth of consumer services varies – refer to Table B. In circumstances where the correct depth of cover has not been achievable, mains and services may be encased in concrete or laid in copper pipe.

All high-pressure steel distribution mains and transmission pipelines have corrosion protection systems. These systems form part of the pipeline and incorporate the protective coating, test points and galvanic anodes at various points along its length. If these are broken or damaged, it should be reported to the gas utility immediately. They are easily rectified but can be extremely difficult to locate if the damage is not reported.

4.6 WATER AND SEWER PIPES

4.6.1 Pipeline types

Cast iron and steel pipes are often joined with lead. These and asbestos pipes are easily disturbed and brittle. Mild steel and ductile cast iron pipes have external protective coatings which, when damaged, significantly reduce the life of the pipes. Copper pipes are very soft and easily compressed or bent without necessarily breaking, but their flow capacity can be significantly reduced. Recycled water areas have dual pipe and service systems.

The water supply system in residential areas has traditionally formed part of the multiple earth neutral (MEN) system of the electricity distribution network. More recent use of PVC and polypropylene materials may adversely impact the MEN system. Refer to Section 5 for more information.

4.6.2 Depth and location

Water authorities, developers and local councils maintain records of pipeline locations.

As with other assets, there can be great variations in pipeline depths, depending on their age and the amount of surface reconstruction over the years. More recently, some water assets have been co-located with other assets in shared trenches. This raises the potential problem of simultaneous damage to several assets.

Some pipes may be encased in concrete to provide added support and protection.

4.7 TELECOMMUNICATION CABLES

Telecommunications cables developed for underground installations have changed in line with technology requirements.

Plans provided by Telstra are circuit diagrams only and indicate the presence of telecommunications plant in the general vicinity of the area shown. Due to the nature of the Telstra plant and the age of some cables and records, it is impossible to ascertain the location of all Telstra plant from plans. Telecommunications plant seldom follow straight lines and careful on site investigation is essential to uncover and reveal its exact position.

4.8 ABANDONED AND RETIRED UNDERGROUND ASSETS LEFT IN-SITU

In cases where assets are no longer to be utilised and are to be left in-situ, they are to be disconnected and/or filled, capped, plugged or otherwise rendered safe to avoid any future problems.

All such assets shall be consistent with the following points:

- treated as in-service unless otherwise positively proven out of service
- marked accordingly on the appropriate asset record
- if out of service retired or abandoned assets etc are to be interfered with, the owner of the asset should be contacted and arrangements made to locate the asset
- an asset shall not be used by others without prior agreement with the asset owner. This is so that both organisations' records can be updated
- where an asset is inserted inside an out of service, retired or abandoned conduit, pipe or duct, the records shall show this information
- if assets are sold or disposed of to another owner, then both organisations records should show such information.

4.9 TABLE A: THE INSTALLATION OF VARIOUS TYPES OF UNDERGROUND ASSETS

Assets have been installed underground over the last 150 years. Therefore you may come across a large range of pipe and cable materials, their installation technologies and protection barrier methods. The table below gives an overview of these different techniques. It is not a complete list and it should be remembered that you may come across underground assets that have no barrier protection or other indication of their presence, for example underbores.

Utility/Industry	Asset	Traditional Techniques	Current Techniques	New Technologies
Electrical cables (power, rail and tram)	Transmission: Extra High Voltage (EHV)	Buried direct, conduits (orange PVC), ductlines, concrete encased, fibro asbestos	Direct burial in trench, ducts	Trench-less technology including directional drilling
	Distribution: High Voltage (HV) and Low Voltage (LV)	cement, steel, earthenware or encased in bitumen	Marker tape – polymeric	Conduits installed by directional drilling.
	Supervisory and signalling cables	Protective covers	Protective covers – polymeric and concrete	Variations in alignment and depth may occur.
	Cathodic protection	bricks/tiles, terracotta, concrete, polymeric	Surface markers	Multiple conduits can be installed using this method
	Earthing rods and conductors	Marker tapes – polymeric	May be direct buried	
Gas pipelines	Conduits and ducts	Direct buried	Nil	
	Power poles and lattice towers	Orange PVC	Direct buried	
		Risk assess to ensure that 1) structure will not be undermined and 2) cable is not coiled around base of pole	Orange PVC	
	Transmission	Coal tar enamel (warning contains asbestos) coated steel pipe	Yellow polyethylene coated steel pipe	
		Blue polyethylene coated steel pipe	Red fusion bonded epoxy coated steel pipe	
			Construction techniques included trenching, cased boring, horizontal directional drilling	

Utility/Industry	Asset	Traditional Techniques	Current Techniques	New Technologies
Gas pipelines (continued)	Distribution High Pressure	Blue polyethylene coated steel pipe Yellow polyethylene coated steel pipe	Yellow polyethylene coated steel pipe Construction techniques included trenching, cased boring, horizontal directional drilling	High density polyethylene yellow stripe/black pipe
	Distribution Low Pressure	Tar coated wooden pipe Cast iron pipe Blue PVC pipe	Yellow nylon pipe Medium density yellow polyethylene pipe High density polyethylene black and yellow stripe pipe Insertion of disused cast iron pipe with nylon or polyethylene pipe Construction techniques included trenching, cased boring, horizontal directional drilling	
	Consumer services	Cast iron pipe Galvanised steel pipe	Yellow nylon pipe Medium density yellow polyethylene pipe High density polyethylene yellow stripe/black pipe Insertion of disused cast iron or galvanised pipe with nylon or polyethylene pipe Construction techniques included trenching, groutamat boring, horizontal directional drilling	
Water mains and services	Pipes 15 mm to 3000 mm, valves, hydrants, chambers	Cast iron, steel, cement coated steel, asbestos cement, copper, glass reinforced plastic ductile iron, polyethylene, PVC or concrete encased steel or ductile iron	Pipes usually installed by trenching Pipe cracking and slip lining renewal technique also used Some directional drilling Some thrust boring across roads Surface fittings for access and operation Chambers for valve access	Dual supply mains and services in recycled water areas

Utility/Industry	Asset	Traditional Techniques	Current Techniques	New Technologies
Water mains and services (continued)	Property connections	Service connections to properties are usually copper in smaller sizes and iron or steel in larger sizes (fire services and industrial)		Dual supply mains and services in recycled water areas
Sewerage mains and services (continued)	Pits pipes 15 mm to 1800 mm, tunnels, valves, connections	Cast iron, mild steel, cement lined steel, asbestos cement, copper, glass reinforced plastic, ductile cast iron or PVC, vitreous clay	Pipes installed by trenching Sewer re-lining or replacement using trenchless technologies (eg pipe cracking and slip lining)	On site treatment and reuse systems Jointless systems
Stormwater, grey water and drainage pipelines and services	Pits pipes 15 mm to 1800 mm, tunnels, shafts	Cast iron, mild steel, cement lined steel, asbestos cement, copper, ductile cast iron or PVC reinforced concrete	Installation generally by trenching	
Communications cables	Phone lines	Fibro asbestos cement (FAC) pipes and ducting. Galvanised iron (GI) pipe – various diameters Roca concrete pipes Earthenware pipe Tunnels – Sydney CBD and servicing some other major telephone exchanges White PVC pipe 10 mm to 100 mm internal diameter Black PVC Directly buried cables PVC or armored steel sheath Polyethylene	Because of the long operational life of conduits, cables providing new technology services are often hauled into existing conduits All new standard conduit installations are white PVC of internal diameter 20 mm – 100 mm. Galvanised iron (GI) conduits are used for special purpose applications Conduits installed by directional drilling. Variations in alignment and depth may occur. Multiple ducts can be installed using this method Conduits installed by directional drilling. Variations in alignment and depth may occur. Multiple conduits can be installed using this method Direct drilling technologies	
	Co-axial, data and signalling cables	As above	As above	

Utility/Industry	Asset	Traditional Techniques	Current Techniques	New Technologies
Water mains and services	Broadband, copper and fibre optic cables	As above	As above Directly buried fibre optic cables will generally have been installed with marker tape above the cable containing a metallic wire Fibre Optic cables in conduits are installed by directional drilling technologies. They do not have marking tapes installed above the cable. In this case there may be no metal marking tapes installed	
	Conduits and ducts	As above	As above	
Oil transmission pipelines and valves	High Pressure (above 1050 kPa) Regularly signposted	Coal tar enamel (warning contains asbestos) coated steel pipe AS 2885-1997. <i>Pipelines for Gas & Liquefied Petroleum</i>	Yellow polyethylene coated steel pipe	
Privately owned pipelines	Chemical	Mostly similar to oil and gas transmission pipelines above (SafeWork NSW Dangerous goods pipelines) Regularly signposted.		

Note: It is essential to treat a cable or pipe as high voltage or high pressure until it has been positively identified as being otherwise.

5. HAZARD IDENTIFICATION

5.1 SAFETY INFORMATION

Consideration must be given to the safety of individuals and the community, especially to provide adequate safety barriers and safe pedestrian access around the worksite. Additionally, PPE applicable to the particular operation must be used.

Excavation within the zone of influence may destabilise the underground asset or supporting structures resulting in damage to the asset.

5.1.1 Some of the dangers when working near underground assets

- **Gas**

Damage to gas assets can cause gas escapes which may lead to fires or explosions if an ignition source is present. There are two types of leaks following damage to the asset:

- damage which causes an immediate escape. In this case, there is a risk to those working at the site
- damage which causes an escape some time after the incident. This may be through damage which weakens the asset casing or the result of poor reinstatement practice. In this instance, the public is mainly at risk.

- **Electricity**

- an injury resulting from damage to live electricity cables is usually caused by electric shock or the explosive effects of arcing current and by the fire or flames which may follow when the sheath of a cable is penetrated by an object. Damage and injury may also occur if the cable is crushed or contact is made between the individual phases of a cable. The presence of gas or a mixture of gases in a trench could be ignited by an electrical charge or an electrical arc resulting in a fire or explosion, the severity of which depends on the gaseous mixture

- gas can be present in the ground due to gas pipe damage or leakage, sewage pits, chemical reactions or leaching and the accumulation of airborne gases in low lying areas. Gas can also be introduced by the nature of the work being undertaken such as oxy-acetylene cutting or chemical grouting
- consideration should be given to conducting a risk assessment to determine if a trench or the work constitutes a confined space.

- **Petroleum or oil pipelines**

- the result of damaging these assets is similar to that of gas assets. However, there is the additional risk of significant environmental issues such as contamination of waterways.

- **Water pipes and sewers**

- some pipelines transport water under high pressure. Some older water pipes are also made from asbestos cement. Damaged water pipes have great potential to affect other assets and structures, either directly or by washing away their supports ie thrust blocks
- the main danger from sewer damage is the contamination of a broken water main or asset, damage to the environment or disease from exposure to sewage. Some sewer lines are high pressure. Toxic and explosive gases may also be present in both sewer lines and stormwater drains
- persons working on metallic water pipes are at risk of electric shock due to an electrical fault near a customer's premises or a mains neutral fault in the street. Metallic water pipes are usually bonded to the electrical earthing system and are a path of low resistance. Stray electrical current will often flow through the bonded metallic water pipe. When the pipe is cut or disconnected, either side of the pipe could become live causing a person to receive a serious or fatal electric shock. The consumer is also at risk of an electric shock under the same circumstances.

- **Telecommunications**
 - consequences could be the isolation of whole communities, disruption of interstate and international telecommunications, inability to contact emergency services, loss of telephone, mobile phone, data and television services
 - cables containing optical fibres carry light signals generated by Class 3B lasers that can cause injury to the eye. This infra-red beam is invisible to the naked eye and exposure to it should be avoided. Small optic fibre particles are capable of entering the bloodstream causing injury or death.
- **Pipelines containing hazardous substances and dangerous goods**


5.1.2 Safety considerations for Low, High or Extra High Voltage electrical cables

- High voltage (HV): same as for low voltage except the approach distances are variable. For more information refer to Table B.
- Extra high voltage cables (EHV): all work in the vicinity of extra high voltage cables must be undertaken with the consent and under the supervision of the asset owner. Contact with extra high voltage electric current will result in serious burns and/or death. For more information refer to Table B.
- Notwithstanding any guidance on the use of blasting as a means of excavation, where blasting is to take place within 200 m of an underground asset, the asset owner should be contacted for any special requirements.

5.1.3 Electrical earthing of metallic pipes

Prior to the removal or the repair/replacement of metallic piping, workers must ensure that an effective electrical bond across the break is maintained at all times.

5.2 TABLE B: TYPES OF ASSETS AND LIMITS OF UNDERGROUND APPROACH

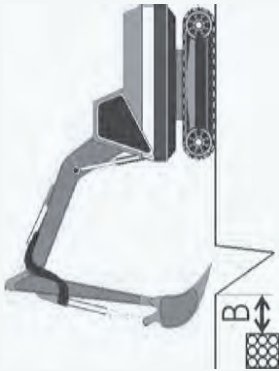Assets	Clearances	No Go Zone For Powered Excavation	Controls	Typical Depths
Types of underground assets (Note: The owners of assets registered with the Dial Before You Dig service and covered by this Guideline require an enquiry through this free service and the compliance with any directive issued with information regarding the asset)	The minimum approach distance for individuals carrying out work near underground assets	<p>Distance 'B' is the minimum approach distance for powered excavating machines</p>  <p>For directional boring across the line of an asset a minimum clearance of 300 mm from the asset shall be maintained</p> <p>For directional boring parallel to the asset and at the level of the asset, a clearance of 500 mm shall be maintained from the edge of the nearest asset. It may be necessary to dig trial holes to prove the location of the nearest asset at points along the route. See Section 6.10</p>	<p>If the risk assessment identifies a potential risk of making contact with both underground and overhead assets, two safety observers would be required. One observer to ensure that the machinery maintains a safe distance from underground assets, the other observer to ensure a safe distance from the overhead powerlines</p> <p>In the case of gas or electricity assets, an appropriate fire extinguishing system must be at the worksite</p> <p>If the width and/or depth of the excavation will expose the asset, the asset owner must be contacted prior to commencing work</p>	
Low and Medium Pressure services and Low pressure mains	N/A	300 mm	<p>Pot-hole to confirm location of service</p> <p>The position of the asset will not appear on the maps</p>	300 - 450 mm

Assets	Clearances	No Go Zone For Powered Excavation	Controls	Typical Depths
Medium Pressure mains	N/A	300 mm	<p>Pot-hole to confirm location of asset</p> <p>The code of practice for shafts, tunnels and trenches, and the guide to dangers of poorly ventilated workplaces</p> <p>Only one individual at a time should be excavating if hand excavation is being undertaken in a confined space. Another should act as an observer and be able to operate any breathing, escape or fire equipment required</p> <p>The elimination of an ignition source in the event of an escape</p> <p>Excavation below underground assets should not be undertaken within a distance of 300 mm below the asset located at the lowest level</p> <p>Note: All transmission pipelines involving gas, oil and petrochemical have separate requirements and the asset owners should be contacted.</p>	450 – 750 mm
High Pressure services, mains and pipelines	300 mm with hand tools and supervision from Network Authority	1000 mm	<p>Powered excavation within 300 – 1000 mm is only permitted under supervision and with a Permit to Work from Asset Owner</p> <p>Also see Controls for medium pressure mains immediately above</p>	750 – 1200 mm
Low Voltage Electricity cables – voltages less than or equal to 1000V (1kV)	Close proximity with use of hand tools	300 mm	Must contact asset owner for specific conditions	450 – 750 mm
Electricity conductors from 11,000V (11kV) up to 33,000V (33kV)	Close proximity with use of hand tools	600 mm	Must contact asset owner for specific conditions	900 mm

Assets	Clearances	No Go Zone For Powered Excavation	Controls	Typical Depths
Underground sub-transmission cables 33,000V up to 132,000V (132kV)	Must contact asset owner	Must contact asset owner	Must be carried out under the supervision of the asset owner	900 mm
High Voltage Electricity cables - voltages from 1000V (1kV) up to 33kV	Close proximity with use of hand tools	Must contact asset owner	Must contact asset owner for specific conditions	600 – 1000 mm
Extra High Voltage Electricity Transmission cables - voltages above (132kV) and 330,000V (330kV)	Must contact asset owner	Must contact asset owner	Work must be carried out under the supervision of the asset owner	800 – 1200 mm
Telecommunications cables	Contact asset owner for specific conditions	Contact asset owner for specific conditions	Must contact the asset owner for specific conditions	Typically 450 – 600 mm, other assets to 1200 mm
Water pipelines	N/A	300 mm (if pipeline is 200 mm or greater in diameter)	Pot-hole to confirm location of asset	Min 450 mm
Sewerage pipelines	N/A	300 mm (if pipeline is 200 mm or greater in diameter)	Pot-hole to confirm location of asset	Between 600 mm to 10 (ten) metres

5.3 ON-SITE CHECKING

Prior to any excavation work, check at least 100 m along the footpath in each direction and around nearby corners for indications of existing assets. These include:

- indicators or markers for underground assets, drainage pits and manhole covers
- damaged footpaths, driveways or depressions which may indicate the presence of a trench
- cables running up a pole
- overhead cables near the worksite
- control cabinets
- no overhead wires to a building or premise
- above ground connection cabinets
- transformers for cathodic protection on power poles
- light poles without an overhead service
- service pits for gas, water, electricity, communications, sewerage and drainage connections
- down pipes or vent poles
- underground storage tank fill points and venting systems
- kerb markings
- water valves
- fire hydrants and plugs
- sprinkler systems
- road repairs
- trap doors or access-covers for:
 - access to underground electricity substations
 - access to cable jointing pits or tunnels
 - access to sewerage or stormwater trunks
 - access underground gas regulators, siphons and valve assemblies
 - access to shafts
 - link box pits, oil tank pits and other ancillary underground pits.
 - domestic service pits
- gas or water meters
- electricity pillars and meter boxes
- any other signs out of character with the surrounding area such as a clearing for an easement.

- If such indications exist, the asset must be located by hand or another approved method.

5.4 PLAN OR DRAWING READING

Although each asset owner may have their own type of plan, with special notations and legends, the basic principle of map reading can be applied.

Telecommunications plans, and in some cases electrical plans, may provide a detailed representation of the asset or network. When reviewing the information:

- identify the streets or buildings nearby and position yourself so the streets correspond with the plan/s
- use the scale and measurements indicated on the plan/s to pinpoint your exact location
- remember, drawings may NOT be to scale
- many plans reference the asset location from an adjacent property alignment
- determine if measurements are metric or imperial, or a combination of both
- identify nearby pipes or cables and mark their recorded location
- cross-reference any supplementary plans or details
- identify any of the items listed below and assess their relationship to each other to determine if a measurement has altered:
 - building lines
 - pits and poles
 - offsets
 - turning points.

Note: Inaccuracies can and do occur, both on plans and in the ground. If in doubt, check with the asset owner. Never guess or assume!

Asset owners' plans show only the presence of some cables, pipes and plant. They only show their position relative to road boundaries, property fences etc at the time of installation and the utilities do not warrant or hold out that such plans are accurate thereafter due to changes that may occur over time. **DO NOT ASSUME DEPTH OR ALIGNMENT** of cables or pipes as these vary significantly. For example, road and building alignments and levels may change.

6. MANAGING THE RISKS

6.1 MANAGING RISKS IN THE WORKPLACE



Employers and self-employed persons must identify any foreseeable hazards, assess their risks and take action to eliminate or control them.

A hazard identification and risk assessment process must be carried out at the planning and preparation stage by the employer/contractor doing the work to determine what risks may arise when the work is being carried out. Safe systems of work must then be put in place to eliminate or control these risks. For tunnel construction work the safe system of work must also be documented in a Safe Work Method Statement (SWMS).

6.1.1 Monitor and review risk assessments and control measures



The OHS Regulation states that employers must review risk assessments and measures adopted to control risks whenever:

- there is evidence that the risk assessment is no longer valid
- an injury or illness results from exposure to a hazard to which the risk assessment relates
- a significant change is planned to the place of work, work practices or work procedures.

6.1.2 Safe work method statements (SWMS)



The OHS Regulation requires SWMS where the cost of the work undertaken exceeds \$250,000 or for defined high risk construction work. Construction work in tunnels is defined as high risk construction work, so tunnelling work requires a SWMS.

The SWMS:

- describes how the work is to be carried out
- identifies the work activities assessed as having safety risks

- identifies the safety risks
- describes the control measures that will be applied to the work activities. It also includes a description of the equipment used in the work, the standards or codes to be complied with, the qualifications of the personnel doing the work and the training required to do the work.

A SWMS requires the work method to be presented in a logical sequence. The hazards associated with each process are to be identified and the measures for controlling these hazards specified.

Break down each job into a series of basic job steps to identify the hazards and potential accidents in each part of the job. The description of the process should not be so broad that it leaves out activities with the potential to cause accidents and prevents proper identification of the hazards.

Employees of the workforce should be involved/consulted in the development and implementation of any SWMS.

All persons involved in carrying out the work should understand the SWMS before commencing the work.

6.1.3 Consultation with relevant parties prior to commencing work

The planning before the start of work, which may affect a utility asset, must include but not limited to:

- consultation with local councils
- consultation with asset owners to obtain agreement on the use of out of service, retired or unused assets
- advising affected residents/occupants
- obtaining permit requirements and conditions for undertaking the works
- identifying and determining exact location of assets
- establishing methods to be adopted to protect existing assets

- further consultation as required by the scope of works
- consultation with 'Dial Before You Dig' and the asset registers of other infrastructure owners not registered with 'Dial Before You Dig'
- consultation with roads authority (eg RTA, local council or private body)
- consultation with local councils in terms of storm water assets and work in council owned roads.

Where underground assets exist, the precise location of the assets shall be established in conjunction with the asset owner by pot-holing (or equivalent non-destructive asset location techniques) prior to the principal excavation commencing.

Consideration must be given to the presence of private property assets eg telecommunications, gas, stormwater, sewerage and water assets. These private property assets are unlikely to be found on any plans and are best identified by a visual on-site inspection.

The use of an Electronic Service Detection Device to survey the ground for buried pipes and cables, before commencing excavation, should be considered.

The close out process of the project or scope of work may typically involve recording the 'as constructed' diagram of the asset and providing this record to the appropriate agency with details of:

- finished surface level
- depth of asset
- alignments from property boundary and/or kerb etc
- type of cover or warning device installed eg warning tape, concrete slab, mechanical polymeric protection strip etc
- new ownership details of the asset
- assets retired, removed, declared out of service etc
- type, size, location and installation method of assets
- surface and underground markings installed
- advice to any authorities, agencies etc on the completion of the project or scope of works
- cancellation of any permits, authorities etc

- the provision of a copy of the asset plans to the new owner.

For more information on how to safely dig near an asset, specific information is provided on the Telstra website via the following link www.telstra.com.au/dialbeforeyoudig/digging.htm. Excavation with hand tools shall be carried out carefully up to but not closer than the minimum distances specified in Table B.

6.1.4 Planning and liaising with other authorities

When planning, it is important to discuss and consider the following areas:

- existing utility assets
- duration of the project and scope of works
- future planned assets
- opportunities for coordination of works
- shared trenching opportunities
- thermal impacts on EHV electricity assets
- changing ground surface levels
- installing heat sources (eg other electricity assets)
- creating underground voids (eg stormwater assets)
- changing backfill materials
- possible limitations in information available
- opportunities to improve information availability
- effect on traffic
- opportunities to isolate or relocate existing assets
- provision of visual identification devices
- asset owner and other authorities' concerns, conditions and expected working procedures
- any requirement/s for the worksite involving:
 - access to assets
 - permit conditions
 - recording of infrastructure, assets locations or relocations
 - financial costs
 - individual, asset or community safety
 - worksite and traffic management requirements and railway safety management requirements

- reinstatement requirements (this liaison is in addition to the statutory notification required by legislation).

Consideration must be given to the operation of heavy plant over potentially fragile underground assets.

6.2 RAILWAY ASSETS

Rail easements have numerous electrical power, signalling, communication cables, compressed air and drainage lines that are owned and maintained by the Rail Authority. These assets vary in type of construction and are documented to various degrees of accuracy.

Numerous utility service providers and other private parties also jointly use the rail easement. Access to the rail easement is strictly regulated by the requirements of AS 4292.1: 2006 and AS 4799: 2000.

Access to information relating to the location of the various rail assets is issued on application.

6.3 SERVICE TUNNELS

Many utilities own or share service tunnels. These will have shafts plus manholes at the surface or other surface infrastructure supporting the tunnel environment.

6.4 EXCAVATION AND TRENCHING

To maintain essential structural support and the protection of other existing assets, excavations in the vicinity must not disturb the embedment around each asset (see Table B for minimum approach distances and to identify if the asset owner must be contacted for specific approach conditions). This information should be supplied by the asset owner through a 'Dial Before You Dig' request. Where this is not possible, the relevant asset owners must be consulted and their permission first obtained.

- If a cable or pipe is exposed, the contractor must ensure that any angular material such as rock or gravel does not mix into the embedment material
- Excavations in any easement must be backfilled, compacted and re-sealed to the

appropriate Authority's standard at the completion of excavation

- Temporary restorations in roads and footways must be of sufficient quality to ensure the safety of pedestrians and vehicles until the final restoration is undertaken. Temporary restorations must be regularly checked by the responsible party to confirm their integrity
- Refer to NSW Code of Practice, *Excavation*
- Refer to:
 - AUS-SPEC 306U *Road Openings and Restoration* (2004 and earlier additions)
 - AUS-SPEC 7200 C0219 *Construction - Roadways - Road openings and restorations for utilities* (2007).

6.5 ASSETS NEAR BRIDGE APPROACHES

Often underground assets will be congested at the approach to bridges. Assets' typical depths may vary substantially, rising and falling sharply and at much shallower depths than elsewhere as they are channelled into shared allocated spaces on the bridge. Road safety barriers are often very close to heavily congested services at the approaches to bridges. Construction staging and footing design for such barriers should consider impacts on assets and, where possible, construct barriers prior to constructing the assets.

6.6 ASSETS AROUND POLES

Unless otherwise agreed, underground assets and other obstructions around poles are to be kept a minimum distance of 300 mm from the periphery of the pole, to allow inspections by asset owner staff.

No excavation within 10 metres of a Single Wire Earth Return (SWER) transformer pole is to occur without the approval of the local electricity asset owner.

It should be noted that the NSW Service and Installation Rules require a sketch of the underground service/consumers mains to be marked inside the switchboard.

6.7 TRAFFIC CONTROLS

All work carried out on RTA NSW controlled roads must be done in accordance with the RTA's *Traffic Control at Work Sites Manual*. As this manual is considered to be the benchmark for traffic control in NSW, all works carried out within the road corridor or on adjacent pathways should be conducted in accordance with this manual.

6.8 EMERGENCY WORK

While there will be times when, due to pressing requirements, the timeframe for starting work will prevent some of the normal controls from being completed, this will not diminish the responsibility of worksite controllers to do everything that is reasonable and practical that is within their power to ensure the health, safety and welfare of persons affected by their actions.

6.9 VERTICAL BORING

For any boring within 500 mm of an underground asset, the location of the asset/s shall first be proved by careful hand digging (pot-holing) or equivalent asset location techniques and:

- a minimum clearance of 300 mm from the edge of the underground asset shall be maintained for pole hole boring
- lead in excavations shall be used.

Note: All transmission assets including EHV electricity cables, pipelines involving gas, oil and petrochemicals have separate requirements and the asset owners should be contacted.

6.10 DIRECTIONAL BORING

- When boring across the line of an underground asset, the location of the asset/s shall be positively proven by hand digging (pot-holing) or proven by another approved method.
- All transmission pipelines involving gas, oil and petrochemicals have separate requirements and the asset owners should be contacted.
- For boring under electricity cables, it is necessary to excavate a slit trench beside the cables to confirm the depth of the cables

and ensure the drill is not within the minimum approach distance of the cable specified in Table B.

- Additional precautions and clearances are required for directional boring near or beneath sub-transmission cables, normally located in roadways. If the bore is to pass within 2 metres of any electrical cable or conduit the asset owner must be notified as the clearances for HV and EHV may be significantly greater.

See Table B for further information on clearances.

6.11 MECHANICAL EXCAVATING PLANT

Reference should be made to SafeWork NSW's *Moving Plant on Construction Sites* code of practice.

Mechanical excavating plant may be used with care up to, but not closer than, the minimum distances as specified in Table B.

- Where the excavation is being carried out parallel to or across underground asset/s, location of the asset/s must be proven by careful hand tool excavation (pot-holing) or another endorsed method used to positively locate the asset prior to mechanical excavation.
- If an excavation must exceed the depth of the asset and will disturb the protective cover, slab, other asset/s or the bedding material around the asset/s, the asset owner/s must be contacted to determine if the asset/s is to be relocated.
- Excavations must be reinstated to comply with the asset owner's requirements.
- Where plant is required to operate over underground assets, such as in major road reconstruction, the clearances as specified in Table B must be maintained. Alternatively, if Table B cannot be complied with, the asset can be mechanically protected by an engineered structure agreed to by the asset owner.

Note: All transmission cables, pipelines and petrochemical networks may have separate requirements and the asset owners should be contacted before commencing work.

6.12 EXPLOSIVES

The use of explosives by licensed operators must only be used after a comprehensive risk assessment has been undertaken in consultation with all owners of assets in the vicinity and must be consistent with the requirements of the *Explosives Regulation 2005*.

6.13 PILE DRIVING

Pile driving adjacent to underground assets must not take place without authority from the owner of the assets. The exact location and depth of all adjacent assets shall be physically proved by hand digging (pot-holing) or equivalent asset location techniques prior to commencement of work.

The effects of vibration on the asset must be considered when planning the work.

6.14 IDENTIFICATION OF ASSETS NOT ON PLANS

Where an asset that is not identified on any plans etc is located in the field, work should be suspended until the asset is positively identified and any remedial controls put in place. Depending on the nature of the risk, it may be necessary to notify the asset owner and obtain a revised plan.

6.15 ASSET SEPARATION DISTANCES

To avoid safety and operational conflicts resulting from space infringement issues, refer to the Street Allocation Diagrams in Section 13.

7. SAFE SYSTEMS OF WORK

A critical part of planning safe systems of work is making sure that the plans are accurate. With some assets installed over 60 years ago, it is likely that changes would have been made to the surface of the land at some stage. Road widening and regrading of surfaces are common causes for inaccuracies in records. For this reason, when working from old records, pot-holing and/or pipe and cable locating devices should be used. The relevant authority or asset owner should be told of any inaccuracies in records.

Asset owners typically require notification of a major project or where the project may require supply of a service or product outside normal residential demand.

A safe system of work should be sufficiently robust to include site controls that will ensure assets on construction sites are not damaged. All those who dig the ground should be aware of the assets in the area before they dig and have appropriate controls in place. Particular attention needs to be given to relocated assets and persons new to the site to ensure they are aware of the assets and their locations.

At the project planning stage it is important to consider minimising damage to surface infrastructure and disruption of services to residents, pedestrians and traffic. Any construction or maintenance technique should ensure adequate clearances are maintained between assets and that other assets crossings are identified.

Access to assets must be maintained at all times to ensure emergency and scheduled maintenance activities can be carried out by the asset owner. Contractors should also give consideration at the planning stage for site storage of material and traffic areas associated with construction activities so these do not impede access to or damage assets.

Consideration should also be given to the appropriate level of supervision and training, including specific industry awareness training, for an individual undertaking work near any gas or electrical assets.

7.1 EXCAVATION USING NON-POWERED HAND TOOLS

For more information on how to safely dig near an asset, specific information is provided on the Telstra website via the following link www.telstra.com.au/dialb4udig/digging.htm. Excavation with hand tools shall be carried out carefully up to, but not closer than, the minimum distances specified in Table B.

There is a duty of care when excavating near cables, pipes and plant. Before using machines to excavate, **underground assets must first be exposed by pot-holing with non-conductive tools** to identify its location. Damage can also result in serious injury or death to workers and widespread disruption to services and traffic.

7.1.1 Work on top of or below an underground asset

No disturbance of the underground assets, including any mechanical cover (eg concrete or polymeric cover slab), should occur without prior notification to the asset owner.

Excavation must not be carried out below an underground asset unless steps are taken to ensure that:

- the asset/s or the integrity of the asset and support material is not damaged
 - under-crossing shall be at right angles whenever possible
 - such excavation below the asset/s should not come within the distance specified in Table B.
- Note:** all transmission cables, pipelines and petrochemical networks may have separate requirements and the asset owners should be contacted before commencing work
- steps must be taken in consultation with the asset owners to ensure the asset is adequately supported.

Note: Also see Section 6.10 Directional Boring.

7.1.2 Work beside an underground asset

If any excavation beside underground assets comes within the clearances specified in Table B, then the asset owner must be notified prior to work commencing. Measures should be agreed upon to ensure the stability of the surrounding soil or material.

7.2 ACCIDENTAL CONTACT WITH UNDERGROUND ASSETS

In the event of an inadvertent contact with an underground asset, it is essential to notify the asset owner and comply with the reporting requirements under the OHS Regulation (Chapter 12).

7.2.1 Electrical assets

Should contact be made with a live overhead power line or a flash-over occur between a live overhead power line and a crane or an item of mobile plant, the following actions shall be taken:

- an attempt should be made to break the machinery's contact with the live overhead power line by moving the jib or driving the machine clear
- if it is not possible to break the contact with the live overhead power line, the operator of the crane or mobile plant should remain inside the cabin of the crane or on the plant item. The network operator should be called immediately to isolate power to the live overhead power line. The operator must remain in place until the power has been isolated and the 'all clear' given by the network operator



When a crane or item of plant inadvertently contacts overhead power lines, circuit protective devices may operate to automatically turn the power off. However, some protection devices are designed to automatically reclose thereby re-energising the power lines after a short period of time, typically 1–4 seconds.

- if it is essential to leave the cabin or the operator's position due to fire or other life threatening reason, then jump clear of the

equipment. Do not touch the equipment and the ground at the same time. When moving away from the equipment, the operator should hop or shuffle away from the plant item (with both feet together) until at least 8 metres from the nearest part of the crane or plant. **Under no circumstances run or walk from the crane or item of plant as voltage gradients passing through the ground may cause electricity to pass through the body resulting in an electric shock**

- warn all other personnel and members of the public to keep 8 metres clear from the crane or item of plant. Do not touch or allow persons to touch any part of the crane or plant item and do not allow persons to approach or re-enter the vehicle until the network operator has determined the site safe. Remember electricity flows through the ground, so an electric shock could be received from walking close to the scene. If the crane or plant operator is immobilised, ensure the power supply has been isolated and the site made safe before giving assistance
- untrained, unequipped persons should not attempt to rescue a person receiving an electric shock. All too often secondary deaths occur because others get electrocuted trying to help earlier victims. If the crane or plant operator is immobilised, ensure the power supply has been isolated and the site has been made safe before giving assistance.

7.2.2 Gas assets

Should an incident involving gas assets occur, the following actions should be taken:

- all work should cease immediately
- operator is to shut down the plant or equipment UNLESS this process may provide an ignition source for any escaping gas
- it is essential to leave the cab or operator station, trench or enclosure and maintain an exclusion perimeter due to the risk of explosion or fire. Do not attempt to use any instrument which may provide an ignition source near the gas escape. This may include mobile phones, two way radios, etc
- warn all other personnel and/or public to keep clear from the worksite and equipment. DO NOT attempt to approach, re-enter or

start the vehicle until the relevant authorities have determined the site is safe

- contact the fire brigade on 000 if life and/or property are threatened
- facilitate First Aid treatment and seek medical aid as required
- advise your organisation's emergency contact and request they immediately notify the relevant authorities, including the relevant asset owner
- initiate the emergency management plan and incident investigation process.

7.2.3 Sewerage assets

Should an incident involving sewerage assets occur, the following actions should be taken:

- cease work, make the site safe and contact the sewerage asset owner as soon as possible. Local circumstances and/or ownership should be considered
- if contaminated, shower or wash down with copious amounts of water. Remove any contaminated clothing as soon as practical
- there is a risk of infection from ingestion or eye contact. If eyes are contaminated, flush with copious amounts fresh potable water. If ingested, seek medical advice
- for skin contact, wash with soap and water. For broken skin and abrasions, also seek medical advice
- protect the public and watercourses from exposure to raw or untreated sewage
- if damage to a sewer pipe occurs during construction works, take appropriate steps to prevent surrounding material entering the pipe.

7.2.4 Water assets

- Cease work, make the site safe and contact the asset owner.

7.2.5 Telecommunications assets

- Report any damage to Telstra assets by phoning **13 22 03**.
- Contact specific asset owner if not owned by Telstra.

7.3 COOPERATION WITH AUTHORITIES

Constructing authorities and others operating in a public road reserve, rail reserve or private property have a duty of care to protect the existing assets of utility providers. It is essential to determine the location of existing assets by obtaining plans and proving the exact location before excavating.

Asset owners may have formal agreements in place describing how work shall be undertaken near each other's assets and these shall be complied with.

7.3.1 Obligations of asset owners and contractors

There is an obligation for all asset owners, contractors and service providers to observe the specifications and separation distances indicated in the Streets Opening Conference diagrams (see Section 13) or those agreed through consultation between asset owners.

All contractors should notify the relevant asset owners if they locate any asset that is not shown accurately on the plans. At no time may an asset be relocated or moved without the prior authority of the asset owner.

7.4 DOCUMENTED SYSTEMS OF WORK

A documented **risk assessment** developed in consultation with those supervising and undertaking the activity is necessary for all activities where excavation and inadvertent contact with underground assets may occur.

A **SWMS** is to be developed in accordance with the OHS Regulation which captures details of the risk assessment and the required training/qualification. All those workers undertaking the activities identified in the SWMS should be made aware prior to commencement of work (eg toolbox talk).

An **excavation permit** is an excellent method of managing the investigation and approval process leading up to the commencement of the excavation. A properly constructed permit will produce a rigorous process that must be

followed and completed prior to excavation activities and includes the positive identification of underground assets.

Verification activities such as **audit and inspection** are an excellent means of ensuring that the process has been correctly implemented at a systems level and on the ground before and during the excavation activity.

7.5 TRAINING OF MANAGERS AND EMPLOYEES

Training is an integral component of reducing the risk of inadvertent contact with underground assets.

Managers and supervisors need to be made aware of the hazards and overarching requirements regarding inadvertent contact with underground assets such that they are able to implement safe systems of work and properly plan for and oversee the activities.

Both managers/supervisors and employees will benefit from information and training regarding the use of electronic detection devices, how to use the 'Dial Before You Dig' service and how to read plans supplied by the asset owners and/or 'Dial Before You Dig'.

Employees need to be made aware of the systems in place to minimise the risk of inadvertent contact with underground assets and also the hazards facing them if these systems are not employed.

Site-specific induction systems should include details such as the known location of assets, the site safety rules in relation to excavations (eg no excavations without a permit) and provide inductees access to, or a copy of, the utilities location plan for the work zone.

7.6 ASSET OWNER PLANS AND 'DIAL BEFORE YOU DIG'

A site meeting with the asset owners may be required to determine location/s and procedures for dealing with assets within the scope of work. This issue should be addressed during initial project development to provide time to establish a regime to manage any risks.

Before commencing any excavation work, reference shall be made to the details or plans of the utility or private assets in the proposed excavation area as well as a site inspection to identify any unmarked assets. Plans illustrating the location of known underground assets can be obtained from individual asset owners or the 'Dial Before You Dig' service.

As mentioned, the location of underground assets provided by a service or utility provider may not be accurate for many reasons. As complete accuracy cannot be guaranteed, the position of underground assets must be proven by hand excavation, pot-holing or other approved techniques.

For work in the vicinity of EHV electricity transmission cables it is mandatory to have a meeting with the asset owner prior to any work commencing.

7.7 CABLE/PIPE IDENTIFICATION DEVICES

An electronic pipe or cable locator should be used to more accurately identify the location of the underground asset – as asset owners' plans will not provide exact locations.

Once identified using such electronic device, care should be taken to mark the location of the underground asset on the ground's surface.

7.8 GROUND PENETRATING RADAR (GPR)

Ground penetrating radar (GPR) is emerging within the civil construction industry as an excellent tool for identifying underground assets and mapping assets on a wider scale.

GPR is a non destructive and non invasive technique for rapidly imaging the shallow surface (up to 10 m) and produces high resolution colour section in real time. Parallel images can be used to create a 3D image.

7.9 POT-HOLING

Pot-holing is the use of hand tools to excavate to a pre-determined depth to establish if assets exist in the immediate location. Pot-holing is a proven method of identifying assets.

Never assume that underground assets are positioned in the location as depicted on the plans or in the depth suggested. All underground assets should be positively identified prior to commencing excavation.

Pot-holing should be undertaken along the length of the proposed excavation to identify the path of underground assets and their depth. The information contained on the asset owner's plans and gathered during electronic identification methods helps in this process.

- careful digging (ie pot-holing) is the only sure way to identify the depth and alignment of underground pipes and cables
- pot-holing must be undertaken with reference to plans and other information provided by pipe and cable owners.

The amount of pot-holing should be determined with reference to the risk assessment for the site. Excavators should also pay attention to pot-holing requirements included in work practices provided with the network plans and onsite by a representative of the pipe and cable owner.

7.10 AIR AND WATER LANCING

Air/water lancing techniques may be used in some circumstances, but the advantage of these needs to be assessed against any inherent safety and environmental risks, eg dust generation, contaminated water runoff and possible damage to underground assets.

7.11 TRENCHLESS TECHNIQUES

Pot-holing must be used to locate existing underground assets to ensure adequate clearances are maintained between assets and to locate other asset crossings. Pot-holing at each asset crossing and at regular spacing along assets is recommended.

Where high risk assets are identified, consultation with the asset owner is required. Consultation is also required when using directional boring

across existing utility lines. Where clearances required by other assets cannot be achieved at the proposed depth of asset installation, alternative solutions should be sought in consultation with the relevant parties.

It is crucial to provide the "as constructed" details on this type of installation for future reference because:

- the ground above the bore is typically undisturbed, not offering any indication of previous works
- of the inability of directionally-bored installations to provide warning tape or mechanical protection above the asset
- the bore may not follow a direct route.

7.12 SAFETY OBSERVERS

Excavation work around underground assets should only be undertaken with the assistance of a competent safety observer.

The safety observer/s should be given sufficient control of the activity to call for a cessation of work in the event of system failure or observation of unsafe practice which may give rise to an inadvertent contact with an underground or overhead asset.

When excavating near or adjacent to underground assets it is important to be aware of overhead hazards such as overhead powerlines. Risk assessment may dictate a requirement for more than one safety observer for such activity, eg one observer to mitigate inadvertent contact with underground hazards and the other to mitigate inadvertent contact with overhead hazards.

7.13 CONFINED SPACES

Excavations are generally not confined spaces. However, confined space provisions may apply to certain excavations where the excavation enters foul or contaminated ground or opens a live sewer. Also, where the atmosphere can be altered by exhaust gases or other contaminants, the excavation is to be treated as a confined space. Further information is given in SafeWork NSW's *Code of Practice: Excavation*, Section 4.

7.14 GLOBAL POSITIONING SYSTEM (GPS)

GPS technology provides an excellent opportunity to plot the location of underground assets and maintain that information for the duration of the project. This is especially important in maintenance and long term projects.

GPS locations, when captured, should be noted on relevant plans. This information should also be provided to asset owners for any as built/modified infrastructure or previously unidentified underground assets.

7.15 ABOVE GROUND IDENTIFICATION DEVICES

Previously in this document, many above ground identification devices have been discussed that may assist identifying underground assets.

The Western Sydney Orbital Project (M7) successfully implemented a process where different coloured conduits (according to the nature of the asset) were temporarily inserted into the pot-hole directly onto the underground asset. These conduits, when back filled, extended approximately 1-1.5 metres above the ground and were plugged on top to prevent dirt and debris entering the conduit. These above ground locators enabled easy visual identification of the path of known underground assets and, when a measuring tape was inserted into the conduit, provided the exact depth of the asset.

8. TRAINING, INSTRUCTION AND INFORMATION



The OHS Act requires employers to provide such information, instruction, training and supervision as may be necessary to ensure the health, safety and welfare of their employees while at work.

In addition, some activities are restricted to persons holding the relevant certificate of competency, for example scaffolding and operation of cranes and some load shifting equipment. See the OHS Regulation or the *Industrial Certification Manual* for a full list of such activities.

- arrangements for the management of OHS, including arrangements for reporting hazards to management
- health and safety procedures relevant to the work of the employee, including the use and maintenance of risk control measures
- how to access any health and safety information that the employer is required to make available to each employee
- any other induction training relevant to the place of work (eg confined spaces entry training), having regard to the competence, experience and age of the new employee.

8.1 TRAINING REQUIREMENTS

In addition to the requirements of construction training, all persons undertaking work involving underground assets must be instructed, trained and assessed as competent for the tasks they are undertaking.

Training includes but is not limited to:

- induction
- general health and safety induction training
- work activity health and safety induction training
- site specific health and safety induction training (Clause 216 OHS Regulation)
- risk assessment methodology
- training in the use of SWMS
- plan/map reading
- utility specific statutory training.

8.2 INDUCTION TRAINING



The OHS Regulation requires that employees receive OHS induction training, including general health and safety induction training, work activity based induction training and site specific induction training, and that this training covers the topics set out in the *Code of Practice: Occupational Health and Safety Induction Training for Construction Work 1998*. The training must cover the following points:

8.3 TRAINING TOPICS

Training should draw on knowledge of the known hazards and risks in your operations, including matters described in this Guideline. The source of risks should be pointed out and the adverse outcomes that have been experienced by others should be used to stress the importance of safety.

The training provided and the instruction given should at least include all safe work methods to be used on the job and matters described in this Guideline, that is, all hazards, risks and control measures for control of hazards.

8.4 WHO SHOULD RECEIVE TRAINING?

The target groups for training at a workplace include but are not limited to:

- managers and supervisors of employees and/or other persons undertaking work considered at risk of injury and/or who have responsibility for implementing safe operating procedures
- OHS committees and OHS representative/s
- staff responsible for the purchasing and maintenance of plant, PPE and for designing, scheduling and organisation of work activities
- persons undertaking risk assessments or preparing SWMS

- employees and subcontractors undertaking the work, including employees of labour hire organisations.

As the needs of each target group are different, the content and methods of presenting training material should be tailored to meet the specific needs of each group.

8.5 PROVISION OF INFORMATION AND INSTRUCTION

Information may include:

- the results of any applicable risk assessment
- SWMS
- a review of such a risk assessment and/or SWMS or operating procedure
- any other relevant OHS information.

Employers should brief each employee as to the contents of risk assessments and SWMS when each employee and/or other person first begins to perform tunnelling work, at regular intervals thereafter, and whenever there are changes to risk assessments or new information about health and safety risks becomes available.

Employees and other workers should have, on request, ready access to risk assessments and SWMS.

9. CASE STUDIES AND CHECK LISTS

9.1 REPAIRING SEWERAGE PIPES

A reactive dig and repair job was commenced by a work crew of a sewage and drainage authority following the internal surcharge of a sewer line at a preschool adjacent to the worksite. CCTV was used to identify the repair location of the sewer. Damage to the sewer pipes apparently occurred during the laying of electrical conduits approximately 20 years ago and a contractor had carried out a repair of that damage. The repairs appear not to have been referred back to the responsible sewerage authority and eventually resulted in the internal surcharge at the preschool.

The work crew did not find indicator plates or markers identifying underground power

in the immediate area, and, because locating equipment was not readily available, made a decision not to delay the work and to commence excavating with a mechanical excavator. The excavator uncovered bricks marking an electricity asset directly over a conduit. Marker tape was found but was not immediately obvious.

An incident was declared by the work crew and work stopped when the conduits were uncovered. The asset owner was called to the site and supervised the remainder of the repairs. An insulated spud bar was used to break up concrete that was placed around the pipe in the original repair. The pipe was replaced, work completed and the excavation backfilled. The incident was reported as a near miss.



The hazards shown here include a broken sewer pipe and high voltage cables.

The risks were electric shock, contaminated and hazardous atmosphere (from sewer gases) and possible infection.

Failure to identify the presence of these cables before work commenced exposed the workers to the risk to health and safety.

Once the risk was identified, the controls included the use of insulated tools to excavate under the supervision of an authorised person from the asset owner.

9.2 COUNTRY TELECOMMUNICATIONS CABLE DAMAGE CASE STUDY



At this location, a contractor working for a telecommunication carrier performing combined pre-ripping and plough operation to install new optic fibre cable, damaged the Telstra major interstate fibre cables.

The new route was being installed through rural paddocks and properties by D7 dozer and trenching machinery. The route was being installed parallel to the existing Telstra major fibre route.

At the manhole, approx 20 metres from the damage location, a 30 fibre cable, 16 fibre cable and a 30 pair copper cable left the manhole at right angles following the fence line. The contractor failed to identify the break off from the manhole shown on the plans. These cables were subsequently damaged during the pre-ripping procedure near the fence line.

The contractor believed the main cables were in another location, the one they had been following, and they had not noticed the manhole (located approximately 20-30 metres from the pre-ripping process) until after the damage had occurred. Two markers on either side of the manhole were clearly visible from a distance.

Site observations

- The Telstra fibre cable route was clearly marked with Telstra yellow concrete markers, which was easily visible.
- The manhole was marked with a yellow concrete marker post at either end of the manhole.
- The cable route was clearly shown on Telstra plans that the contractor obtained from the 'Dial Before You Dig' service.
- There was no visible sign of asset location (pot-holing) on the ground such as markers, paint, peg lines, markings on the ground etc.
- There were deficiencies with the safe system of work used on the project.

9.3 CITY TELECOMMUNICATIONS CABLE DAMAGE CASE STUDY

A contractor in the west of Sydney drilling pier holes for the construction of townhouses caused significant damage to telecommunication cables resulting in severe disruption to telecommunication services in country NSW.

An auger operated by an excavation contractor made a direct hit on a telecommunications cable route. Thousands of telephone lines, mobile phone towers, EFTPOS terminals and data lines went dead all over NSW instantly.

The auger, a giant drill, severed six fibre optic cables running between 12 and 60 fibres each and a 2400 copper pair cable, about seven kilometres from the Parramatta exchange.

Physical cable damage was not confined to the one hole in the ground – it wrenched and ripped cables clean out of manholes for hundreds of metres on either side.

One of the cables was the main feed to the Bathurst and Orange area, others carried mobile phone traffic. Almost all the copper lines were in use by local households and businesses and, not least of all, the main ATM (asynchronous transfer mode) internet backbone running to the south and west out of Sydney. At one ISP alone, more than 100,000 customers across four states

were unable to log on to the internet for hours. Also 250,000 Foxtel service subscribers were disconnected, some for nearly 12 hours.

It was not just the phone services that went down. EFTPOS services died, and staff from a Bathurst supermarket were reduced to hunting around other businesses for manual transfer forms for more than a day so customers could buy groceries and debit their bank accounts. E-mail access in Bathurst was out too.

Had the 'Dial Before You Dig' service been contacted on 1100 and the appropriate plans used, the damage could have been avoided.

If there is any doubt at all about cable location, Telstra will send staff to show contractors and property owners how to check for stray lines. However, there was no call placed to the 1100 service for this damage.


When people in west Sydney picked up their phones and found no signal, they might have expected their mobiles or other carrier services to fill the gap. But Telstra, Optus, AAPT, Vodafone and Primus were all affected to some extent.

This incident was the cable cut of all cable cuts, but cut and flooded cables take down parts of the telephone and data network every day.

It took 50 technicians until 11.00 that night just to restore all the services, and two-and-a half days to finish all the work.



Sub-ducts and cables laying on the construction site, pulled out by an auger.

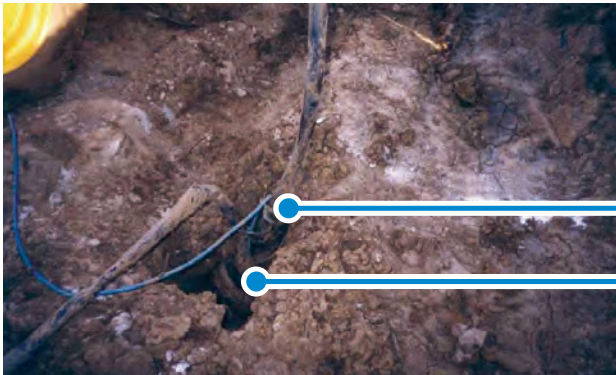

Twisted sub-ducts
and optical fibre.

One of the bored holes where
the cables and conduits had
been pulled out.



Twisted sub-ducts and
optical fibre.

Through these bored holes
large amounts of cables and
sub-ducts had been pulled
out. Thus, causing major
damage to cables and joints
in the Telstra Network.

9.4 EXAMPLE OF AN INCIDENT REPORT USED BY AN ELECTRICITY ASSET OWNER

‘Excavator operator injured when hitting 11,000 volt underground cable’

Date	07/10/05
Incident occurred at a place of work (refer OHS Act 2000)	(Construction site)
System voltage involved	11,000 kV
Address	Northumberland Road
Work being done for	Contestable work done for customer
Category	General public (workers – non networks worker)
Category type	Electric shock
Treatment	Medical treatment given (Hospital)
Description of injuries	Excavating for ASP to relocate 11,000 volt UG cables, excavator hit cable causing explosion and feeder trip. Victim received shock from excavator and was taken to hospital for check up. No permanent injuries
Network element involved in incident	Underground mains
Object involved in incident	Excavator
Location of incident	Urban
Location type	Public Roadway (including footpaths to property boundary)
	Accident area exposed to weather (ie outdoors)
Possible causes of incident	Failure to follow written procedures
Briefly describe possible causes of incident in more detail	Workers had located cable via searches but proceeded to dig with excavator beyond marker tape and hit cable
Initial corrective action	ASP and excavator operator advised of the dangers associated with excavation near cables. Advised that any work beyond covers or marker tapes can only be done using hand tools
Corrective action taken	excavator operator advised of his responsibilities when working near underground assets ASP reminded of his responsibilities in regard to site supervision and the need to consult plans before commencing any excavation work
Follow up	Cable isolated and repaired by IE. 50 customers interrupted for 5.2 hours

9.5 CASE STUDY: CONSTRUCTION OF THE M7 MOTORWAY

The Abi Leighton Joint Venture (ALJV) conducted an extensive risk assessment before commencing on the project and services both above and below the ground were identified as a major risk.

The ALJV consulted with the asset owners who identified an extensive number of assets in the M7 corridor and local road upgrades.

Plans were obtained from 'Dial Before You Dig' and from the asset owner. Electronic services detection was also conducted. These assets were then surveyed and non-destructive digging conducted to positively identify each asset. Colour coded conduits were then placed on top of the assets.

The ALJV still recorded hits to the assets as not all assets were identified on the plans or by 'Dial Before You Dig'.

Meetings were arranged by the ALJV with management and field staff, asset owners, subcontractors and 'Dial Before You Dig'. From these meetings the ALJV developed the following procedures through consultation to reduce the possibility of impacting on these assets:

- a request to de-energize high risk electrical assets where possible was made to the asset owner. A training course was developed and delivered by the ALJV and Integral Energy to approximately 500 ALJV and subcontractor employees on the project
- permits to excavate and work around assets were reviewed and developed with input from all stakeholders. The mandatory exclusion zones for underground assets were doubled
- colour coded conduits were used to identify the type of asset, location and depth
- when working in the asset zones, only toothless buckets were permitted to be used on plant
- banners, posters, stickers and signage were extensively used to remind all personnel of the procedures.

The ALJV, in consultation with a manufacturer, developed a GPS backpack to identify a known asset by comparing it to the ALJV survey database. This allows the ALJV to mark out existing assets and make this information more accessible and easier to understand.

By consulting and training all stakeholders, the ALJV was able to implement safe work methods and dramatically reduce the number of incidents impacting on assets.



Colour Coded Conduits used to identify assets



Manufacturer's backpack being used by ALJV survey staff



The manufacturer's pocket PC allows quick recognition of underground assets by touch screen technology. This identifies the type of asset and its approximate location.

10. FURTHER INFORMATION

10.1 AUSTRALIAN STANDARDS

- AS 2648.1 *Underground marking tape*
- AS 4026 *Electrical cables for underground residential systems*
- AS 1345 *Identification of the contents of pipes, conduits and ducts*
- AS 2566.2 *Buried flexible pipelines*
- AS 4271 *Interim – Geographic information data dictionary*
- AS 1742.3 *Traffic control devices for works on roads*
- AS/NZS 4360 *Risk management*
- AS 4799 *Installation of underground utility services and pipelines within railway boundaries*
- AS 4292.1 *Railway safety management*
- AS 2865:2001 *Safe working in a confined space*
- AS 1165 *Traffic hazard warning lamps*
- AS 1345:1995 *Identification of the contents of pipes, conduits and ducts*
- AS 1742.3 *Traffic control devices for works on roads*
- AS 1743 *Road signs – specifications*
- AS 1744 *Forms of letters and numerals for road signs*
- AS 1906 *Retroreflective materials and devices for road traffic control purposes*
- AS HB81 *Field guide for traffic control at works on roads:*
 - (HB81.1 Short term urban works – daytime only
 - HB81.2 Short term rural works – daytime only
 - HB81.3 Mobile works
 - HB81.4 Short term night works
 - HB81.5 Works on unsealed roads
 - HB81.6 Bituminous surfacing)

Australian Standards are available from SAI Global www.saiglobal.com/shop
email sales@sai-global.com or phone 13 12 42.

10.2 SAFEWORK NSW CODES OF PRACTICE

- *Code of Practice: Work Near Overhead Power Lines*
- *Code of Practice: Excavation*
- *Code of Practice: Moving Plant on Construction Sites.*

10.3 OTHER STANDARDS AND REFERENCES

- Streets Opening Conference (2007) *Guide To Codes and Practices for Streets Opening*
- Streets Opening Conference (1999) *Model Agreement for Local Councils and Utility Service Providers*
- *Service and Installation Rules of New South Wales* (2006)
- AUS-SPEC 306U *AUS-SPEC Road Openings and Restoration* (2004 and earlier additions)

- AUS – SPEC 7200 C0219 *Construction – Roadways – Road openings and restorations for utilities* (2007).

For Streets Opening Conference enquiries, contact The Secretariat, Institute of Public Works, Engineering Australia (NSW Division)

Phone 02 9267 6677 Fax 02 9283 5255 email ipwea@ipwea.org.au

For AUS–SPEC enquiries contact: Manager Specifications, Standards Australia, 286 Sussex Street Sydney NSW 2000. GPO Box 476 Sydney NSW 2001

Phone 02 8206 6713 Fax 02 8206 6021 email aus-spec@standards.org.au

10.4 LEGISLATION

- *Electricity Supply Act 1995*
- *Electricity (Consumer Safety) Act 2004*
- *Gas Supply Act 1996*
- *Occupational Health and Safety Act 2000*
- *Pipelines Act 1967*
- *Sydney Water Act 1994*
- *Hunter Water Act 1991*
- *Roads Act 1993 and Road Regulations 1994 (as amended)*
- *Local Government Act 1993*
- *Contaminated Land Management Act 1997*
- *Telecommunications Act 1997.*

11. APPENDIX A – UNDERGROUND ASSET LOCATION CHECKLIST

Worksite location: _____

(street name, cross street, landmarks)

Plans provided by: Dial Before You Dig ☐ Yes ☐ No Contractor ☐ Yes ☐ No

Asset owner ☐ Yes ☐ No

Underground assets located:

Utility (Note Utility from which plans were obtained)	Plans received as per dial before you dig information	Plans current Check dates	Plans indicate assets in vicinity	Assets checked	Pot-holing req'd	Pot-holing done	Stand-by req'd	Site marking completed	(sketch on rear of sheet)
	✓	✓	✓	Y/N	Y/N	Y/N	✓	Y/N	Y/N
Communications									
Electrical									
Water									
Sewerage									
Gas									
Other									
Other									

Sketch worksite and Utility locations on reverse side of page


Additional Comments:

Plans verified and confirm all assets as located? ☐ Yes ☐ No

Person locating asset	Person carrying out work
Signed	Signed
Name (Print) Business Name.....	Name (Print)
Date completed checks/...../.....	Date received checked results/...../..... Completed Checklist and Utility Plans included in job-pack. <input type="checkbox"/> Yes <input type="checkbox"/> No

UNDERGROUND ASSET LOCATION CHECKLIST – SAMPLE ONLY

Diagram of UG assets as located on site

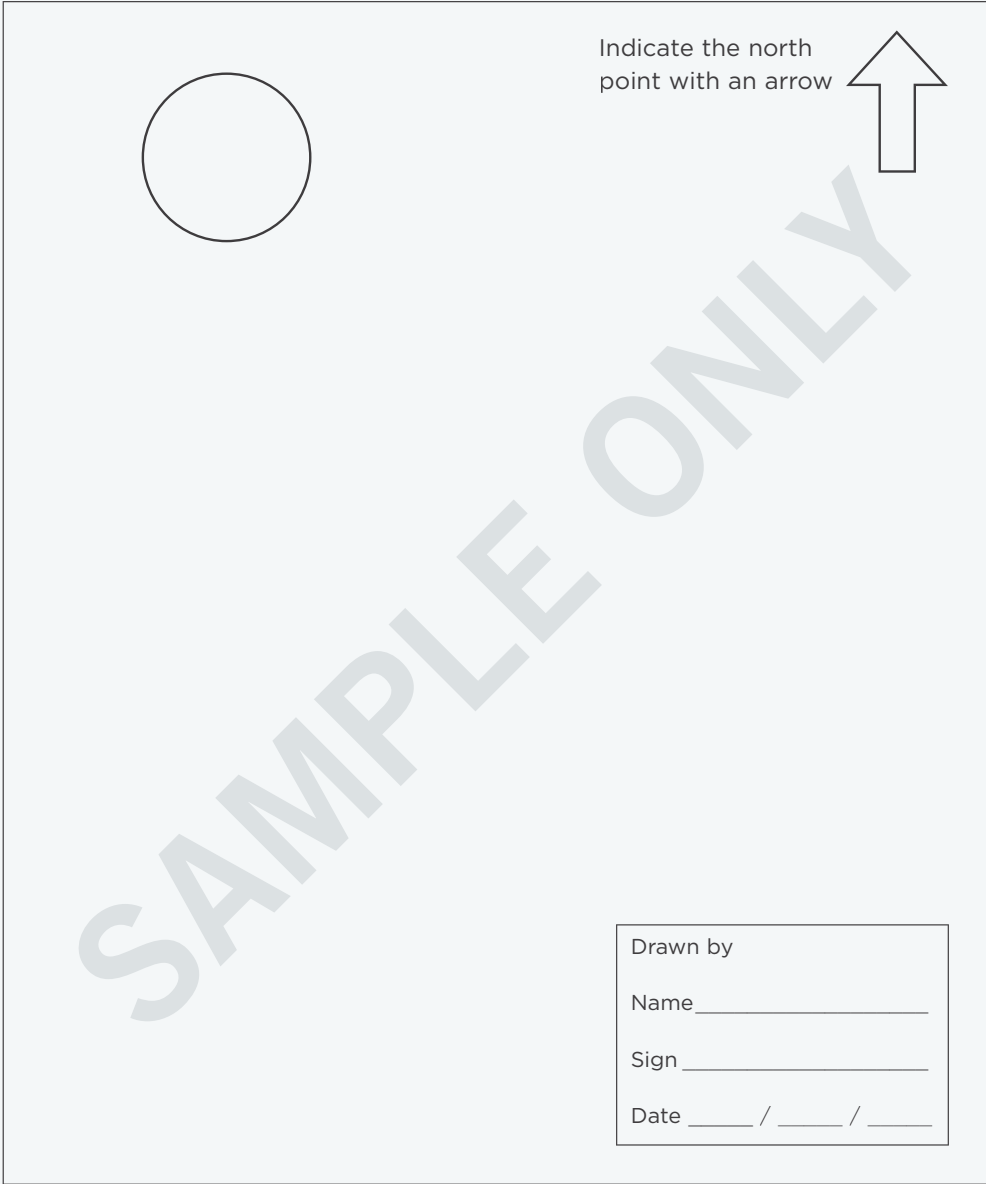

A large rectangular box for drawing a site diagram. Inside the box, there is a circle in the top left corner. In the top right corner, there is text and an arrow pointing upwards. A large, diagonal watermark reading "SAMPLE ONLY" is overlaid across the center of the box. In the bottom right corner of the box, there is a smaller rectangular box containing fields for "Drawn by", "Name", "Sign", and "Date".

Indicate the north point with an arrow

Drawn by

Name _____

Sign _____

Date ____ / ____ / ____

The above sketch should contain the following details:

- street alignments (where applicable)
- lot boundaries (where applicable)
- name of street and suburb
- north point
- nearest cross street
- distances from relevant assets/boundaries
- depth of cover (only if available)
- signature and name (drawn by).

12. APPENDIX B – WORKERS COMPENSATION INSURANCE



Anyone who employs workers, and in some cases engages contractors, must maintain a current workers compensation insurance policy. Penalties apply for failing to have a current policy in place.

All employers have a legal liability to pay workers compensation to workers who are injured in the course of their work, and employers are required by law to hold a workers compensation insurance policy from a licensed SafeWork NSW insurer to cover that liability.

For workers compensation insurance purposes the *Workplace Injury Management and Workers Compensation Act 1998* (the Act) defines a worker, subject to certain specified exceptions, to mean:

A person who has entered into or works under a contract of service or a training contract with an employer (whether by way of manual labour, clerical work or otherwise, and whether the contract is expressed or implied, and whether the contract is oral or in writing).

In addition, the Act deems certain other persons to be workers for workers compensation purposes, eg some types of contractors.

For assistance in clarifying your obligation, contact your insurer or the SafeWork NSW Customer Experience on 13 10 50.

13. APPENDIX C – TYPICAL FOOTWAY ALLOCATIONS FOR UTILITY SERVICES AND DEPTH OF COVER IN ROAD RESERVES


The diagrams in this section have been sourced from the publication entitled *Guide to Codes and Practices for Streets Opening 2007* published by the NSW Streets Opening Conference (SOC). These diagrams are typical examples only, and may not be up-to-date. The current edition of the SOC document should always be consulted prior to undertaking work that impacts on underground services to ensure that the information used is up-to-date.

Source: NSW Streets Opening Conference: *Guide to Codes and Practices for Streets Opening 2007*

For the purpose of this section, note that sewer lines have not been specifically identified.

13.1 NOMINAL DEPTH OF COVER OF UTILITY SERVICES IN ROAD RESERVES

13.1.1 In footways

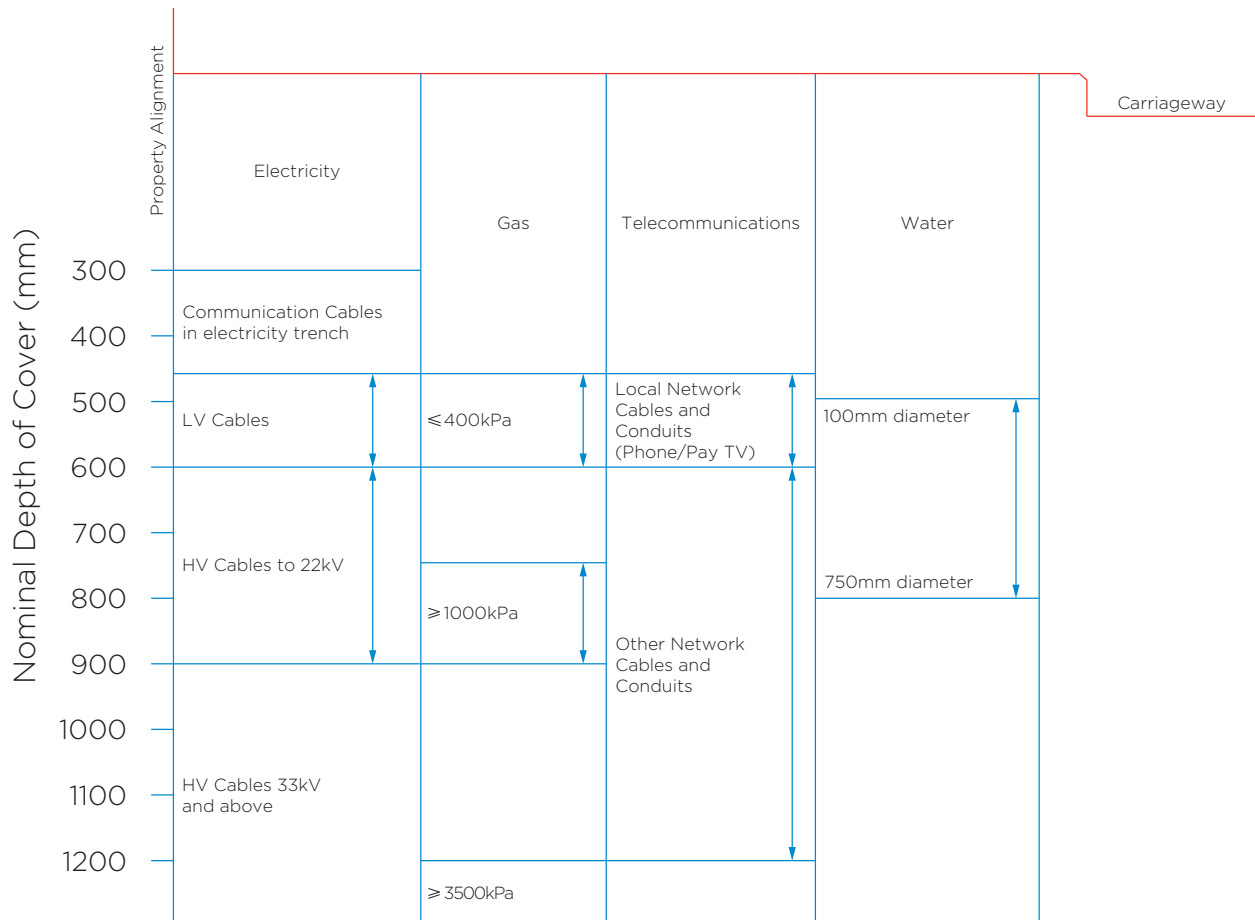

Source: NSW Streets Opening Conference: *Guide to Codes and Practices for Streets Opening 2007*


13.1.2 In carriageways

	Electricity	Gas	Telecommunication	Water
300				
400				
500	Communication Cables in electricity trench		Local Network Cables and Conduits (Phone/Pay TV)	
600				100mm diameter
700	LV Cables	$\leq 400\text{kPa}$		750mm diameter
800	HV Cables to 22kV			
900			Other Network Cables and Conduits	
1000		$\geq 1000\text{kPa}$		
1100	HV Cables 33kV and above			
1200		$\geq 3500\text{kPa}$		

Source: NSW Streets Opening Conference: Guide to Codes and Practices for Streets Opening 2007


13.2 UTILITY/SERVICE PROVIDER ALLOCATION OF SPACE IN FOOTWAYS

13.2.1 Streets dedicated prior to 1 January 1991

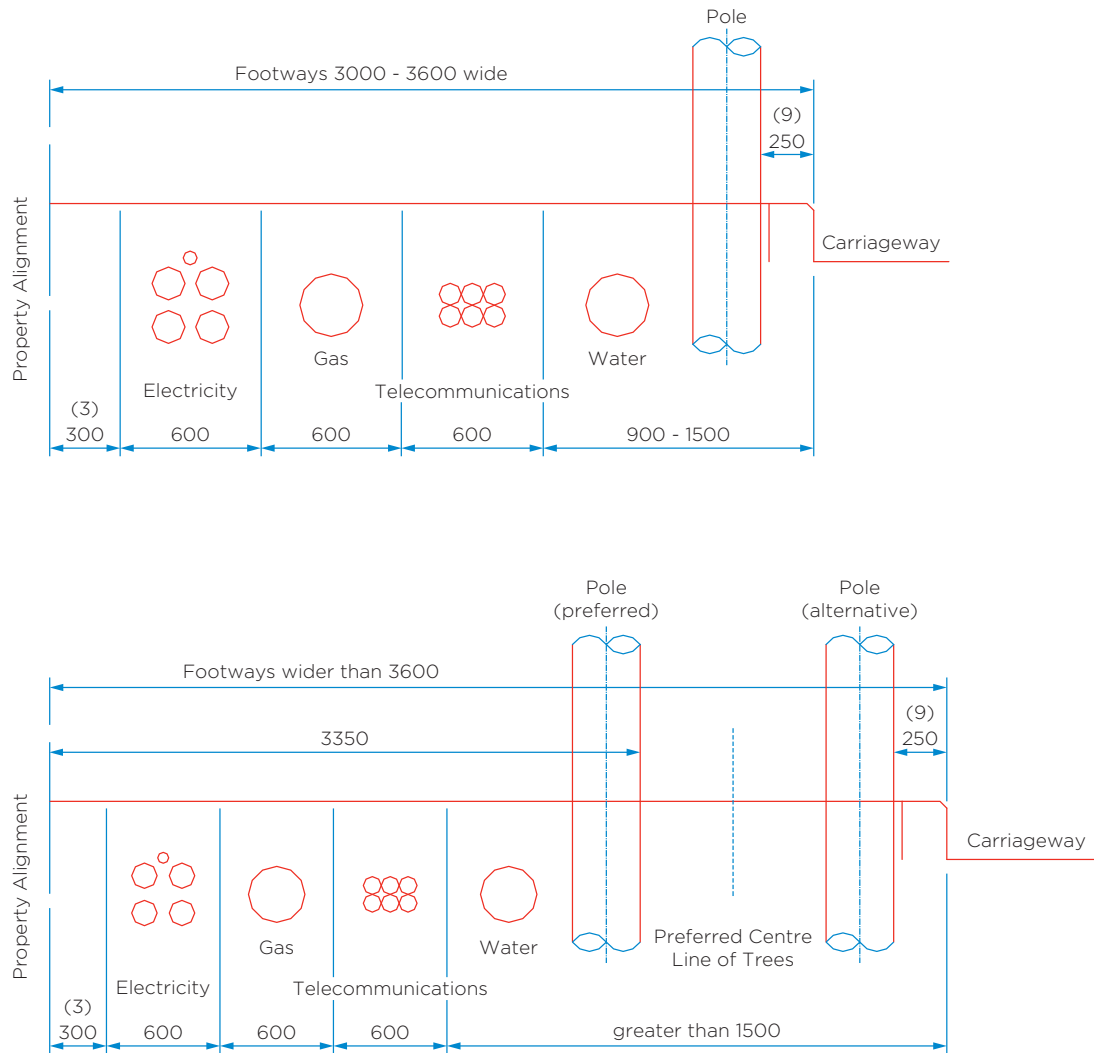

Source: NSW Streets Opening Conference: Guide to Codes and Practices for Streets Opening 2007

13.2.2 Streets dedicated after 1 January 1991

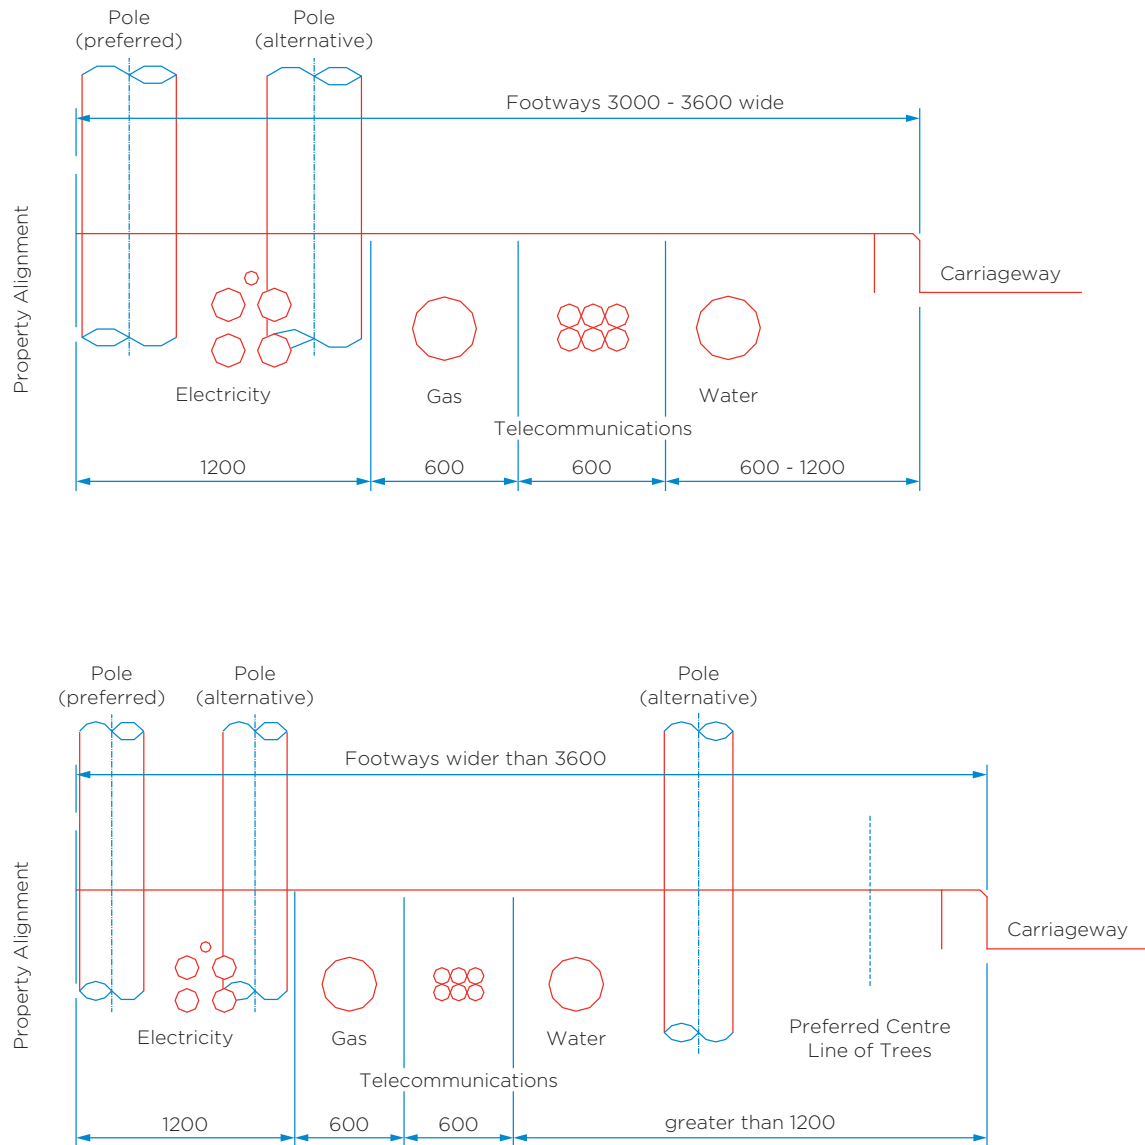

Source: NSW Streets Opening Conference: Guide to Codes and Practices for Streets Opening 2007

Catalogue No. SW08773 0118

ELECTRICAL SAFETY

FOR BUILDING AND
CONSTRUCTION WORKERS

WORKPLACE FACT SHEET

KNOW THE DANGERS

Employees and contractors in the building and construction industry may run the risk of receiving an electric shock and causing substantial damage to plant and equipment when operating plant near overhead power lines or when excavating. This fact sheet has been developed to help you understand why you may be at risk and what you can do to work safely.

THINGS YOU SHOULD DO BEFORE STARTING WORK

- Complete a risk assessment. This should identify hazards (including work practices and procedures) and help you implement appropriate control measures.
- Find out the location of underground and overhead power lines and their proximity to your work activities and transit routes before commencing digging or other activities by phoning **131 081**.
- Know the location of underground and overhead power lines and their proximity to your work activities and transit routes before commencing digging or other activities.
- Dial **1100** or visit **www.1100.com.au** when planning underground work.
- Visually inspect points of attachment, at both ends, before commencing work as gutters and metal roofs may become "alive" due to deteriorating insulation on electrical wiring.
- Use a safety switch to reduce the risk of shock from portable tools.
- Before commencing work, install eye level visual markers in any area where overhead power lines are identified.
- Carefully monitor weather conditions – power lines can sway in the wind, sag as temperatures increase and are difficult to see at dawn and dusk.
- Ensure operators are aware of the height and reach of their machinery in their travel, stowed and working positions to ensure that minimum approach distances to power lines are maintained. For more information refer to *Work Near Overhead Power Lines Code of Practice 2006*, WorkCover NSW.
- Determine electricity asset safety clearances and whether an isolation needs to occur by referring to *Where to draw the line on safety clearances from electricity assets*, available at www.endeavourenergy.com.au
- Ask the occupant if they have experienced any minor electrical shocks from plumbing or appliances.

Call **131 081** and put safety first.
www.endeavourenergy.com.au

Document Set ID: 8875016
Version: 1, Version Date: 02/10/2019



BEFORE YOU DIG

- Apply for Dial Before You Dig plans for each location where you intend to dig.
- Use cable location services and technologies such as Global Positioning Systems (GPS) and Ground Penetrating Radar (GPR) to accurately identify the location of underground utilities.
- Pothole once you reach the applicable approach distance – for more information on approach distances for underground assets refer to *Work Near Underground Assets Guide 2007*, WorkCover NSW.

SAFE WORK HABITS


- Look up and locate overhead power lines and maintain at least the minimum approach distance from them.

Minimum safe approach distances when working near power lines

Workers and their equipment should not approach overhead power lines any closer than the following, when machinery is being operated:

Power lines with voltages up to 132,000 volts	e.g. low voltage distribution and subtransmission lines, usually on poles	3 metres
Between 132,000 and 330,000 volts	e.g. subtransmission and transmission lines, usually on either poles or towers	6 metres
More than 330,000 volts	e.g. transmission lines usually on towers	8 metres

The distance that must be assessed prior to work

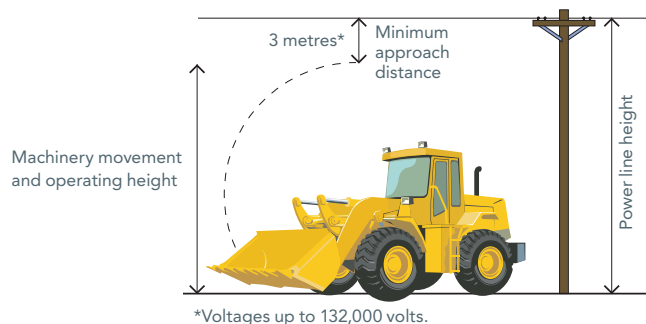

- Remember that WorkCover requires a minimum approach distance of at least three metres from overhead power lines (up to 132,000 volts).
- Exercise extreme caution when working near the point of attachment of the electrical service line to the house/building.
- Look for cables and the signs of underground assets whenever digging, such as changes in grass, depressions or mounds and pipe work.
- Look out for electrical arcs. If identified, do not commence work and contact Endeavour Energy immediately on **131 003**.
- To eliminate the possibility of making contact with power lines on a job site, plan and communicate safe traffic paths by providing diagrams of plant and vehicle travel paths away from overhead power lines.
- Assign a spotter to each operator of high machinery and excavators to guide movements near overhead power lines and underground cables and ensure that minimum approach distances are maintained.

- Before every relocation, lower all machinery into the transport position.
- Use proximity sensor technologies on plant while you dig.

PERMIT TO WORK SYSTEMS

Using a permit to work (PTW) system can be an effective way to be sure preventative measures have been taken before any digging commences. It acts as a checklist that can only enable digging work to commence (usually with supervisor sign off) once all preventative actions have been taken *first*.

A typical permit to work checklist should ask/specify the following:

- 01 Has Dial Before You Dig been undertaken?
- 02 Have cable location services/technologies been used and their results compared with the DBYD plans?
- 03 Have the plans been marked up to reflect any new information/changes?
- 04 Has the safest plant suitable for the job been selected and ordered?
- 05 Has a spotter been allocated to this job to observe hand, mechanical or powered digging?
- 06 Is potholing included in the safe work procedure?
- 07 Has the job been assessed to use non-destructive digging?
- 08 Have overhead power lines been identified as a risk? If so, has this risk been managed as low as reasonably practicable?
- 09 Have all persons who may face/are affected by the risk of hitting underground utilities been consulted/made aware of the safe work procedures?

SAFETY EXCELLENCE

IN EMERGENCIES CALL 131 003

24 hours a day, 7 days a week

If you have any questions about what you should do to stay safe please call 131 081 or visit us at www.endeavourenergy.com.au

Application for the Relocation / Removal of Endeavour Energy's Electrical Network Assets



Application Type: ☐ Relocation ☐ Removal

Please return completed form along with all attachments to: Endeavour Energy, PO Box 811 Seven Hills NSW 1730
Email: cwadmin@endeavourenergy.com.au | Fax: 02 9853 7925 | For connection enquiries, please contact 133 718

Incomplete applications will be returned. The developer is encouraged to approach a Level 3 ASP to obtain preliminary details of the assets and discuss possible solutions to the developer's requirements. The developer must provide as much detail as possible concerning the Endeavour Energy assets that the developer wishes to relocate / remove. **A sketch or plan must be attached.**

Site Details

Street: _____ Suburb / Town: _____
Nearest Cross Streets: _____ UBD Ref: _____
Asset Type: _____ Asset Number: _____

Description of Works (Enter Details)

Developer / Developer's Representative Details

Developer's Name: _____
Developer's Representative (if applicable): _____
Developer / Developer's Representative Reference Number for correspondence: _____
Address for correspondence: _____ Post Code _____
Mobile: _____ Telephone: _____ Fax: _____
Email _____

Developer / Developer's Representative Acknowledgement and Agreement

I acknowledge and agree that:

1. in signing and submitting this application I am requesting an expedited connection;
2. I have read and understood the terms of Endeavour Energy's Model Standing Offer for a Standard Connection Service (Subdivision and Asset Relocation), as published on its website at www.endeavourenergy.com.au, and a connection offer by Endeavour Energy for a Standard Connection Service (Subdivision and Asset Relocation) on the terms of that Model Standing Offer is acceptable to me; and
3. if Endeavour Energy is satisfied that the service requested by me falls within the terms of Endeavour Energy's Model Standing Offer for a Standard Connection Service (Subdivision and Asset Relocation), then I will be taken to have accepted a connection offer by Endeavour Energy on the terms of that Model Standing Offer on the date that Endeavour Energy receives this application.

Developer / Developer's Representative Signature: _____

Date: ____/____/____

* Do you consent to the release of your contact details to other customers with similar works in progress nearby to facilitate co-operation in design and construction activities.

☐ Yes
☐ No

Permission to Remove Service / Metering by Authorised Level 2 Service Provider

(Note:- This form must accompany the NOSW Form)

I/We hereby give permission for -

Authorised **Level 2** Service Provider – (Name)

.....

Authorised Service Provider No.:

Authorised Person No.:

To Remove all Metering Equipment and Service to: -

Address:

.....

.....

Meter No's.:

.....

For the following reason:

.....

.....

.....

Electricity account holder:

Account/NMI No.:

Account holders signature:

If not the same as account holder:-

Property owner / agent:

Signed:

Date:

Has the customer contacted their Retailer to finalise their account

Yes

No

(please tick box)

If NO, the account is to be finalised with the Retailer prior to meters being removed

Technical Review Request



Please return completed form along with all attachments to: Endeavour Energy, PO Box 811 Seven Hills NSW 1730
Email: cwadmin@endeavourenergy.com.au | Fax: 02 9853 7925 | For enquiries about this form, please contact 02 9853 7977

This form can be used for requesting technical assistance to determine preliminary connection requirements prior to lodging a formal application for large or complex developments including master planning for major projects or subdivisions, embedded networks, asset relocations and embedded generator connections.

Site Details

Lot / DP No. ____/____ Street No. ____ Street Name ____
Suburb/Town ____ Postcode ____ UBD Ref ____
Nearest Substation: ____ Pole/Pillar ____ Cross Street ____
Retailer NMI for Existing Sites: ____ (Can be found on your electricity bill)

Retail Customer or Developer Details

Name / Company ____ Contact Person ____
Street No. ____ Street Name ____
PO Box ____ Suburb / Town ____ Post Code ____
Phone ____ Mobile ____ Fax ____
Email: ____

Applicant / Applicant's Representative Details

Name / Company ____ Contact Person ____
Street No. ____ Street Name ____
PO Box ____ Suburb / Town ____ Post Code ____
Phone ____ Mobile ____ Fax ____
Email: ____
Preferred method of contact: ☐ Mail ☐ Phone ☐ Email

Nature of Request

Please Note:

Please provide detailed information describing your development as attachments to support your request including harmonic loads, excessive motor starting or other types of load that may cause quality of supply issues on the network.

The Customer/Developer is the Landowner: ☐ Yes ☐ No
☐ I am authorised by the customer/proponent to make enquiry to Endeavour Energy for this development.

Important Information

As fees associated with normal applications for connection services represent a more cost effective solution, final connection customers are not encouraged to apply for technical reviews unless their projects are staged or of a complex nature, or a review of supply availability is required and application is not possible.

This form is used for both Complex and Simple requests for technical review, which are also called Complex and Simple preliminary enquiries, and must be accompanied, with a cheque made out to Endeavour Energy for the fee amount as shown below. All payments are non-refundable, and are unlikely to substantially reduce other fees associated with submission of applications, as the same information must be reviewed and refreshed in the application phase. The quoted rates below are based on the AER approved fees – Simple Enquiry \$109.835/hr and Complex Enquiry \$260.183/hr including GST.

Complex requests for technical review require input from Network Planners and specialist project management services to determine the voltage of connection and/or the connection point and result in a detailed response. An application for connections services is still required in order to receive a binding offer and proceed to connection.

Common types of complex requests for technical review	Minimum Hours	Excluding GST	Payment Including GST
Master Planning with Transmission	11	\$2601.83	\$2862.01
Master Planning without Transmission	9	\$2128.77	\$2341.64
Subdivision up to 300 lots	5	\$1182.65	\$1300.91
Connection of Load at LV	5	\$1182.65	\$1300.91
Asset Relocations without Transmission	5	\$1182.65	\$1300.91

Simple requests for technical review are basic reviews of existing data systems in order to provide a summary response. An application for connection services is still required, in order to receive a binding offer and proceed to connection.

Types of Simple requests for technical review	Minimum Hours	Excluding GST	Payment Including GST
All simple	1	\$99.85	\$109.835

Use of Fencing for security and the reduction of visual impact of a Padmount substation:

- Appropriate screening made of metal, timber, plastic or masonry fencing is allowable outside the easement.
- No sail clothes, covers or tarps of any kind are allowable in the easement.
- Carport posts, metallic clothes hoists poles or posts cannot be located inside the padmount substation easement area nor encroach into it.
- Dial before You Dig (DBYD) service plans are required prior to any property excavation. Contact **1100**. Note: DBYD service plans do not indicate underground electrical service mains.
- Ground excavation must be done manually or by a toothless mechanical scraping device within the easement with an approved safety observer at all times.
- Easement dimensions must not be reduced by any structures e.g. fences, retaining walls, brick walls, terrace work or vegetation etc.
- Ongoing clear entry and exit access around the substation easement area is paramount for Work Health & Safety (WH&S) requirements.
- No trees, shrubs or bushes nor planter boxes or pot plants or decorative features are allowed in the easement.
- No slip or trip hazards allowed in the easement. Tree stumps must be cut to ground level or below.
- Ventilation is required around and through the base of the substation.
- No placing of Council bins or stock piling of any materials is allowed in the easement.
- If the substation is fenced out or gated, ongoing maintenance of the easement area is still the responsibility of the owner of the property.
- If the substation is enclosed and gated and locked, it must open outwards towards the street, and have an Endeavour Energy locking system installed for 24hr 7days access. Contact Integrity locking on **1300 366 488** for assistance.
- Endeavour Energy will provide the appropriate reflective signage for the asset when contacted.

NOTE: The easement must be maintained on a regular basis for work health and safety WH&S regulations. The following suggestions are provided to property owners who may find it onerous to maintain the easement on a regular basis. The property owner may install the following within the easement at their cost:

- Remove or spray all vegetation with a non-toxic grass and weed deterrent;
- Remove all foreign objects leaving the easement in an approved and level state;
- Form up the easement perimeter with treated timber minimum 75-100mm deep;
- Followed with the laying of a suitable porous weed mat; and
- Then covering the easement with 20mm min. size blue metal or coloured stones, wood bark/chips, asphalt or install pavers that are easily lifted. Alternately, lay lawn and maintain periodically.

The above suggestions, if employed correctly, will require less ongoing maintenance ensuring a clear firm footing for staff to carry out electrical maintenance or emergency works. This will also ensure an approved aesthetic state for your local community.

Retaining Walls

The final height of a retaining wall should comply with the Local Council and not exceed 1m.

The finished ground surface of the uphill of the retaining wall should batter down and finish below the top of the wall's capping to mitigate direct water flow into the substation easement.

The finished wall should be completely constructed in the same type of brick or concrete blocks / material for safety as well as aesthetic reasons.

The finished wall should not trap or promote pooling of water in the easement.

The wall should comply with all relevant building and council codes e.g. drainage material inclusion behind the retaining wall to include min. 100mm ag-line, aggregate and geo tech fabric.


The side walls can be extended minimally in order to accommodate a raised surrounding ground level.

Any future wall extension would need to be properly footed.

Dial before You Dig (DBYD) service plans are required before excavating for retaining wall footings and fence posts. Contact DBYD on 1100 for assistance.

Retaining walls must be constructed outside of and not encroach the electricity easement.

Easement and Restriction Sites for Padmount Substations - Common Earthing, Residential -

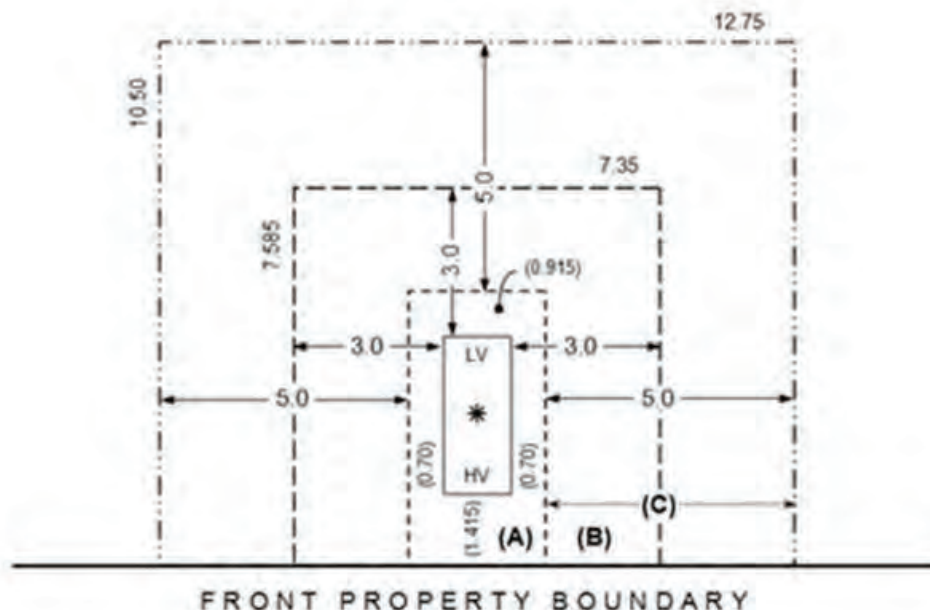

- No building must be erected or permitted to remain within the restriction site marked (B) unless:
 - the external surface of the building erected within 1.5 metres from the substation footing has a 120/120/120 fire rating; and
 - the external surface of the building erected between 1.5 metres and 3.0 metres from the substation footing has a 60/60/60 fire rating; and
 - the owner provides Endeavour Energy with an engineer's certificate to this effect.
- No swimming pool or spa must be erected or permitted to remain within the restriction site marked (C).

The foregoing easement and restrictions apply to a padmount substation with a common earth system where the high voltage and low voltage equipment, the local neutral and other metallic parts are electrically bonded together and connected to one earth grid. Common earthing must be used where a new earthing installation is being established and interconnected to 5 or more other substations through the neutral conductor. If the conditions for a common earthing system cannot be achieved economically eg. in non-urban areas, then two separate and distinct earthing systems, one for the high voltage and the other for low voltage must be used. Substation separate earthing changes the dimensions of the restriction sites.

- No fencing must be erected or permitted to remain within 4 metres from the substation footing.
- No swimming pool or spa must be erected or permitted to remain within 30 metres from the substation footing.

For further details refer to Endeavour Energy's Mains Design Instruction Document No: MDI 0044 'Easements and Property Tenure' or contact Endeavour Energy's Head Office enquiries on telephone: 133 718 or (02) 9853 6666 from 8am - 5:30pm.

Mains Design Instruction

Easements and Property Tenure

IMPORTANT DISCLAIMER

As the information contained in this publication is subject to change from time to time, Endeavour Energy gives no warranty that the information is correct or complete or is a definitive statement of procedures. Endeavour Energy reserves the right to vary the content of this publication as and when required. You must make independent inquiries to satisfy yourself as to correctness and currency of the content. Endeavour Energy expressly disclaims all and any liability to any persons whatsoever in respect of anything done or not done by any such person in reliance, whether in whole or in part, on this document.

Copyright © Endeavour Energy 2017

MAINS DESIGN INSTRUCTION

ASSET STANDARDS & DESIGN	Document No Amendment No Approved By Approval Date	MDI 0044 1 GMAM 06/03/2017
-------------------------------------	---	-------------------------------------

MDI 0044 – Easements and Property Tenure

CONTENTS

1.0	PURPOSE	5
2.0	SCOPE	5
3.0	REFERENCES	5
4.0	DEFINITIONS AND ABBREVIATIONS	6
4.1	Abbreviations	6
4.2	Definitions	6
5.0	ACTIONS	7
5.1	General Requirements	7
5.2	Management process of easements	8
5.3	Minimum easement widths	9
5.3.1	<i>Minimum easement required for overhead lines</i>	9
5.3.2	<i>Minimum easement required for network assets</i>	10
5.3.3	<i>Parallel overhead feeders</i>	11
5.3.4	<i>Request for dispensation to the minimum easement width</i>	12
5.3.5	<i>Indoor substations</i>	12
5.3.6	<i>Padmount substations and switching stations</i>	12
5.4	Assets within special areas	12
5.4.1	<i>Assets within the road verge</i>	12
5.4.2	<i>Assets within roadways</i>	13
5.4.3	<i>Overhead lines crossing private property</i>	13
5.4.4	<i>Easement over Railway Corridor land</i>	13
5.4.5	<i>Easements over National Park Land</i>	14
5.4.6	<i>Easements over Forestry Land</i>	14
5.4.7	<i>Easements in water catchment areas</i>	14
5.4.8	<i>Community Title developments</i>	14
5.5	Easement creation	15
5.6	Easement terms	15

5.7	Other types of Property Tenure	15
5.8	Modifying assets with an easement	16
5.9	Easement release.....	16
5.10	Easement height	16
5.11	Rights granted by the Electricity Supply Act.....	17
5.11.1	<i>Protection of assets installed before May 2006</i>	17
5.11.2	<i>General protection of network assets</i>	17
5.12	Works on assets without a registered easement.....	17
5.13	General requirements on encroachment management.....	18
5.14	Encroachments on overhead line easements.....	19
5.14.1	<i>Minimum safety requirements for overhead line easements</i>	19
5.14.2	<i>Prohibited activities / encroachments</i>	20
5.14.3	<i>Permitted activities / encroachments</i>	20
5.14.4	<i>Controlled activities / encroachments</i>	20
5.15	Encroachments on underground easements	26
5.15.1	<i>General information for underground asset easements</i>	26
5.15.2	<i>Minimum safety requirements for underground asset easements.....</i>	26
5.15.3	<i>Prohibited activities / encroachments</i>	26
5.15.4	<i>Permitted activities / encroachments</i>	27
5.15.5	<i>Controlled activities / encroachments</i>	27
5.16	Encroachments on Padmount Substation or Switching Station easements	29
5.16.1	<i>General information for padmount substation easements.....</i>	29
5.16.2	<i>Minimum safety requirements for padmount substation easements</i>	29
5.16.3	<i>Prohibited activities / encroachments</i>	30
5.16.4	<i>Permitted activities / encroachments</i>	30
5.16.5	<i>Controlled activities / encroachments</i>	30
5.17	Transfer earth hazards	31
5.18	Encroachment management process.....	32
5.18.1	<i>Existing encroachment management process.....</i>	32
5.18.2	<i>Applications for controlled encroachments</i>	33
5.19	Access and Rights of Way	34
5.19.1	<i>Locking arrangements for shared access gates</i>	34
5.20	Recording of easements in GIS	35
5.21	Drawings	35
6.0	AUTHORITIES AND RESPONSIBILITIES.....	36
7.0	DOCUMENT CONTROL	36
Annexure 1	STANDARD EASEMENT TERMS	37

Annexure 2	Terms of Restrictions on the Use of Land	41
Annexure 3	COMMUNITY TITLE BY-LAWS	46
Annexure 4	Typical easement layouts	47
	A4.1 - Underground assets	47
	A4.2 – UGOH and Stay pole easements	48
	A4.3 - Padmount easements and clearances	49
Annexure 5 –	Encroachment reference guide	51

1.0 PURPOSE

To set out Endeavour Energy's design requirements for new easements, other property tenure requirements, and the management of existing easements.

2.0 SCOPE

This instruction covers:

- The rights Endeavour Energy has within its own easements;
- The determination of the minimum easement size for an asset;
- Process for acquiring, modifying and removing easements;
- The definition of controls for the safe operation of activities within easements; and,
- The definition of activities which are prohibited within easements.

The instruction does not cover:

- The release process of easements, which is covered in Company Policy 9.2.4.
- The process for managing existing encroachments, which is defined in Company Procedure GAM 0098.

3.0 REFERENCES

Internal

- Company Policy 9.2.3 – Property Tenure for Network Assets
- Company Policy 9.2.4 – Network Easement Release
- Company Procedure GAM 0098 – Management of Existing Encroachments
- Company Procedure GAM 0114 – Granting Dispensation for Engineering Documents
- Environmental Management Standard EMS 0006 - Maintenance and construction of access tracks
- Mains Construction Instruction MCI 0006 – Underground distribution construction standard
- Mains Design Instruction MDI 0028 – Underground distribution design
- Mains Design Instruction MDI 0031 – Overhead distribution: Design standards manual
- Mains Design Instruction MDI 0047 – Overhead transmission design
- Substation Design Instruction SDI 100 – Distribution Earthing Design, Construct and Test
- Endeavour Energy General Terms & Conditions for Connection of Public Lighting Assets (March 2011)
- Network Management Plan November 2013

External

- *Electricity Supply Act 1995**
- *Roads Act 1993**
- *Land Acquisition (Just Terms Compensation) Act 1991**
- *Conveyancing Act 1919**
- State Environmental Planning Policy (Infrastructure) 2007
- ISSC 20 - Guidelines for the Management of Activities within Electricity Easements and close to Electricity Infrastructure (April. 2012)
- ENA National Electricity Network Safety Code (Doc 001-2008)

- AS / NZS 7000:2016 Overhead Line Design – Detailed procedures
- AS / NZS 4853:2012 – Electrical hazards on metallic pipelines

* - Act current as of 19/02/2016

4.0 DEFINITIONS AND ABBREVIATIONS

4.1 Abbreviations

EPR

Earth Potential Rise

HV

High voltage

LV

Low voltage

LPI

Land and Property Information

4.2 Definitions

Easement

An easement is an encumbrance on the title of land (which may be limited in width and height above or below the land) conferring a right to inspect, construct, operate, maintain, repair, renew, replace or upgrade electrical infrastructure.

Positive Covenant

A type of property tenure that requires expenditure by the land owner is required to meet the terms of the covenant.

Property tenure

A broad term covering the rights of the company to carry out network operations within land not owned by the company – exercising statutory rights in accordance with relevant legal requirements and the creation of appropriate recognised property rights. Typical property tenure include easements, Restrictions on Use, Positive Covenant and long term leases.

Public road

Defined under the Roads Act 1993. A road usually includes a vehicle carriageway and associated footpath areas on each side of the carriageway.

Restrictions on use of land

Conditions imposed on the use of the land, to inform the landowner and put limitations on the use of land due to the risk that exists by the electrical asset being located within the burdened lot.

5.0 ACTIONS

5.1 General Requirements

This standard covers two aspects of easement (and other types of property tenure) management:

- The design requirements relating to easements – easement size, creation, modification and release, rights of way and community titles.
- The management of existing easements – encroachments, transfer hazards and rights granted by the Electricity Supply Act 1995.

The general philosophy behind Endeavour Energy's approach to design and management of easements is to secure both the safe operation of the electrical network and, the safety of its employees, contractors and the public. Where a design, activity or proposal could compromise the electrical network or put an employee or the public at risk, the Electricity Supply Act 1995 allows Endeavour Energy to restrict and/or prohibit the activity. Refer to Clause 5.11 for further details.

All Endeavour Energy easements must comply with the requirements of this document, which is based on ISSC 20 "Guidelines for the Management of Activities within Electricity Easements and close to Electricity Infrastructure". However, where this standard and ISSC 20 differ, this standard will take precedence.

All new/proposed transmission and distribution infrastructure, which is not constructed on public roads, an easement in favour of Endeavour Energy must be created in accordance with the requirements of this standard.

5.2 Management process of easements

The following flowchart details the management process for easements.

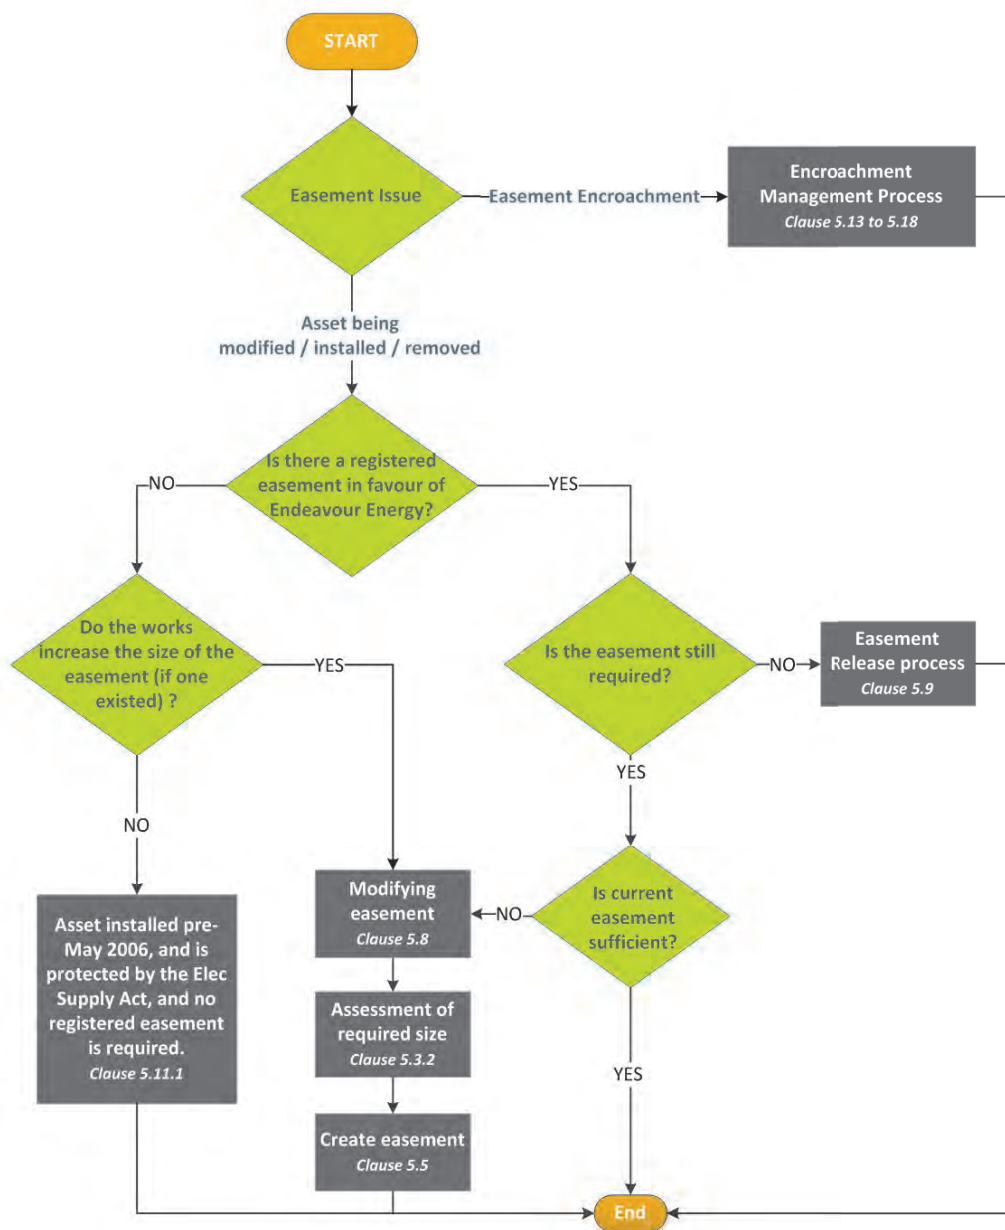


Figure 1 - Easement Management Flowchart

5.3 Minimum easement widths

The minimum easement widths are specified in Table 1. Larger easements may be specified and/or required on a project by project basis. All designs must certify that the easement widths in Table 1 are suitable for the span lengths / conductors used in the design.

5.3.1 Minimum easement required for overhead lines

For overhead lines, the minimum easement width for each span must be the greater width of the following three criteria:

- The width of the structure plus, two (2) times the sum of:
 - Conductor blowout, including insulator swing where applicable, (at 50°C and 500 Pa wind pressure); and,
 - The appropriate clearance from Table 3.7 of AS/NZS 7000 (Refer to Figure 2)
- Minimum maintenance requirements for the type of construction.
- The easement widths specified in Table 1.

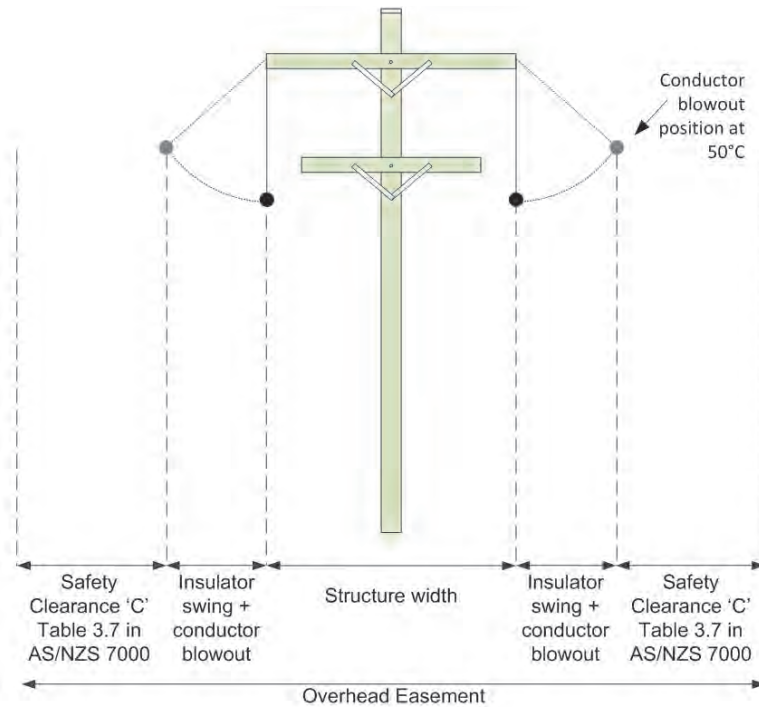


Figure 2 - Minimum overhead easement

New overhead assets must be fully contained within an easement (or other types of property tenure) and not encroach adjoining properties. Existing lines encroaching a property (without a formal easement) are permitted to remain, and may be replaced or uprated, as long as there is no increase in this encroachment. Refer to Figure 5.

5.3.2 Minimum easement required for network assets

The table below details the minimum easement widths for various network assets. Refer to Annexure 4 for graphical representation for a cable joint system; pole stay and padmount clearances.

Table 1 - Minimum easement widths

	Voltage	Asset Type	Construction	Minimum Easement (m)
Overhead Assets	400V–22kV	Bare Construction	All	9
		ABC		
		CCT		
	33kV / 66kV	Bare conductor (see Note 2)	Line post insulators	18
			33kV Suspension Insulators	18
			66kV Suspension Insulators	25
			H pole Structures	30
	132kV	Bare conductor (see Note 2)	Line post insulators	25
			H pole Structures	30
			Steel tower	30
Underground Assets	400V - 22kV	Cables	Underbore / Ducted / Direct buried	3
			Ducted < 100m and with concrete protection (min 50 mm concrete cover at standard burial depth)	1
	33kV - 132kV	Cables (single feeder only)	Ducted / Direct buried	5
			Cable Pits / Joint Bays	6
	-	Communications cables	Ducted / Direct Buried	1
		Earthing conductors		1
		Bonding leads		1
		Link Box / Comms Pit		2.0 x 2.0
Other	-	Streetlight Column / Service Pillar	-	1.0 x 1.0
		Switching Station		2.75 x 2.75 (see clause 5.3.6)
		Padmount Substation		2.75 x 5.5 (see clause 5.3.6)
		Auto Transformer		See clause 5.3.5
		Indoor Substation		See clause 5.3.5
		Pole stays / Ground stays		See Note 2
	Rights of Access	Vehicle access tracks easement in rural areas (see Note 3)	-	5
		Vehicle access in urban areas		5 (see Note 5)
		Pedestrian access only		1.2

Notes:

1. All Network assets, except for padmounts / switching stations, must be positioned in the centre of the easement. Refer to Drawings 016665 and 282551 for easement details of padmounts and switching stations. For non-symmetrical assets, such as post insulators, the centre must be measured from the position of the conductors at rest.
2. The easement for a termination pole/structure or for an aerial / ground stay must extend at least half the easement width beyond the last network pole or stay.
3. For further details regarding the construction and maintenance requirements of access tracks, refer to EMS 0006.
4. For an overhead line which its operating voltage differs from its constructed voltage, the easement must be for the constructed voltage.
5. Applies to straight line of access only. If angles or bends are required in the access path, then width to be determined by assessing a truck turning diagram, and gaining approval from the relevant Endeavour Energy Operations Manager. .

5.3.3 Parallel overhead feeders

When considering overhead lines installed in parallel, an optimised easement width may be determined in accordance with the following principles:

- It is not necessary to consider the lines blowing toward each other with the maximum wind load. Instead consider the line with the larger sag blowing under maximum wind load toward the other line in its vertical position.
- Allowance must be given for physical movement of the line (conductors and insulators swinging), as well as electrical clearances and climbing corridors.
- Minimum horizontal separation between the two centrelines of the two feeders must be no less than 10m.

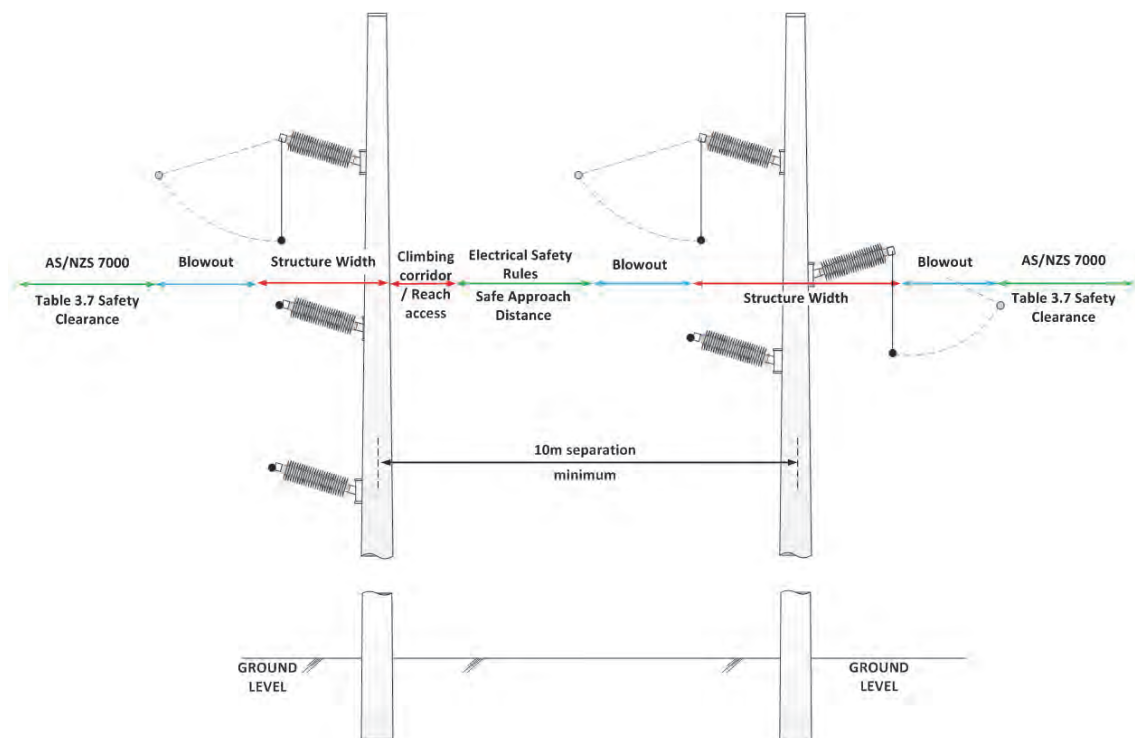


Figure 3 – Easement requirements for parallel feeders
(Structure on the right assumed to have the greatest conductor blowout)

5.3.4 Request for dispensation to the minimum easement width

A request for dispensation must be made to Endeavour Energy's Mains Assets Manager for any proposed easement that is smaller than the stated minimum width listed in Table 1. The submission must show there is no reduction in access for maintenance purposes and that the easement provides adequate electrical clearance to any existing and/or planned structures that may be built adjacent to the easement.

All designs must consider the following factors when determining an easement width:

- Electrical safety clearance
- Insulator and conductor blowout
- Access for maintenance, repair and upgrading
- Future requirement for additional feeder(s)
- Public safety based on potential earth potential rise (EPR) and electromagnetic field (EMF) issues
- Radio and television interference
- Audible noise
- Cable duct / jointing bay requirements

5.3.5 Indoor substations

The boundaries of an easement for indoor substation must be defined by the internal face of the walls, ceiling, floor, and cable trenches of the substation room.

An easement for the cables that enter and exit the substation room will also be required if they are not installed within public roads and/or existing Endeavour Energy easements.

A right of access may also be required to give Endeavour Energy employees, vehicles, and equipment unrestricted access to the indoor substation at all times.

5.3.6 Padmount substations and switching stations

The easement size for a padmount substation must be increased when a retaining wall or safety bollard has been installed/built to protect a padmount substation from vehicle impact, as indicated in Figure 4.

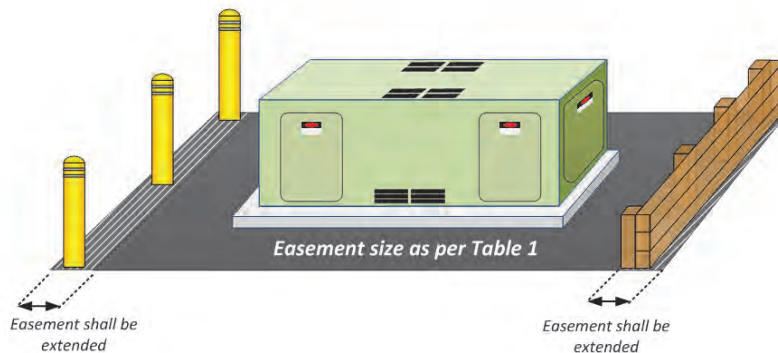


Figure 4 - Easements to include retaining wall or safety bollard

5.4 Assets within special areas

5.4.1 Assets within the road verge

Assets installed within a road carriageway cannot be provided with an easement. However, overhead assets proposed to be installed within the road verge still require the clearances specified in Table 1 and Clause 5.3.1.

As a minimum, the separation between the power line and the property line, must be the conductor blowout (at 50°C and 500 Pa wind pressure) and Safety Clearance 'C' from Table 3.7 of AS/NZS 7000.

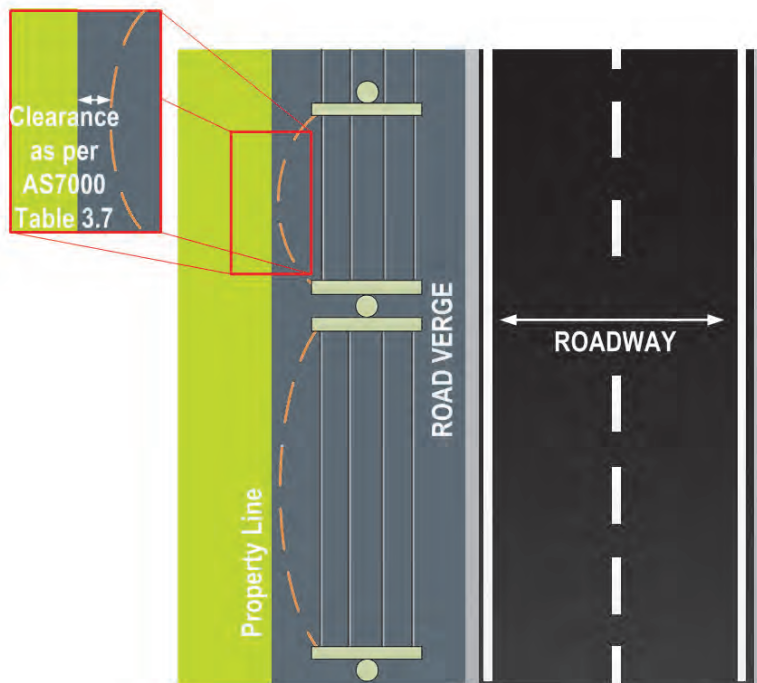


Figure 5 - Roadway requirements

5.4.2 Assets within roadways

Assets installed within a public road (as defined in the *Roads Act 1993*) requires the consent of the appropriate road authority to be obtained prior to the construction of any electrical works. Neither the *Roads Act 1993* or the *Electricity Supply Act 1995* requires an easement within public roads.

5.4.3 Overhead lines crossing private property

Where Endeavour Energy overhead lines cross private property, the line must be protected by a registered easement. The minimum width of this easement must be in accordance with the requirements in Clause 5.3.1 and 5.3.2.

5.4.4 Easement over Railway Corridor land

In 2002, Endeavour Energy entered into a *Master Access Deed* with Transport for NSW (then Railcorp), covering all new and existing Endeavour Energy network assets located within any rail corridor. This deed defines a rail corridor as any land owned by Transport for NSW. Network assets located within a rail corridor under the provisions of the *Master Access Deed* do not require easements.

Transport for NSW may also permit developers to install network assets in a rail corridor under an *Individual Access Deed* or *Deed of Release and Indemnity*. Any deed between the developer and Transport for NSW, will need to provide the same minimum requirements as those under the Master Access Deed and be transferable to Endeavour Energy for any new network assets installed by the developer.

Transport for NSW's process for third party works within the rail corridor is documented on its website, which includes the application form. Applications for rail corridor access must be submitted to the Rail Corridor Management Group in Sydney.

The ARTC website must be consulted for contact information regarding proposed rail corridor access.

5.4.5 *Easements over National Park Land*

Land dedicated as a wilderness area, national park, state recreation area, regional park, or nature reserve is managed by the NSW Office of Environment & Heritage.

Endeavour Energy is usually required to enter into a Formal Deed of Easement under Section 153 of the National Parks & Wildlife Act 1974 whereby compensation or an annual rent may be payable. The minimum easement dimensions given in Table 1 still apply, however, specific requirements will need to be negotiated with NSW Office of Environment & Heritage.

5.4.6 *Easements over Forestry Land*

Land dedicated as state forest is managed by Forests NSW/Department of Primary Industries and may be subject to native title.

Forests NSW will grant a limited form of property tenure under an Occupation Permit and an annual rent may be payable. The minimum easement dimensions given in Table 1 still apply, however, specific requirements will need to be negotiated with Forests NSW.

5.4.7 *Easements in water catchment areas*

Land that is classed as a water catchment area by the Sydney Catchment Authority, the standard easement terms do not always apply fully. The minimum easement dimensions given in Table 1 still apply, however, specific requirements will need to be negotiated with Sydney Catchment Authority.

5.4.8 *Community Title developments*

5.4.8.1 *Asset ownership*

The ownership of electrical assets (both HV and LV) within a community title development will only be accepted (owned and maintained) by Endeavour Energy if they are installed in accordance with Endeavour Energy's standard requirements and installation practices.

Endeavour Energy will generally own and maintain all high voltage electrical equipment within the development.

Endeavour Energy or the Community Title Association may own and maintain the low voltage electrical equipment and/or street lighting network.

Annexure 3 outlines the relevant by-laws that must be incorporated into the Community Title Management Plans to define the ownership and access requirements for the electricity assets within the development.

Community title developments and their management associations or developers are not considered to be public lighting customers under the NSW Public Lighting Code and therefore must meet the requirements stated in Endeavour Energy's *"General Terms and Conditions for Connection of Public Lighting Assets"*.

5.4.8.2 *Asset construction*

For all assets the installation must provide the same level of security and access as normally would be found in standard urban residential development, this includes:

- All cables / spare conduits being located in the standard allocation within the road verge

- All pillars, padmount substations and switching stations are located in acceptable areas as stated in MDI 0028.
- No other assets and/or utilities being installed directly above the electrical assets
- Minimum distances between electrical assets and other utility services being maintained
- Sufficient access for Endeavour Energy vehicles (including trucks and EWP's) to access and maintain the assets without the need to close and/or block private roads.

5.4.8.3 Easements within Community Title developments

All assets owned by Endeavour Energy within a Community Title development and not installed within a public road, are to be provided with an easement to allow for future maintenance and repair.

For assets other than underground cables, the minimum easement widths defined in Table 1 must be achieved. However, the minimum easement widths for underground cables defined in Table 1, do not apply to Community Title developments. An easement the size of the trench width plus 500mm either side must be achieved as a minimum,

All easements must be created under a Section 88B of the Conveyancing Act 1919.

5.5 Easement creation

Easements must be created in favour of Endeavour Energy and can be created by one of the following three methods:

- Creation by Section 88B of the Conveyancing Act;
- Creation by Deed or transfer granting easement; and,
- Creation by compulsory process.

The easement must be defined on a plan, and registered at LPI.

A restrictive or positive covenant cannot be compulsory acquired.

5.6 Easement terms

The easement terms defines the rights and restrictions for an easement for Endeavour Energy and the landowner. The terms of an easement must be defined to the landowner in writing. Annexure 1 contains the standard easement terms for Endeavour Energy's:

- Overhead Lines, Underground Cables, Padmounts, Switching Stations and streetlighting;
- Indoor Substations; and,
- Rights of Access.

There may be additional rights and restrictions required for certain easements so that Endeavour Energy interests are protected.

An owner may have specific site requirements that require amendment to the standard terms. The details of any proposed amendment are to be submitted to Endeavour Energy's Mains Assets Manager for review prior to certification of the design for approval.

5.7 Other types of Property Tenure

Restrictions on the use of land are sought by Endeavour Energy on land on which its infrastructure exists to protect the integrity and security of its network, whilst still allowing the landowner to own and make use of their land.

A positive covenant is sought when Endeavour Energy will allow activities on the site but only with additional controls. An example of a positive covenant is requiring the installation of fire proof screen walls near Endeavour Energy's electrical assets.

In situations where Endeavour Energy requires covenants to be provided around electrical equipment / assets, the following standards terms defined in Annexure 3 must be used.

5.8 Modifying assets with an easement

Where an existing asset (post May 2006) is to be replaced/upgraded/modified, and there will be an increase to the existing easement size, then the designer must go through the process of applying for a new easement.

An easement may be reduced in size if:

- The easement meets the minimum size requirements as detailed in Table 1;
- If approval is sought and granted from Capacity Planning Manager, and the corresponding Regional Transmission/Distribution Manager.
- A design for the existing line demonstrating the asset will have sufficient access and clearance.

5.9 Easement release

Easements may be released if the need arises and the easement has no / limited benefit to Endeavour Energy. Easements releases must be managed in accordance with Company Policy 9.2.4.

5.10 Easement height

Easements do not have a specified height to which they apply. Endeavour Energy does not allow assets to be installed above its assets, as this presents access, safety and reliability risks. Where all other options have been exhausted, a dispensation must be submitted as described in Company Procedure GAM 0114.

5.11 Rights granted by the Electricity Supply Act

5.11.1 Protection of assets installed before May 2006

Section 53 of the Electricity Supply Act 1995, protects Endeavour Energy infrastructure that was constructed prior to the commencement of the *Electricity Supply Amendment (Protection of Electricity Works) Act 2006* (26th May 2006), from action from the owner of the land in which Endeavour Energy infrastructure exists.

Endeavour Energy may maintain, operate, repair, replace or upgrade the infrastructure despite whether a registered easement exists. However, this protection does not exist for new assets which are constructed on private land after the 26th of May 2006, and as such, easements must be acquired for new assets.

5.11.2 General protection of network assets

The following summarises the powers Section 49 and 49A of the Electricity Supply Act 1995, grants Endeavour Energy:

Section 49 – Endeavour Energy may serve a written notice to a person who has control of a structure, which may interfere, destroy or damage Endeavour Energy's network to remove the imposing structure. This is regardless if the person owns the land on which Endeavour Energy's asset exists.

Section 49A - Endeavour Energy may serve a written notice to a person who is carrying out excavation work in, on or near its network which may destroy or damage Endeavour Energy's network to cease work immediately.

5.12 Works on assets without a registered easement

Endeavour Energy is legally required to provide a safe and reliable network. As such, where the need arises where a network asset is required to be modified or replaced, and does not have the benefit of an easement (installed before May 2006), Endeavour Energy will evaluate all possible options in the refurbishment/replacement of the asset.

In assessing the upgrade of the asset the following factors will be considered:

- If there will be an increase in the required size of the easement;
- Is it a like-for-like replacement.
- The impact on the customer and the aesthetic nature of the new asset;
- The risk to the customer, to the public or to Endeavour Energy employees of the current installation;
- The preference of the customer;
- The required access to maintain and install the new asset.

Where the evaluation has concluded that the asset needs to be replaced/modified, Endeavour Energy reserves the right to do so. However, where the rectification works will increase the size of the required easement width, an easement must be created for the rebuilt asset.

5.13 General requirements on encroachment management

For easements managed by Endeavour Energy, encroachments fall into three (3) categories – *permitted*, *prohibited* or *controlled*.

- Permitted activity – An activity which is allowed within an easement, but must still adhere to the minimum safety requirements within the easement.
- Prohibited activity – An activity that must not be performed under any circumstance within the easement.
- Controlled activity – An activity which is allowed only if it meets both the minimum safety requirements for that type of easement with additional controls which are specified in the appropriate clause detailed below. Approval from Endeavour Energy is required for any controlled activity.

The main principle behind these categories is to maintain a high level of safety of the public and Endeavour Energy employees, whilst also allowing Endeavour Energy to inspect, operate, maintain, access and upgrade its network.

The activities listed below are not exhaustive, and where an activity/encroachment is not covered, a request to Mains Assets Manager must be submitted, which is to include:

- a full risk assessment detailing the risk to the network and safety and suitable controls.
- an overview of the easement, all current and proposed Endeavour Energy assets as well as all current and proposed encroachments

Refer to Annexure 5 for the current list of identified encroachments, how Endeavour Energy manages these, and the applicable clauses.

Encroachments on assets which do not have a formal easement, must be treated as though an easement does exist as per clause 5.11, and how the applicable encroachment is handled in the following sections. Table 1 may be used as an indication as to the applicable easement width, however, an assessment of the minimum easement size required to maintain access and safe operation of the asset is required.

5.14 Encroachments on overhead line easements

5.14.1 Minimum safety requirements for overhead line easements

For an overhead line easement, the following criteria must always be met, to maintain the safe operation of the network and employees:

- Minimum ground clearances, as defined in MDI 0031 and MDI 0047 are maintained, when the conductor is operating at maximum design temperature;
- Sufficient clearance is maintained to accommodation for overhead line blowout (500Pa, with the conductor operating at 50°C);
- Minimum separation clearances between the network and objects/structures are maintained to this standard and AS/NZS 7000.
- Does not allow a person to breach the safety clearances to the network, namely, allow any part of a person to be greater than 4.3m above the ground (See Figure 6) ;
- Access to Endeavour Energy assets are not reduced and the minimum requirements of Figure 6 and clause 5.19 are adhered to.

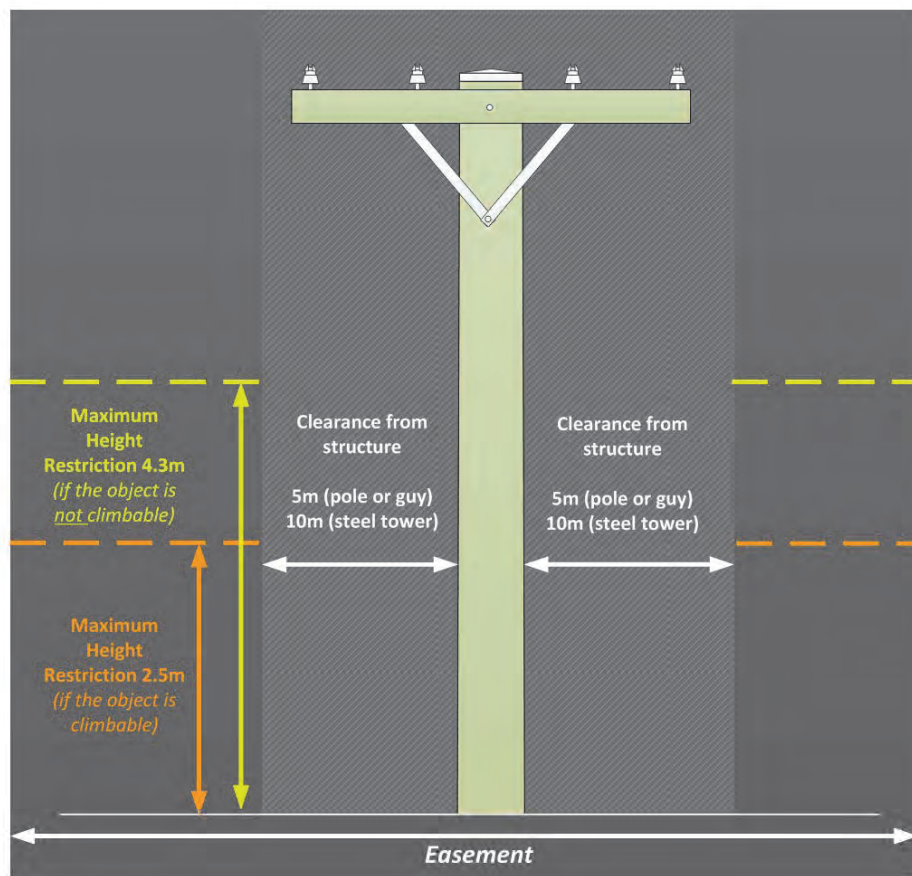


Figure 6 - Overhead line restriction within easement

5.14.2 Prohibited activities / encroachments

The following activities / encroachments listed below are prohibited within all Endeavour Energy easements and will not be approved:

- Construction of habitable buildings (permanent or temporary);
- Construction of garages or large sheds, whether permanent or temporary, or any other structure which may allow safety clearances to be breached;
- The installation of fixed plant (such as conveyor belts) or equipment, or its footings;
- The planting of trees that exceed a height of three (3) metres ;
- The placement of obstructions which may hinder access requirements;
- In-ground or above-ground swimming pools (permanent and / or temporary constructions);
- The storage and / or use of flammable, combustible, corrosive or explosive material;
- The storage and / or handling of conductive material of lengths in excess of three (3) metres;
- Lighting of any fires (this does not include back burning, refer to section 5.14.4.8);
- Parking of large vehicles (such as tankers and semi-trailers with large loads);
- The setting up of campervans or tents, which would allow persons to reside in the easement;
- The construction of flag poles and/or weather vanes which are taller than 4.3m;
- Electric fencing;
- Ploughing near electricity structures or stay poles/wires, that may impact the assets structural integrity;
- Use of any types of explosives;
- Flying of kites, model aircraft or drones;
- BMX bike riding (with jumps);
- Installation of flood lighting;
- Any activity which involves firearms.

Where an activity or encroachment is found to be being undertaken/installed and is on the above list, arrangement of its removal must be made. Any cost incurred will be at the expense of the owner of the land.

5.14.3 Permitted activities / encroachments

The following activities/encroachments are allowed within Endeavour Energy easements if it meets the minimum safety requirements detailed in clause 5.14.1:

- Low growing vegetation;
- Ground cover/surfaces such as wood chips and bluemetal stones;
- Storage of non-combustible, non-explosive, non-conductive, non-corrosive materials.

5.14.4 Controlled activities / encroachments

All controlled activities require approval to be sought from the applicable Regional Easement Officer of Endeavour Energy, in writing as set out in Clause 5.18.2. The Easement Officer will assess the activity/encroachment as defined Clause 5.18. The proposed activity must not commence unless approval is received in writing from Endeavour Energy Regional Easement Officer.

All these controlled activities must meet the required minimum safety requirements detailed in clause 5.14.1, as well as any additional controls listed below.

5.14.4.1 Minor structures

The following minor structures are permitted:

- clothes hoists;
- playground equipment;

- shade cloths / umbrellas;
- non-metallic fences (Endeavour Energy may require gates);
- small brick barbecues.

All metallic parts must be effectively earthed and no electrical supply must be brought within the easement.

If Endeavour finds that a structure impedes access or presents an unacceptable level of risk, Endeavour Energy reserves the right to have the structure removed, or to remove it at the owner's expense.

5.14.4.2 Non-habitable buildings (carports and metallic garden sheds)

Carports or metallic garden sheds can be installed within an overhead line easement provided they are effectively earthed, and no power is connected to the structure. Only metallic sheds which will not be inhabited must be approved.

5.14.4.3 Erection of conductive fencing / sound walls

All conductive fencing and/or sound walls crossing or running parallel to an easement are to be effectively earthed and / or have interval breaks in electrical continuity to prevent electromagnetic induction and transferred voltage hazards. Refer to drawing 242450, 242451 and 069575 for requirements for fencing.

A minimum 4.2 metre wide opening or gate (with provision to accept Endeavour Energy locks) for vehicle access will be a condition of approval.

5.14.4.4 Metal safety barriers and guardrails

Where a metal barrier (Armco guardrail or similar) crosses and continues beyond an easement, the following is required:

- The section of barrier within the easement must be earthed.
- A minimum 300 mm clear air gap must be left between the end of the barrier within the easement boundary and the starting point of the barrier beyond the easement boundary.

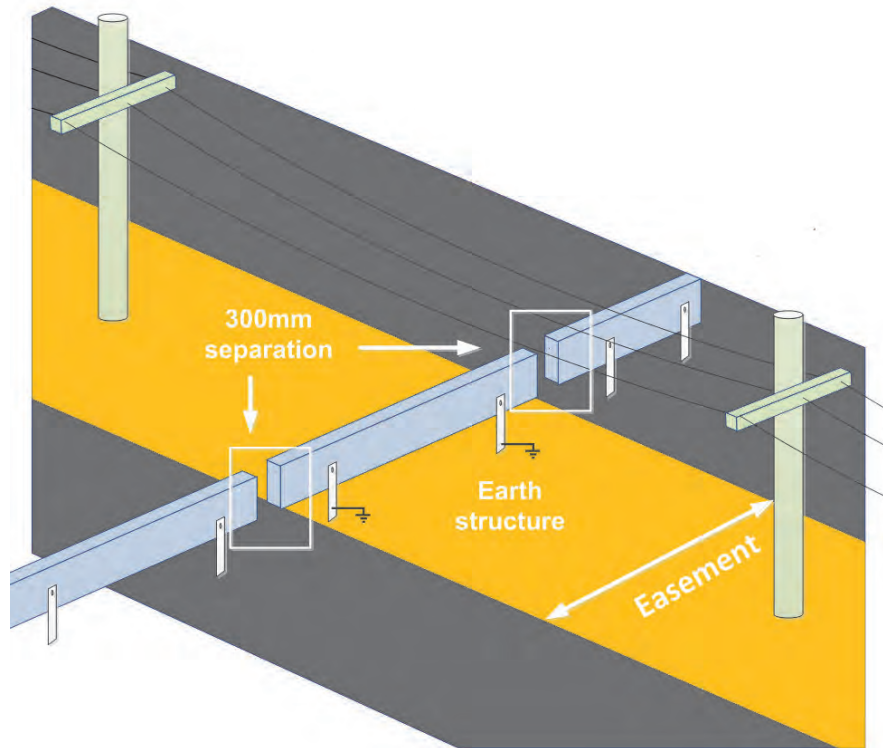


Figure 7 - Safety Barrier Requirement

5.14.4.5 Retaining walls

All proposed retaining walls must be made as to provide sufficient strength for any future work to be performed by Endeavour Energy, and must not impact the maintenance activities required on any assets within the easement.

5.14.4.6 Parking of vehicles or mobile plant

Parking within an overhead easement is subject to the vehicle:

- having a height limitation of 4.3 metres;
- is not occupied;
- is not connected to power; and,
- must be able to be readily removed if Endeavour Energy requires access to its assets.

5.14.4.7 Operation of mobile plant and equipment

No mobile plant and equipment must exceed a maximum height of 4.3 metres.

Within an overhead easement area, approval for the operation of mobile plant and equipment is dependent upon available clearances to the conductors under maximum operating conditions, power line voltages, vehicle operating heights and the level of accreditation of the vehicle operator.

Consequently, each application for the operation of mobile plant and equipment will be processed by the Regional Easement Officer and assessed for compliance with relevant **Safework** NSW legislation. A dedicated observer must also be present so that clearances are maintained.

Precautions must be taken to prevent collision or interference with overhead structures or stay poles.

5.14.4.8 *Back burning*

Back-burning operations carried out by fire authorities or bushfire brigades must be referred to Endeavour Energy's Control Room Manager and must include a map of the area showing the time, date and the area of the burn. An Endeavour Energy representative may attend back-burning procedures to maintain the safety of structures and conductors.

5.14.4.9 *Agricultural pursuits*

Agricultural pursuits, such as dusting, harvesting, netting and irrigation must have the following controls:

- Clear, defined vehicle access to structures is required to prevent damage to crops.
- Irrigation systems must not be placed within five (5) metres of the overhead conductors at any time.
- The location of any irrigation equipment must be such that it is not capable of projecting a solid jet of water to within three (3) metres of any overhead conductor.
- Gun type irrigators must have the water jet directed away from the conductors.
- Care must be taken when moving equipment around such as irrigation pipes or equipment, grain augers and the like.
- The equipment must not interfere with maintenance or safe operation of the power line, nor must it interfere with access to electricity assets.
- No electrical supply brought within the easement without prior approval of Endeavour Energy..

5.14.4.10 *Rainwater tanks*

Rainwater tanks must have the following controls:

- Above ground rainwater tanks, either for fire-fighting purposes or rainwater harvesting, erected within an easement, must be fully enclosed and of non-conducting material. (Concrete is considered to be a conductive material)
- All pipework is to be non-conductive and no electrical supply must be supplied to the tank for any purpose (including pumps and/or lighting).
- Any pumps and/or lights must be installed outside the easement.
- Ladders must not be installed on the rainwater tank.
- Rainwater tanks must not be installed within five (5) metres of a pole or stay pole, 10 metres from a steel structure or within five (5) metres of the vertical projection of the conductor.
- The tank and associated pipe work must not interfere with maintenance or access to electricity assets.

5.14.4.11 *Detention basins*

Applications for detention basins will be considered, subject to:

- The location has local council approval;
- The location is not within five (5) metres of a pole or stay pole or 10 metres from a steel structure;

- Sufficient clearance is maintained to all structures along the easement to allow unrestricted access.

5.14.4.12 Quarrying, filling, earthworks, or change of ground contours

Approval by the Easement Officer may be given, subject to:

- The maintenance of standard ground clearances (if conductor heights need adjustment, this will be at the proponents expense);
- Equipment/machinery performing earth works maintains standard clearances to the overhead lines;
- access maintained to all line structures;
- the subsoil stability and surface drainage in the vicinity of structures is not adversely affected; and,
- excessive quantities of dust are not generated.

5.14.4.13 Roads (other than access tracks)

For roads proposed within an existing easement, the minimum ground clearances as specified in MDI 0047 and MDI 0031 must be achieved.

Where alterations to conductor height and/or relocation of poles are required for the development of the road, this will be at the cost of the developer. This will include any work required to maintain safety clearances arising from activities in the easement after the road works are completed.

Where a road is proposed to run parallel to a feeder, a risk assessment evaluating the risk of impact with each structure as outlined in MDI 0031 must be submitted.

Earthing conductors may have been laid near, around and between the structures and must not have their electrical integrity compromised. Where a developer plans to construct a road which crosses the easement, the onus is on the developer to locate and avoid all earthing cables. If earthing cables are damaged, Endeavour Energy must be notified immediately.

Roads and driveways that are required for access to electrical infrastructure must be capable of carrying a 30 tonne truck.

5.14.4.14 Installation of utility services

Applications for the installation of telephone, water and sewerage services (overhead, underground, or on the surface) may be considered for approval by Endeavour Energy's Mains Assets Manager. The approval of the installation of these services will be based on:

- There is no practical alternative available;
- Any services within 15 metres of a structure must be constructed of non-conducting materials;
- The integrity of all line structures and stay pole/wires are to be maintained at all times;
- Designers and installers of utility services must consider any hazards associated with induced voltages and transferred earth potentials, in accordance with AS 4853, which must be controlled. Applications will require a risk assessment and proposed controls for each of the identified hazard.

Establishment of an easement for other utilities assets within Endeavour Energy's easement may be required.

5.14.4.15 Residential/Commercial subdivisions

Where subdivisions of property are proposed for land in which Endeavour Energy has an easement, the following requirements must be met:

- Unrestricted access to Endeavour Energy's structures are retained;
- No structures are to be erected within the easement;
- Structures suitably protected against motor vehicle impact;
- The number of crossings of Endeavour Energy's overhead line by utilities must be minimised, and complies with 5.14.4.14.

5.14.4.16 Domestic recreational activities and recreational facilities

Approval will be given for domestic recreation activities, but will not include activities that may interfere with clearances to the conductors, such as those listed in 5.14.2.

Approval will be given for recreational facilities, such as tennis courts, subject to:

- fencing is to be non-conductive material or must be effectively earthed (refer to section 5.14.4.3);
- Height of any fence is 4.3 metres or less;
- facilities surface construction will be required to withstand the movement of large heavy plant up to a 30 tonne truck; and,
- not located within five (5) metres from a power pole or ten (10) metres from a steel structure.

5.14.4.17 Storage of organic materials

Small amounts of organic materials, such as leaves and compost, may be stored underneath overhead powerlines, provided they do not impede access to structures and do not create a fire hazard.

5.15 Encroachments on underground easements

5.15.1 General information for underground asset easements

Where relocation of existing assets are proposed, the costs to enable the activity to proceed, will be borne by the applicant.

Safework NSW (previously Workcover Authority of NSW) Publications provides guidance on risk control measures when working close to electricity infrastructures both below and above ground. Refer to *Code of Practice – Work near Overhead Power Lines* or *Work Near Underground Assets Guide*.

5.15.2 Minimum safety requirements for underground asset easements

For an underground asset easement, the following criteria must **always** be met, to maintain the safe operation of the network and employees:

- Before commencing any underground activity, all applicants are required to obtain advice from the **Dial before You Dig 1100** service in accordance with the requirements of the Electricity Supply Act and associated Regulations.
- Ground contour does not substantially change, which would impact the rating of the conductors;
- Any storage of an asset is temporary in nature and can be moved at a given notice or the cost of removal of the encroachment will be at the expense of the owner, if Endeavour Energy requires access to its asset;
- No mechanical compacting is to occur within an easement.
- Access to Endeavour Energy joints/joint bays are not impeded.
- No excavation which is greater than 300mm deep must occur.

5.15.3 Prohibited activities / encroachments

The following activities / encroachments listed below are prohibited within all Endeavour Energy easements and will not be approved:

- Construction of habitable buildings (permanent or temporary)
- Installation of minor structures (such as shade cloths, clothes lines, flood lights, playground equipment, fences and BBQs.)
- Installation of all types of garages, sheds, shipping containers, or carports.
- Installation of sound walls or safety barriers.
- Installation of conductive fencing which runs through an easement.
- Installation of rainwater tanks;
- Electric fencing;
- Retaining walls running longitudinally above underground assets;
- The installation of footings for fixed plant or equipment;
- Plants with significant root systems that grow greater than 400 mm below ground level;
- In-ground or above-ground swimming pools and spas (permanent and / or temporary constructions)
- Ploughing that is greater than 300mm deep, or at a depth greater than 400mm above underground assets
- The storage and / or use of flammable, combustible, corrosive or explosive material
- Changing of the ground level such that relative depth of underground cables increases or decreases
- Permanent surfaces, such as asphalt or concrete;
- The placement of obstructions which may hinder access requirements
- Concrete driveways located above and/or that restrict access to existing cable joints/pits.
- Use of explosives;
- Installation of tennis courts;

Where an activity or encroachment violates the above requirements, arrangement of its removal must be made. Any cost incurred will be at the expense of the owner of the land.

5.15.4 Permitted activities / encroachments

The following activities/encroachments are allowed within Endeavour Energy easements if it meets the minimum safety requirements detailed in clause 5.15.2:

- Tents;
- Flag poles and/or weather vanes;
- Sound walls;
- Metal safety barriers;
- Parking of small vehicles;
- Shrubs with root systems that are less than 400mm;
- Alternative ground surfaces (such as Bluemetal stones and woodchips);
- Storage of non-combustible, non-flammable, non-explosive material;
- Rainwater tanks;
- Detention basins;
- General recreational activities, the flying of kites and model aircraft, and the use of firearms;

5.15.5 Controlled activities / encroachments

All controlled activities require approval to be sought, from Endeavour Energy's Regional Easement Officer, in writing as set out in Clause 5.18.2. The Easement Officer will assess the activity/encroachment as defined Clause 5.18. The proposed activity must not commence unless approval is received in writing from Endeavour Energy Regional Easement Officer.

Controlled activities must meet the minimum safety requirements detailed in clause 5.15.2, as well as any additional controls listed below.

5.15.5.1 Fencing

A minimum 4.2 metre wide opening or gate (with provision to install Endeavour Energy locks) for vehicle access will be a condition of approval of fencing on the boundary of the easement.

Where fencing runs through an easement, the posts must be located outside the easement.

5.15.5.2 Metallic pipes (greater than 3 metres)

The storage of metallic pipes greater than three (3) metres is acceptable provided the metallic pipes can be moved upon request.

5.15.5.3 Fixed plant and/or equipment

Fixed plant is generally not allowed within Endeavour Energy's underground easement areas. This is due to potential access issues as well as risk of damage to Endeavour Energy's assets for the installation fixed plant footings. A proposal where fixed plant crosses an underground easement perpendicularly, will be considered upon application.

5.15.5.4 Parking of Mobile plant, equipment or vehicles

Within an underground easement area, approval is dependent upon an adequate surface to support the mobile plant/vehicle (up to 30 tonne) or equipment likely to be parked to prevent the crushing of the cables/ducts or erosion of the ground. In some instances, the activity may require supervision by an Endeavour Energy representative at the operator's expense.

5.15.5.5 *Agricultural pursuits*

Agricultural pursuits, such as dusting, irrigation and grazing are permitted within an underground easement. However, any activity which is likely to affect the ground level (such as ploughing and the planting of crops) is not allowed within the easement.

Equipment and/or crops must not interfere with access to electricity assets.

5.15.5.6 *Roads and concrete driveways*

Roads and concrete driveways are permitted within Endeavour Energy underground easements where:

- Cables are in existing continuous ducts;
- The roadway/driveway is capable of supporting the heaviest vehicle likely to traverse the driveway;
- The thermal rating of the cable is not compromised by the installation;
- The concrete driveway is not proposed to be installed within a distance that would restrict access / maintenance of a joint / pit.
- The concrete driveway is not proposed to be installed over a joint / pit.

The need for (including size and quantity) spare conduits must be confirmed with Network Capacity Planning prior to construction within Endeavour Energy's easements. All required conduits must be funded by the applicant.

If a roadway/driveway is found to be installed without the installation of spare ducts, the owner of the driveway must bear the cost of installing additional ducts, which will be done either by digging up the driveway or under-boring if required by Endeavour Energy at a future stage.

5.15.5.7 *Installation of utility services*

The installation of underground services must comply with MCI 0006 and Drawing 403230 Sheets 1 – 12.

5.15.5.8 *Residential/Commercial subdivisions*

Where subdivisions of property are proposed for land in which Endeavour Energy has an easement, the following requirements must be met:

- Unrestricted access to Endeavour Energy's structures are retained;
- No structures are to be erected within the easement;

5.15.5.9 *Retaining walls*

Retaining walls must not be approved where they run longitudinally over an underground easement.

Retaining walls which encroach on an underground easement, must be:

- Built using concrete material (for example, *Besser* blocks, concrete / clay bricks);
- Have mustow foundations;
- Must be a maximum of one (1) metre in height

Where foundations require digging post holes, these must be located outside the easement.

5.16 Encroachments on Padmount Substation or Switching Station easements

5.16.1 General information for padmount substation easements

For the purpose of this section, wherever a padmount substation is referenced, this also applies a ground substation, padmount substation and switching station.

Where the relocation of existing assets is proposed, the costs to enable the activity to proceed will be borne by the applicant.

Workcover Authority of NSW Publications provides guidance on risk control measures when working close to electricity infrastructures both below and above ground. Refer to *Code of Practice – Work near Overhead Power Lines* or *Work Near Underground Assets Guide*.

5.16.2 Minimum safety requirements for padmount substation easements

The minimum safety requirements padmount substations easements are outlined below and must **always** be met to maintain the safe operation of the network and employees:

- Screening vegetation for padmount substations must be planted outside the easement. Any vegetation adjacent to the easement must not obstruct access to the padmount substation and must be maintained in such a manner as to allow easy access to Endeavour's assets.
- The ground contour surrounding the padmount substation does not substantially change;
- Storage of an object/machinery is temporary in nature and can be moved at a given notice and if Endeavour Energy requires access to its asset the cost of removal of the encroachment will be at the expense of the owner;
- No building overhangs within the six (6) metre airspace above a padmount substation site;
- No construction must occur within the padmount substation / switching station easement;
- No mechanical compacting is to occur within an easement.
- Access to Endeavour Energy joints/joint bays and the padmount substation must not be impeded and must comply with clause 5.19.

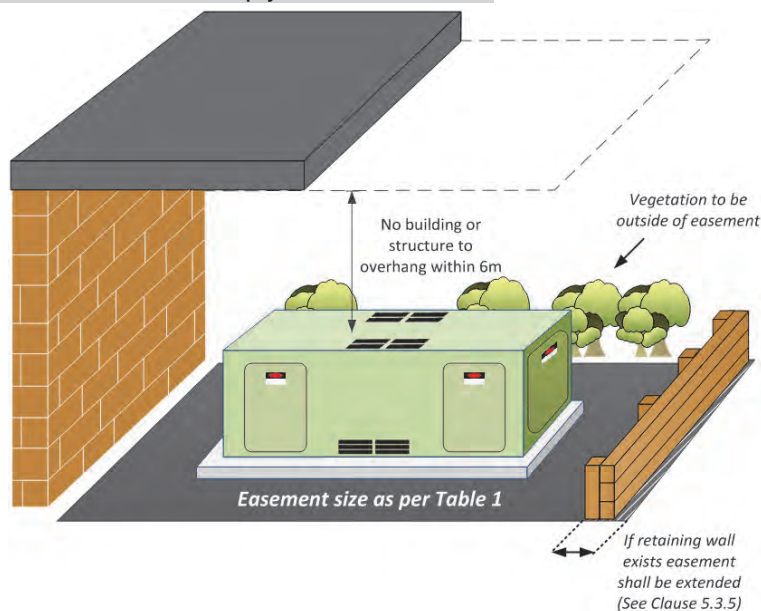


Figure 8 - Padmount Substation Easement Requirements

5.16.3 Prohibited activities / encroachments

Most activities are prohibited within the padmount substation easement. For a full list refer to Annexure 5 – Encroachment reference guide.

5.16.4 Permitted activities / encroachments

The following activities/encroachments are allowed within Endeavour Energy easements if it meets the general requirements in Clause 5.16.2.

- The use of mobile plant and/or equipment;
- Planting of vegetation with a root system not greater than 400mm;
- The installation of easily removable surfaces other than grass (bluemetal or woodchips);

5.16.5 Controlled activities / encroachments

All controlled activities require approval to be sought, from Endeavour Energy's Regional Easement Officer, in writing as set out in Clause 5.18.2. The Easement Officer will assess the activity/encroachment as defined Clause 5.18. The proposed activity must not commence unless approval is received in writing from Endeavour Energy Regional Easement Officer.

All controlled activities must meet the minimum safety requirements detailed in Clause 5.16.2, as well as any additional controls listed below.

5.16.5.1 Mobile plant/equipment and Parking of vehicles

Where a padmount substation is in the vicinity of a parking facility, suitable crash and impact protection from vehicles must be installed. These must be positioned in such a way to allow access to the substation to be maintained. Any proposals for the installation of suitable vehicle impact protection measures are subject to approval from the Regional Easement Officer.

5.16.5.2 Agricultural pursuits

Agricultural pursuits are prohibited within a padmount substation easement. Grazing would be the only activity that would be permitted.

5.16.5.3 Roads and concrete driveways

Roads and concrete driveways are permitted within the padmount easements where:

- Cables are in existing continuous ducts;
- The roadway/driveway is capable of supporting the heaviest vehicle likely to traverse the driveway;
- The thermal rating of the cable is not compromised by the installation;
- Suitable crash and impact protection must be installed, positioned in such a way to allow access to the substation to be maintained.

5.16.5.4 Retaining walls

Retaining walls built around distribution substations or switching stations, as part of reticulation requirements, must be outside the standard easement Refer to 5.3.6.

Proposed retaining walls must not impact the maintenance activities performed by Endeavour Energy on any assets within the easement.

5.16.5.5 Fencing

For fencing requirements around a padmount substation refer to MCI 0006 – Section 7.

Fencing surrounding an easement must comply with Table 2.

Table 2: Fencing near a Padmount Substation

Padmount Earthing	Fence Allowed	
	On easement boundary	Through easement
Common Earthed	YES	NO
Separately earthed	If within 4m of padmount, fence posts must be insulated and a touch-voltage assessment required.	NO

5.17 Transfer earth hazards


In addition to all requirements stipulated in this standard the risk of transfer earth hazards associated with Endeavour Energy's assets and/or equipment, structures or objects must be managed in accordance with SDI 100 "Distribution earthing design, construct and test".

This requirement may impose restriction zones around Endeavour Energy's assets limiting the use of land within the defined area(s).

5.18 Encroachment management process

5.18.1 Existing encroachment management process

Endeavour Energy will manage existing encroachments that have not been previously approved, according to the flowchart below:

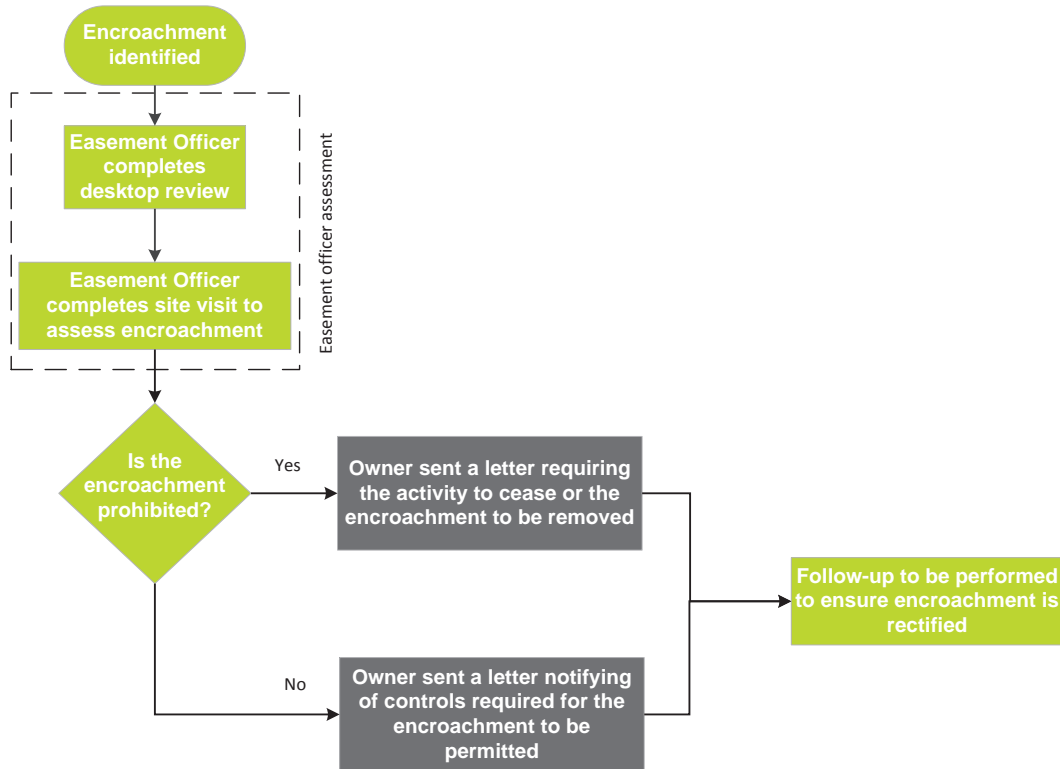

5.18.1.1 Easement Officer Review

Once identified, the Easement Officer will perform both a desktop assessment and a site visit to determine whether the encroachment is permitted, controlled or prohibited, as defined in Clause 5.11, or whether with possible controls can overcome / lessen the encroachment.

On completion of the assessment, a letter will be sent to the owner, identifying:

- Explanation of the terms of the easement;
- Identifying the hazards to themselves, members of the public and Endeavour Energy's employees;
- Providing advice on possible solutions to overcome / lessen the encroachment.
- The outcome of the assessment:
 - Where the encroachment is determined to be a "controlled activity", conditional approval for it to continue must be given only if the applicable controls (as defined in Clause 5.11) are used.
 - Where the encroachment is determined to be a prohibited activity/structure, the owner will be required to remove the encroachment or cease the activity.

A follow-up site visit will be completed within 30 days to check whether the encroachment has been adequately managed.

Legal action will be considered when all other avenues are exhausted.

The local council must be included in correspondence to highlight the need for their approval process to include a corresponding approval from Endeavour Energy where easements are involved.

5.18.2 Applications for controlled encroachments

All applications for an activity or encroachment, or requests for advice, must be referred to Endeavour Energy's Regional Easement Officers. Applications must be addressed to:

Regional Easement Officer – North / Central / South (see table below)
 Endeavour Energy
 PO Box 811
 Seven Hills NSW 1730

Endeavour Energy's network franchise area has three (3) regions, responsible for the local government areas set out in the following table:

Region	Local government areas
North	Bathurst, Baulkham Hills, Blacktown, Blue Mountains, Hawkesbury, Lithgow, Parramatta, Penrith, plus parts of Hornsby, Mid-Western and Ryde.
Central	Camden, Campbelltown, Fairfield, Cumberland (Holroyd), Liverpool, Wingecarribee, Wollondilly, plus parts of Bankstown.
South	Kiama, Shellharbour, Shoalhaven, Wollongong.

5.18.2.1 Application requirements

Due to the varied circumstances that apply to easements, all applications will be assessed individually, and will be site specific.

All applications require the following:

- The application is to be made in writing.
- The application is to include detailed plans, drawn to scale and with full dimensions, showing property boundaries, lot number, Deposited Plan (DP) number, any electricity structures, and other relevant information.
- A survey plan of an easement for padmount substation must show the substation number and at least two (2) offsets from adjacent sides of the concrete plinth to the easement boundary.
- Each application will require an impact and risk assessment and must be assessed on the site-specific circumstances and Endeavour Energy's risks assessment company procedure of the proposal.

5.18.2.2 Easement Officer Review

After the application has been received, the easement officer will perform a desktop review of the application and if required, a site visit.

Where Endeavour Energy is uncertain about the impact of the controlled activity or encroachment, the applicant/s will be asked to arrange an independent study of the risk at their own expense. Endeavour Energy will consider the outcome of the study when deciding on the application.

Where additional testing is required, the applicant will be responsible for:

- Arranging the test with an organisation acceptable to Endeavour Energy;
- Paying for the test;
- Supplying the test results to Endeavour Energy.

5.19 Access and Rights of Way

Where possible, access to Endeavour Energy assets must be made possible by access tracks located within Endeavour Energy easements.

Consideration must be given to securing access by the way of a land tenure agreement and/or other legal instruments such as 'Right of Ways', where:

- access tracks must traverse outside of easements;
- access options to assets is limited;
- significant investment has been outlaid to upgrade and/or construct an access; or,
- there is future development planned for an area that may affect or obstruct access routes.

The appropriate land tenure agreement and or legal instrument must be discussed with the Property, People and Services Branch.

5.19.1 Locking arrangements for shared access gates

In some cases, access to land with electricity easements is shared by Endeavour Energy with others – utilities, customers, and organisations such as the NSW National Parks and Wildlife Service or the Rural Fire Service.

Where access is through a gate protected by dedicated locks, an EL specification lock must be installed. The preferred arrangements for single or multiple locks are shown in Figure 9. Where there is more than one lock, the locks must be spaced as evenly as possible by joining with equal lengths of chain.

The entire chain must be of exact length to allow the gate to be fully secured, while allowing for the chain to be rotated so that access to the locks is possible from either side of the gate.

When replacing locks after entering or leaving, the correct ends of the chain must be connected with the lock, so that it remains a continuous loop.

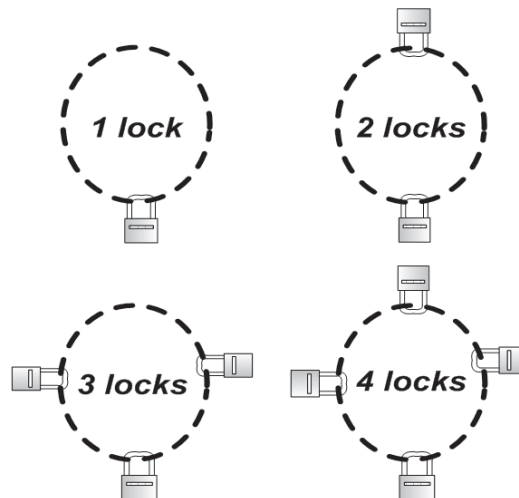


Figure 9 – Locking arrangements for shared access gates

5.20 Recording of easements in GIS

When an easement is created, the easements must be reflected in the Endeavour Energy's GIS system.

5.21 Drawings

Drawing No	Amendment	Title
016665	S	11kV and 22kV Padmount substation easement layout
086232	K	Minimum clearances near structures
282551	A	Size 16 Switching Station easement layout
289702 (Sheets 1 – 7)	A	Fencing arrangement for padmount substation easement details
403230 (Sheets 1 – 12)	A	Shared trenching arrangements
242451	B	Chain wire fence – isolation panel and earthing installation detail
069575	G	Solid Metallic Fence – Isolated panel and earthing installation detail
242450	A	Transmission Line Structure – Metallic fence clearance and isolation panel requirements.

6.0 AUTHORITIES AND RESPONSIBILITIES

General Manager Asset Management has the authority and responsibility for approving this instruction.

General Manager, Network Services has the authority and responsibility for all new distribution and transmission projects complying with the contents of this instruction.

Manager Asset Standards & Design has the delegated authority and responsibility for approving this instruction and the endorsing of non-standard/reductions in easement widths.

Manager Network Connections has the authority and responsibility for new contestable works electrical designs complying with this instruction.

Mains Assets Manager has the authority and responsibility for:

- Endorsing the content of this instruction;
- Keeping the content of this instruction is kept up to date;
- Approval for encroachments within easements.

Substation Assets Manager has the authority and responsibility for providing input into the content of this instruction.

Earthing and Power Quality Manager is responsible for the assessment and approval of earthing issues within easements.

Easements Officers are responsible for:

- Reviewing easement encroachment applications;
- Performing investigations into possible encroachments;
- Providing advice and consultation to stakeholders.

7.0 DOCUMENT CONTROL

Documentation content coordinator: Mains Assets Manager

Documentation process coordinator: Branch Process Coordinator

Annexure 1 STANDARD EASEMENT TERMS**A1.1 - Overhead Lines, Underground Cables, Padmounts, Switching Stations, Street Lighting, Pole/Ground Stays****1.0 Definitions:**

- 1.1 **easement site** means that part of the lot burdened that is affected by this easement.
- 1.2 **electrical equipment** must be defined as stated below for each of the easement terms associated with the following asset classes:
 - 1.2.1 *Overhead Power Lines* - includes pole, tower, overhead electrical conductors, underground earthing system, and ancillary equipment.
 - 1.2.2 *Underground Cables* - includes underground electrical cable, duct, service pillar, underground earthing system, and ancillary equipment.
 - 1.2.3 *Padmount Substation / Switching Station* - includes electrical transformer (padmount only), switchgear, protective housing, concrete plinth, underground electrical cable, duct, underground earthing system, and ancillary equipment.
 - 1.2.4 *Pole Stays / Ground Stays* – includes stay pole, concrete strainer block, stay cable, stay wire, and ancillary equipment.
 - 1.2.5 *Street Lighting* – includes the column, lantern and foundations of the street light.
- 1.3 **Endeavour Energy** means Endeavour Energy and its successors (who may exercise its rights by any persons authorised by it).
- 1.4 **install** includes construct, repair, replace, maintain, modify, use, and remove.
- 1.5 **owner** means the registered proprietor of the lot burdened and its successors (including those claiming under or through the registered proprietor).
- 1.6 **services** includes Network gas, telephone, communications, water, sewage, and drainage services.
- 1.7 **structure** includes building, wall, retaining wall, carport, and swimming pool; but excludes garden furniture and garden ornaments.

2.0 Endeavour Energy may:

- 2.1 install electrical equipment within the easement site,
- 2.2 excavate the easement site to install the electrical equipment.
- 2.3 use the electrical equipment for the transmission of electricity,
- 2.4 enter the lot burdened using the most practical route (with or without vehicles, machinery or materials) at all reasonable times (and at any time in the event of an emergency) and remain there for any reasonable time. This may include the installation of gates in existing fencing if access is not readily available,
- 2.5 install its own access gates and locks,
- 2.6 trim or remove any vegetation from the lot burdened that interferes with or prevents reasonable access to the easement site or the electrical equipment, and
- 2.7 remove any encroachments from the easement site and recover the costs of carrying out the removal work and repairing any damage done to the electrical equipment by the encroachment.

- 3.0 In exercising its rights under this easement **Endeavour Energy** will take reasonable precautions to minimise disturbance to the lot burdened and will restore the lot burdened as nearly as practicable to its original condition.

- 4.0 The owner agrees that, without the written permission of Endeavour Energy and in accordance with such conditions as Endeavour Energy may reasonably impose, it will not:
- 4.1 install or permit to be installed, any services or structure within the easement site, or
 - 4.2 alter the surface level of the easement site, or
 - 4.3 do or permit to be done anything that restricts access to the easement site by Endeavour Energy

5.0 Lessee of Endeavour Energy's Distribution System

- 5.1 Notwithstanding any other provision in this easement, the owner grants to Endeavour Energy the easement and acknowledges and agrees that any lessee of Endeavour Energy's distribution system, and any nominee of such lessee (which may include a sublessee of Endeavour Energy's distribution system from that lessee), may, without the need for any further approvals or agreements, exercise the rights and perform the obligations of Endeavour Energy as if that lessee or nominee were Endeavour Energy, but only for so long as the lessee leases Endeavour Energy's distribution system from Endeavour Energy.
- 5.2 The owner must do all things reasonably necessary to ensure any such lessee, and any such nominee, is able to exercise the rights and perform the obligations of Endeavour Energy.

A1.2 - Indoor Substation

1.0 Definitions:

- 1.1 **building** means the building within which the electrical equipment is located.
- 1.2 **easement site** means that part of the lot burdened that is affected by this easement.
- 1.3 **electrical equipment** includes electrical transformer, electrical switchgear, electrical cable, duct, services, ventilation, and ancillary equipment.
- 1.4 **Endeavour Energy** means Endeavour Energy and its successors (who may exercise its rights by any persons authorised by it).
- 1.5 **install** includes construct, repair, replace, maintain, modify, use, and remove.
- 1.6 **owner** means the registered proprietor of the lot burdened and its successors (including those claiming under or through the registered proprietor).
- 1.7 **services** includes Network gas, telephone, communications, water, sewage, and drainage services.

2.0 Endeavour Energy may:

- 2.1 install electrical equipment within the easement site,
- 2.2 use the electrical equipment for the transmission of electricity,
- 2.3 enter the lot burdened using the most practical route (with or without vehicles, machinery or materials) at all reasonable times (and at any time in the event of an emergency) and remain there for any reasonable time. This may include the installation of gates in existing fencing if access is not readably available,
- 2.4 install its own security doors to gain access to the electrical equipment and to prevent access by others, and
- 2.5 install conduits, cables, and pipes on, under or through the building for the purpose of connecting the electrical equipment with any services and to operate those services.

- 3.0 Endeavour Energy agrees that it will not cut, drill, alter or demolish any part of the building necessary to install or operate the electrical equipment without the written permission of the owner and in accordance with such conditions as the owner may reasonably impose.
- 4.0 In exercising its rights under this easement Endeavour Energy will take reasonable precautions to minimise disturbance to the lot burdened and will restore the lot burdened as nearly as practicable to its original condition.
- 5.0 The owner agrees that, without the written permission of Endeavour Energy and in accordance with such conditions as Endeavour Energy may reasonably impose, it will not:
- 5.1 install or permit to be installed any thing within the easement site, or
 - 5.2 interfere with, allow to be interfered with, or prevent the ventilation of the easement site, or
 - 5.3 direct or allow to be directed drainage into the easement site, or
 - 5.4 do or permit to be done anything that restricts access to the easement site by the Endeavour Energy

6.0 Lessee of Endeavour Energy's Distribution System

- 6.1 Notwithstanding any other provision in this easement, the owner grants to Endeavour Energy the easement and acknowledges and agrees that any lessee of Endeavour Energy's distribution system, and any nominee of such lessee (which may include a sublessee of Endeavour Energy's distribution system from that lessee), may, without the need for any further approvals or agreements, exercise the rights and perform the obligations of Endeavour Energy as if that lessee or nominee were Endeavour Energy, but only for so long as the lessee leases Endeavour Energy's distribution system from Endeavour Energy.
- 6.2 The owner must do all things reasonably necessary to ensure any such lessee, and any such nominee, is able to exercise the rights and perform the obligations of Endeavour Energy.

A1.3 – Rights of Access

1.0 Definitions:

- 1.1 **access site** means that part of the lot burdened that is affected by this right of access.
- 1.2 **Endeavour Energy** means Endeavour Energy and its successors (who may exercise its rights by any persons authorised by it).
- 1.3 **owner** means the registered proprietor of the lot burdened and its successors (including those claiming under or through the registered proprietor).

2.0 Endeavour Energy may:

- 2.1 by any reasonable means pass across the access site for the purpose of exercising or performing any of its powers, authorities, duties or functions, and
- 2.2 do anything reasonably necessary for passing across the access site, including:
- 2.2.1 Entering the lot burdened;
 - 2.2.2 taking anything on to the lot burdened; and,
 - 2.2.3 carrying out work within the site of the easement, such as constructing, placing, repairing or maintaining trafficable surfaces, driveways or structures.

3.0 In exercising its rights set out in Clause 2.0, Endeavour Energy must:

- 3.1 complete all work properly;
- 3.2 take reasonable precautions to minimise disturbance to the lot burdened and owner of the lot;
- 3.3 cause as little damage as is practicable to the lot burdened;
- 3.4 restore the lot burdened as nearly as practicable to its former condition; and,
- 3.5 make good on any collateral damage;

4.0 Lessee of Endeavour Energy's Distribution System

- 4.1 Notwithstanding any other provision in this easement, the owner grants to Endeavour Energy the easement and acknowledges and agrees that any lessee of Endeavour Energy's distribution system, and any nominee of such lessee (which may include a sublessee of Endeavour Energy's distribution system from that lessee), may, without the need for any further approvals or agreements, exercise the rights and perform the obligations of Endeavour Energy as if that lessee or nominee were Endeavour Energy, but only for so long as the lessee leases Endeavour Energy's distribution system from Endeavour Energy.
- 4.2 The owner must do all things reasonably necessary to ensure any such lessee, and any such nominee, is able to exercise the rights and perform the obligations of Endeavour Energy.

Annexure 2 Terms of Restrictions on the Use of Land**A3.1 Safety Clearance between Padmount Substations and Adjacent Buildings**

Terms of Restrictive Covenant numbered [xx] in the plan

1.0 Definitions:

- 1.1 **“120/120/120 fire rating”** and **“60/60/60 fire rating”** means the fire resistance level of a building expressed as a grading period in minutes for structural adequacy / integrity failure / insulation failure calculated in accordance with Australian Standard 1530.
- 1.2 **“building”** means a substantial structure with a roof and walls and includes any projections from the external walls.
- 1.3 **“erect”** includes construct, install, build and maintain.
- 1.4 **“restriction site”** means that part of the lot burdened affected by the restriction on the use of land as shown on the plan.

2.0 No building must be erected or permitted to remain within the restriction site unless:

- 2.1 the external surface of the building erected within 1.5 metres from the substation footing has a 120/120/120 fire rating and
- 2.2 the external surface of the building erected between 1.5 metres and 3.0 metres from the substation footing has a 60/60/60 fire rating
- 2.3 and the owner provides the authority benefited with an engineer's certificate to this effect.

3.0 The fire ratings mentioned in Clause 2.0 must be achieved without the use of fire fighting systems such as automatic sprinklers.**4.0 Lessee of Endeavour Energy's Distribution System**

- 4.1 Notwithstanding any other provision in this easement, the owner grants to Endeavour Energy the easement and acknowledges and agrees that any lessee of Endeavour Energy's distribution system, and any nominee of such lessee (which may include a sublessee of Endeavour Energy's distribution system from that lessee), may, without the need for any further approvals or agreements, exercise the rights and perform the obligations of Endeavour Energy as if that lessee or nominee were Endeavour Energy, but only for so long as the lessee leases Endeavour Energy's distribution system from Endeavour Energy.
- 4.2 The owner must do all things reasonably necessary to ensure any such lessee, and any such nominee, is able to exercise the rights and perform the obligations of Endeavour Energy.

A3.2 Fire Proof Screen Walls

Terms of Positive Covenant numbered [xx] in the plan:

1.0 Definitions

- 1.1 “**fire proof screen wall**” means a wall of brick or concrete necessary to achieve a 120/120/120 fire rating up to a minimum height of [xx] metres from the level of the substation footing.
- 1.2 “**owner**” means the registered proprietor of the lot burdened and its successors (including those claiming under or through the registered proprietor).
- 1.3 “**prescribed authority**” means Endeavour Energy (and its successors).
- 1.4 “**120/120/120 fire rating**” means the fire resistance level of a building structure expressed as a grading period in minutes for structural adequacy/integrity failure/insulation failure calculated in accordance with Australian Standard 1530.

2.0 The owner covenants with the prescribed authority that the owner:

- 2.1 Will construct fire proof screen [wall/s] adjacent to the [northern, southern, eastern, western] [boundary/ies] of the easement for padmount substation.
- 2.2 Will maintain the fire proof screen [wall/s] in a satisfactory state of repair and in accordance with any reasonable conditions that the prescribed authority may impose.

3.0 Lessee of Endeavour Energy's Distribution System

- 3.1 Notwithstanding any other provision in this easement, the owner grants to Endeavour Energy the easement and acknowledges and agrees that any lessee of Endeavour Energy's distribution system, and any nominee of such lessee (which may include a sublessee of Endeavour Energy's distribution system from that lessee), may, without the need for any further approvals or agreements, exercise the rights and perform the obligations of Endeavour Energy as if that lessee or nominee were Endeavour Energy, but only for so long as the lessee leases Endeavour Energy's distribution system from Endeavour Energy.
- 3.2 The owner must do all things reasonably necessary to ensure any such lessee, and any such nominee, is able to exercise the rights and perform the obligations of Endeavour Energy.

A3.3 Fire Proof Walls and Roof

Terms of Positive Covenant numbered [xx] in the plan:

1.0 Definitions

- 1.1 **“fire proof wall”** means a wall of brick, concrete or other material necessary to achieve a [60/60/60 or 120/120/120] fire rating up to a minimum height of 6 metres from the level of the substation footing. It also includes any structures attached to the wall such as eaves and gutters.
- 1.1 **“fire proof roof”** means a roof constructed of concrete or other material necessary to achieve a [60/60/60 or 120/120/120] fire rating.
- 1.2 **“owner”** means the registered proprietor of the lot burdened and its successors (including those claiming under or through the registered proprietor).
- 1.2 **“padmount substation”** means padmount substation No. [xxxx]
- 1.3 **“prescribed authority”** means Endeavour Energy (and its successors).
- 1.4 **“60/60/60 or 120/120/120 fire rating”** means the fire resistance level of a building structure expressed as a grading period in minutes for structural adequacy/integrity failure/insulation failure calculated in accordance with Australian Standard 1530.

2.0 The owner covenants with the prescribed authority that the owner:

- 2.1 Will construct fire proof [wall/s] adjacent to the [northern, southern, eastern, western] [boundary/ies] of the easement for padmount substation.
- 2.2 Will maintain the fire proof [wall/s] in a satisfactory state of repair and in accordance with any reasonable conditions that the prescribed authority may impose.
- 2.3 Will construct fire proof roof above the padmount substation.
- 2.4 Will maintain the fire proof roof in a satisfactory state of repair and in accordance with any reasonable conditions that the prescribed authority may impose.

3.0 Lessee of Endeavour Energy's Distribution System

- 3.1 Notwithstanding any other provision in this easement, the owner grants to Endeavour Energy the easement and acknowledges and agrees that any lessee of Endeavour Energy's distribution system, and any nominee of such lessee (which may include a sublessee of Endeavour Energy's distribution system from that lessee), may, without the need for any further approvals or agreements, exercise the rights and perform the obligations of Endeavour Energy as if that lessee or nominee were Endeavour Energy, but only for so long as the lessee leases Endeavour Energy's distribution system from Endeavour Energy.
- 3.2 The owner must do all things reasonably necessary to ensure any such lessee, and any such nominee, is able to exercise the rights and perform the obligations of Endeavour Energy.

A3.4 Separation of Metal Structures to an Earth Grid

Terms of Restrictive Covenant numbered [xx] in the plan

1.0 Definitions:

1.1 **"erect"** includes construct, install, build and maintain.

1.2 **"restriction site"** means that part of the lot burdened affected by the restriction on the use of land as shown on the plan.

2.0 Except as provided in Clause 3.0, no metal structure must be erected or permitted to remain within the restriction site.

3.0 Metallic fencing may be erected within the restriction site if the fence panels are insulated from the fence posts and from the ground.

4.0 Lessee of Endeavour Energy's Distribution System

4.1 Notwithstanding any other provision in this easement, the owner grants to Endeavour Energy the easement and acknowledges and agrees that any lessee of Endeavour Energy's distribution system, and any nominee of such lessee (which may include a sublessee of Endeavour Energy's distribution system from that lessee), may, without the need for any further approvals or agreements, exercise the rights and perform the obligations of Endeavour Energy as if that lessee or nominee were Endeavour Energy, but only for so long as the lessee leases Endeavour Energy's distribution system from Endeavour Energy.

4.2 The owner must do all things reasonably necessary to ensure any such lessee, and any such nominee, is able to exercise the rights and perform the obligations of Endeavour Energy.

A3.5 Separation of Swimming Pools to an Earth Grid

Terms of Restrictive Covenant numbered [xx] in the plan

1.0 Definitions:

1.1 **"erect"** includes construct, install, build and maintain.

1.2 **"restriction site"** means that part of the lot burdened affected by the restriction on the use of land as shown on the plan.

2.0 No swimming pool or spa must be erected or permitted to remain within the restriction site.

3.0 Lessee of Endeavour Energy's Distribution System

3.1 Notwithstanding any other provision in this easement, the owner grants to Endeavour Energy the easement and acknowledges and agrees that any lessee of Endeavour Energy's distribution system, and any nominee of such lessee (which may include a sublessee of Endeavour Energy's distribution system from that lessee), may, without the need for any further approvals or agreements, exercise the rights and perform the obligations of Endeavour Energy as if that lessee or nominee were Endeavour Energy, but only for so long as the lessee leases Endeavour Energy's distribution system from Endeavour Energy.

- 3.2 The owner must do all things reasonably necessary to ensure any such lessee, and any such nominee, is able to exercise the rights and perform the obligations of Endeavour Energy.

Annexure 3 COMMUNITY TITLE BY-LAWS

To maintain access to assets the following by-law must be incorporated into all community title management statements where HV or LV (including street lighting) assets are owned and maintained by Endeavour Energy:

BY-LAW [X] ENDEAVOUR ENERGY – Access Ways

The Association agrees that if the surface of the access ways does not support the heavy vehicles, machinery and materials necessary to maintain Endeavour Energy's electrical equipment, the Association will be responsible for repairing any damage caused to the surface of the access ways during such maintenance.

This provision applies despite any other easement term to the contrary.

Where the ownership of any part of the electricity network (HV, LV or street lighting) within the community title development is to be the responsibility of the community association, the following by-law must be incorporated into the community title management statement:

BY-LAW [X] ENDEAVOUR ENERGY – Ownership of Assets by the Association

The low voltage electricity system is defined on the prescribed diagram as [eg "electricity"].


This electricity system is Association property.

The Association is responsible for the maintenance, repair, refurbishment, and augmentation of this electricity system.

The design of this electricity system has been based on a maximum demand of [as advised by the designer] Amps per dwelling.

Annexure 4 Typical easement layouts

A4.1 - Underground assets

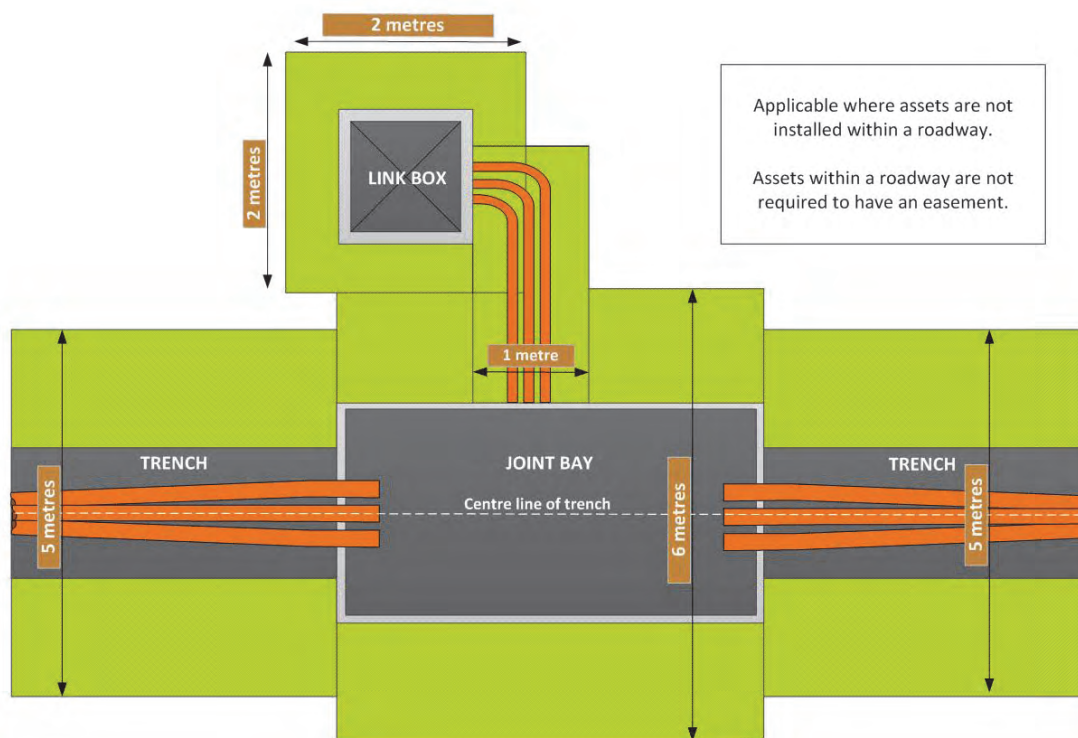

A4.2 – UGOH and Stay pole easements

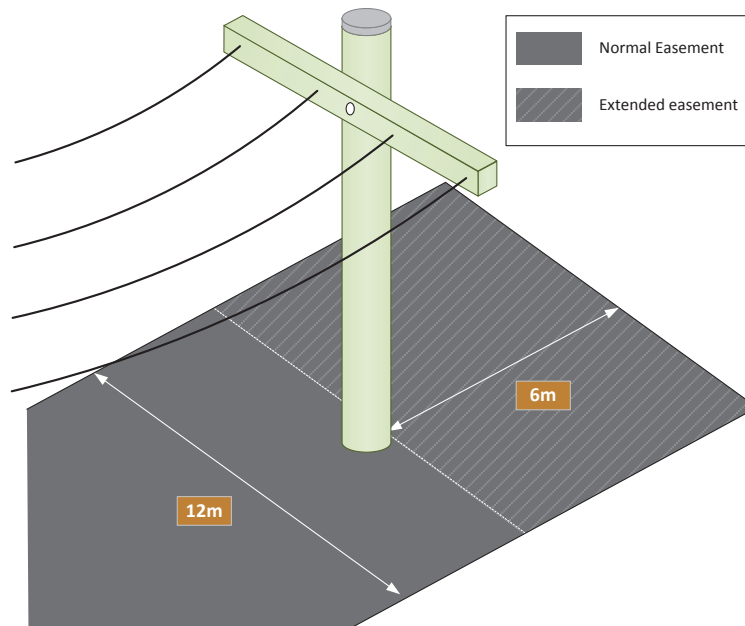


Figure 10 –UGOH pole easement

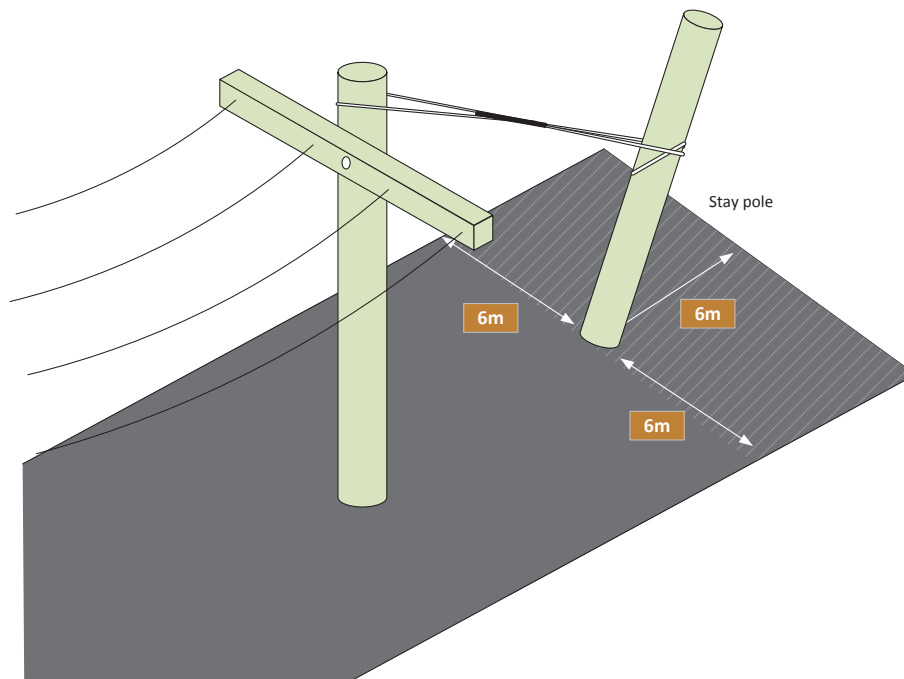


Figure 11 – Stay / Ground pole easement


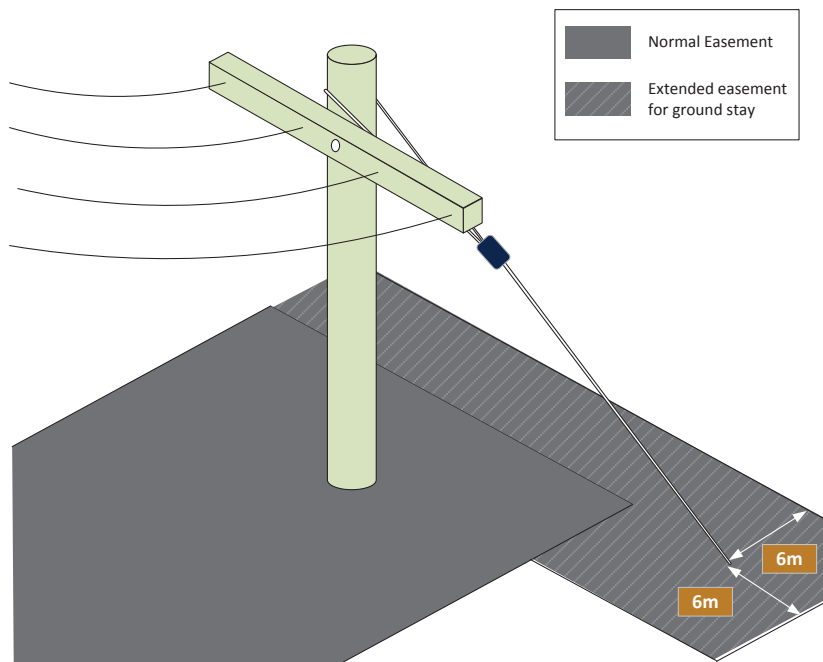


Figure 12 – Ground stay easement

A4.3 - Padmount easements and clearances

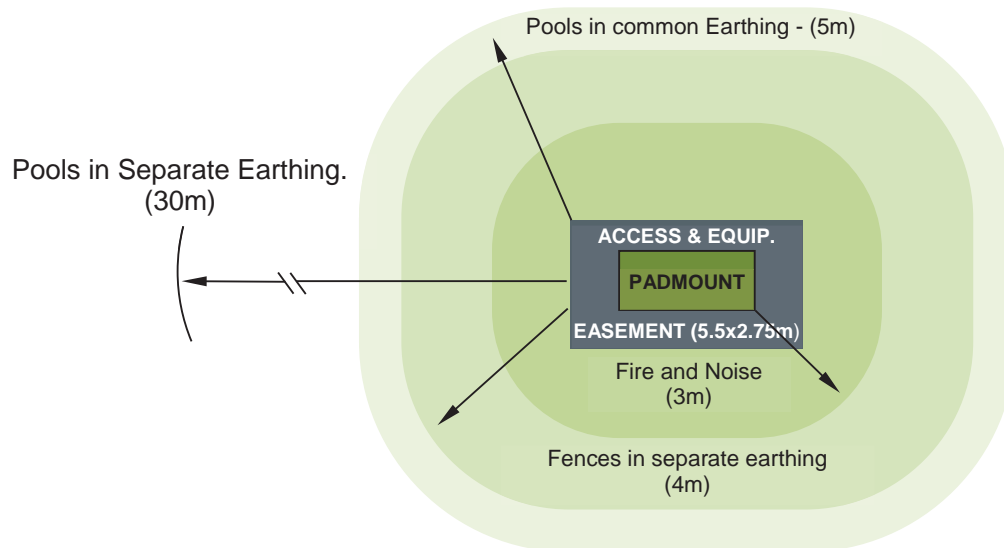

This page is intentionally left blank.

Annexure 5 – Encroachment reference guide

Allowed - An activity which is allowed within an easement, but must still adhere to the minimum safety requirements within the easement stated in this document.

Prohibited - An activity that must not be performed under any circumstance within the easement.

Controlled - An activity which is allowed only if it meets both the minimum safety requirements for that type of easement with additional controls which are specified in the corresponding clause. Approval from Endeavour Energy is required for any controlled activity.

Category	Encroachment	Overhead				Underground				Padmount Substations		
		Allowed	Prohibited	Controlled	Clause	Allowed	Prohibited	Controlled	Clause	Allowed	Prohibited	Controlled
Buildings/ Structures	Buildings (habitable)		✓				✓				✓	
	Tents – Commercial or Recreational		✓			✓					✓	
	Shade Cloths / Umbrellas			✓			✓				✓	
	Minor structures (clothesline, playground equipment, non metallic fences and bbqs)			✓	5.14.4.1		✓				✓	
	Garages, large sheds and shipping containers (habitable)		✓				✓				✓	
	Non-habitable buildings (Carports and metallic sheds), and shipping containers (uninhabited)			✓	5.14.4.2		✓				✓	
Barriers/Walls	Flag pole / weather vane		✓				✓				✓	
	Sound walls			✓			✓				✓	
	Conductive fencing through an easement			✓	5.14.4.3			✓	5.15.5.1		✓	5.16.5.5
	Conductive on boundary of an easement			✓				✓			✓	
	Metal safety barriers			✓	5.14.4.4		✓				✓	
	Electric fencing		✓				✓				✓	
Fixed/ Mobile plant	Retaining walls			✓	5.14.4.5			✓	5.15.5.9			✓ 5.16.5.4
	Metallic pipes in lengths greater than 3m		✓					✓	5.15.5.2		✓	
	Footings of Fixed plant		✓				✓				✓	
	Fixed Plant or equipment		✓				✓		5.15.5.3		✓	
	Mobile plant or equipment							✓		✓		5.16.5.1
	Parking of tall vehicles, trucks, caravans, campervans		✓		5.14.4.7			✓	5.15.5.4		✓	
Vegetation	Parking of other vehicles			✓	5.14.4.6	✓					✓	5.16.5.1
	Shrubs with roots < 400mm	✓				✓				✓		
	Planting of trees which grow less than 3m	✓					✓				✓	
	Planting of trees which exceed 3m		✓				✓				✓	
Swimming Pools	Storage of organic matter (leaves, compost)			✓	5.14.4.17			✓			✓	
	Spas and Swimming pools – above ground		✓				✓				✓	
	Swimming pools – in ground		✓				✓				✓	

Category	Encroachment	Overhead				Underground				Padmount Substations			
		Allowed	Prohibited	Controlled	Clause	Allowed	Prohibited	Controlled	Clause	Allowed	Prohibited	Controlled	Clause
Fires	Lighting of fires		✓					✓			✓		
	Back burning			✓	5.14.4.8		✓				✓		
Agricultural use of the land	Agricultural pursuits such as dusting, harvesting, netting, irrigation			✓	5.14.4.9			✓	5.15.5.5			✓	5.16.5.2
	Ploughing near structures		✓					N/A			✓		
	Ploughing not near structures	✓					✓				✓		
	Objects which may hinder access		✓				✓				✓		
Other	Storage of combustible/flammable/corrosive material		✓					✓					
	Storage of non-combustible, non-flammable, or non-corrosive material	✓								✓			
	Rainwater tanks			✓	5.14.4.10		✓				✓		
	Detention basins			✓	5.14.4.11		✓				✓		
	Earth works – reducing cover or filling			✓	5.14.4.12		✓				✓		
	Permanent surfaces (asphalt, concrete etc)	✓					✓				✓		
	Different surfaces (bluemetal, woodchips)	✓								✓			
	New Roads			✓	5.14.4.13			✓	5.15.5.6			✓	5.16.5.3
	Concrete driveways			✓				✓				✓	5.16.5.3
	Installation of Utility services – telecoms, water, LV elec, sewerage			✓	5.14.4.14			✓	5.15.5.7				
	Residential/ Commercial subdivision lots			✓	5.14.4.15			✓	5.15.5.8		✓	N/A	
	Use of explosives		✓					✓			✓		
	Recreational Activities	Recreational activities – general (not including activities listed below)	✓									✓	
Recreational activities – flying kites, model aircraft, balloons			✓								✓		
Recreational activities – Flood lighting, grandstands			✓								✓		
Recreational activities – firearms			✓								✓		
Recreational activities – tennis courts				✓	5.14.4.16			✓			✓		

LIVING SAFELY WITH ELECTRICITY

When working outside, whether it's a small job or large job or even something you do every day, you need to be aware of the electrical dangers of working near overhead power lines or underground cables.

Endeavour Energy wants to help protect you from potential electrical dangers on your work site. In turn, this will ensure families, households and businesses can continue to enjoy a safe and reliable electricity supply.

This brochure highlights some of the things you can do to avoid electrical dangers on the job.

Did you know?

Australian households receive communication, gas, water and electrical services via a labyrinth of cables stretching millions of kilometres underground. If just one of these cables is damaged, you could potentially be seriously injured and/or isolate thousands of households from essential services. Such incidents can result in hefty fines.

- 01** Call Emergency Services on **000**.
- 02** Request an ambulance if anyone is injured.
- 03** Report the incident to Endeavour Energy on **131 003** as soon as possible.

SAFETY ON THE JOB



SAFETY EXCELLENCE

IN EMERGENCIES CALL 131 003

24 hours a day, 7 days a week

If you have any questions about what you should do to stay safe around damaged power lines and other electrical infrastructure please call 131 081 or visit us at www.endeavourenergy.com.au

51 Huntingwood Drive
Huntingwood NSW 2148
PO Box 6366 Blacktown NSW 2148
T: 131 081 • F: 61 2 9853 6000



**Endeavour
Energy**



**Endeavour
Energy**

Call 131 003 and put safety first.
www.endeavourenergy.com.au

BE ALERT AT WORK

Do you know where the underground cables are?

Unfortunately, serious incidents occur when excavators hit underground cables because cables aren't identified before work has commenced. Obtaining information about underground cable locations once involved making numerous calls to many utility providers.

Now there's really no excuse. Information and site maps showing the general location of underground services can be obtained by calling **1100** or visit **www.1100.com.au**. Remember it's the law.

Check, double check, triple check and reassess

Always check, double check, triple check and reassess for electrical dangers on the job. Remember, earthmoving operations often require material to be relocated to mounds or piles. When this happens under and around power lines it reduces the clearance distances between plant and the electrical infrastructure.

Completed your job?

Stay alert when packing up or removing scaffolding or equipment or when returning plant to its transit position.

Transporting trees?

Remember tall trees and shrubs such as palms can come into contact with power lines. Water is a good conductor of electricity and can therefore conduct through vegetation due to its water content.

Excavating?

Always check the voltage of cables listed on plans so that you can then apply this to *Work Near Underground Assets Guide 2007*, *WorkCover NSW*, to determine what the clearance and other requirements are to commence excavation. Select the safest plant for the job, e.g. toothless buckets and blunt hand tools. Before using mechanical plant to dig, use a cable location service to check the accuracy of plans. Always pothole by hand with non-conductive, blunt hand tools.



HOW CAN YOU HELP?

Electricity can jump

You don't have to be touching power lines to get an electric shock because electricity can 'jump' – also known as arcing. A safe 'clearance' distance needs to be maintained to prevent electricity from arcing across to you and your equipment.

Five things to remember

01

Check, double check, triple check and reassess – always assess your work site for electrical dangers before you start and stay alert until you've left the site.

02

Look up and live – identify the location of overhead power lines and plan your job away from them.

03

Dial **1100** or visit **www.1100.com.au** before you dig – confirm the location of all underground cables before you begin any excavation work.

04

Before using mechanical plant to dig, check the accuracy of your plans using a cable location service. Pothole by hand using blunt plant items.

05

Always maintain a minimum approach distance from power lines and assign a co-worker as an observer while you operate and move machinery around power lines.



Look up and live

If a tip-truck, scaffolding, pump, ladder, crane or metal platform approaches or comes in contact with overhead power lines, the operator and even people nearby, could be electrocuted. Before starting work always look up and identify the location of any overhead power lines. Plan the job to minimise work near and around power lines.

Compare the height of power lines to the maximum height of your equipment, and ensure the full reach of your equipment will not breach the approach distances outlined in the *Work Near Overhead Power Lines Code of Practice 2006*, *WorkCover NSW*. For "ordinary persons" *WorkCover* requires an approach distance of at least three metres from overhead power lines (up to 132,000 volts).

Additional clearances are required when working near power lines carrying higher voltages. It's also a good idea to nominate a co-worker to observe and check that you and your equipment do not go into the approach distance zone.

SAFETY PLAN FOR PLUMBERS

Purpose

This brochure outlines risks, and how to avoid receiving an electric shock from metallic water pipes due to faults within the electricity supply system.

Metallic water pipe systems are used extensively as a means of earthing the electricity supply system, even in properties built after 1976 that are required to have the main earth wire connected to an earthing electrode (rod) driven into the ground.

If an electrical fault occurs then the water pipe can become 'alive' – and therefore dangerous.


Bridge the gap

If there is a fault you may feel a tingle from pipes or taps. Stop work immediately and contact Endeavour Energy.

When cutting water pipes or removing a meter, ensure that you always use a bridging conductor across the cut/break before cutting and keep it in place until the pipe is permanently rejoined. Such work should only be undertaken by qualified people using the appropriate bridging conductor in accordance with AS/NZS 3500.1:2003 Part 5.2, Electrical Safety Precautions and Earthing.

Get a sparky

In circumstance where an earth wire needs to be disconnected from a pipe and/or reconnected to a pipe, an electrical contractor must be contacted to perform the task and ensure the system is safe. Similarly, when replacing part of a copper water system with plastic pipes or non-metallic fittings or couplings, an electrical contractor must be engaged to install an earthing electrode and ensure the system is effectively earthed.

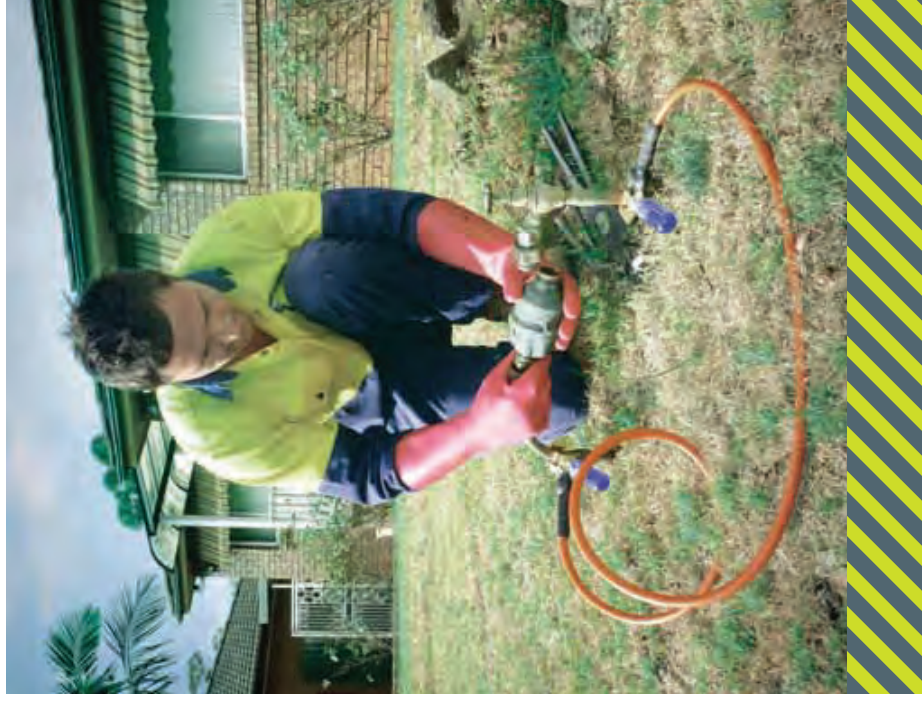

Storm precautions

Lightning can also damage electrical equipment and can conduct through metallic pipes and fittings. To improve plumbing safety when lightning is about, you should cease contact with any metal pipes and fittings.

Check power points

If you plug your equipment into a faulty power point your whole machine could become 'alive'. That's why it is important to use a power point safety tester to check a customer's power point before you use it. For added protection against electric shock from damaged cords or faulty equipment, use a portable safety switch (Residual Current Device).

HOW CAN YOU HELP?

Be aware

When an electrical fault occurs, metallic water pipes can become 'alive' resulting in an electric shock which could be fatal.

The risks increase if you:

- Cut a water pipe
- Remove a water meter
- Disconnect the main earth wire from the water pipe.

Plan the job

01 Find the main switches for the premises and then turn them off. Attach 'Danger Tags'. Be aware this step alone will not guarantee your safety as other faults elsewhere could still make the water pipes 'alive'.

02 If you are replacing all or part of the metallic water system with a plastic pipe, ask a qualified electrician to check the installation to ensure the electricity system is still effectively earthed.

03 Contact an electrical contractor when an earth wire needs to be disconnected or reconnected to a water pipe or when replacing part of a copper water system with plastic pipes or non-metallic fittings or couplings.

04 Test power points and use a safety switch to reduce the risk of shock from your portable tools. Make sure you have your tool and extension leads tested regularly and tagged including bridging conductors.

05 Stop immediately if you feel a tingle or see electrical arcs. Contact Endeavour Energy immediately on **131 003**.

YOUR SAFETY IS OUR PRIORITY

The danger

Under normal operations electricity flows through the active conductor into a premises, whilst the neutral conductor provides the return path for electric current to the substation. If a fault occurs at the customer's or neighbouring premises or in the mains neutral in the street, the electricity may not be able to follow its normal course and flow along metallic water pipes instead. Such faults may remain undetected for prolonged periods of time, especially if nobody has received a shock or noticed a tingling sensation from taps or pipes. Under these conditions the pipe can be energised and cause dangerous shocks if safe work procedures are not applied prior to and during any work on the pipe.

SAFETY EXCELLENCE

IN EMERGENCIES CALL 131 003

24 hours a day, 7 days a week

If you have any questions about what you should do to stay safe around damaged power lines and other electrical infrastructure please call 131 081 or visit us at www.endeavourenergy.com.au

DANGER IN THE PIPELINE



0611-ENE2351-PLMB

51 Huntingwood Drive
Huntingwood NSW 2148
PO Box 6366 Blacktown NSW 2148
T: 131 081 • F: 61 2 9853 6000



**Endeavour
Energy**



**Endeavour
Energy**

Call 131 003 and put safety first.
www.endeavourenergy.com.au

ELECTRIC & MAGNETIC FIELDS – WHAT WE KNOW

ABOUT EMFS

ELECTRIC AND MAGNETIC FIELDS – OR EMFS – ARE FOUND EVERYWHERE THERE IS ELECTRICITY. THEY ARE INVISIBLE.

Electric and magnetic fields - or EMFs - are found everywhere there is electricity. This includes around electrical appliances, equipment and the wiring we use in our homes, workplaces and schools, as well as powerlines and utility facilities. As electricity is so widespread in our society, questions about electricity and health are important to people. Research over more than 40 years has greatly increased our understanding of EMFs. The purpose of this brochure is to inform the public about what we know, and what we are doing about it.

WHAT ARE ELECTRIC FIELDS?

Electric fields are related to the voltage, or the pressure which pushes electricity along wires. The higher the voltage, the higher will be the electric field. Electric fields are present in any appliance plugged into a power point which is switched on. Even if the appliance itself is turned off, if the power point is on, an electric field will be present.

Electric fields are strongest closest to their source, and their strength diminishes rapidly as we move away from the source. The many common materials such as brickwork or metal will block electric fields. Walls, tables and bench tops can act as shields.

WHAT ARE MAGNETIC FIELDS?

Magnetic fields are produced by the flow of electricity, commonly known as current. Unlike electric fields, magnetic fields are only present when electric current is flowing. In other words, if an appliance is operating (even while in 'standby' mode), a magnetic field is produced.

The level of a magnetic field depends on the amount of the current (measured in amps), and decreases rapidly once we move away from the source. While electric fields are shielded by many common materials, this is not the case with magnetic fields. This is one reason why power lines may contribute to magnetic fields in the home and why burying power lines will not eliminate magnetic fields.

EMFS AND HEALTH

Research on EMFs and health has been conducted for over 40 years. This includes over 2,900 studies at a cost of more than \$490 million internationally.

The research has generally focused on the magnetic fields with two main areas of research, *epidemiology* and *laboratory* studies. Both areas would need to provide links between EMFs and adverse health effects for causality to be accepted by health authorities.

Epidemiology (population).

This research looks at statistics to see if there are patterns of disease in large groups of people. The difficulty with large statistical studies is that they take several years to produce meaningful results and even then, there are different opinions about how the results should be interpreted.

There may be other factors in the study which could complicate the interpretation of the results. Scientists generally agree that epidemiological studies aren't strong enough by themselves to establish that adverse health effects exist.

Laboratory


In the laboratory researchers have studied animals cells, as well as human volunteers under controlled circumstances to see if EMFs have any effects.

There have been many hundreds of these studies, and scientists look for results which can be successfully repeated in different laboratories. In over 40 years of research there have been no such consistently reproducible results for exposures below the guidelines.

AUTHORITATIVE REVIEWS

It is well accepted by scientists that no one study considered in isolation will provide a meaningful answer to the question of whether or not EMF can contribute to adverse health effects. In order to make an informed conclusion from all of the research, it is necessary to consider the science in its totality.

All of the research is reviewed periodically by expert panels which are established by national or international bodies with the purpose of trying to determine whether or not human exposure to EMF is related to adverse health effects.

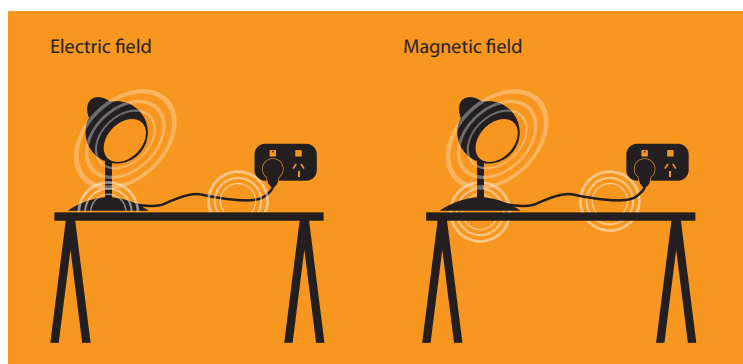

The Australian Radiation Protection and Nuclear Safety Agency (ARPANSA) is a Commonwealth Government agency charged with the responsibility for protecting the health and safety of people and the environment from EMF. ARPANSA advises that:

"The scientific evidence does not establish that exposure to ELF EMF found around the home, the office or near powerlines and other electrical sources is a hazard to human health."

"There is no established evidence that ELF EMF is associated with long term health effects. There is some epidemiological research indicating an association between prolonged exposure to higher than normal ELF magnetic fields (which can be associated with residential proximity to transmission lines or other electrical supply infrastructure, or by unusual domestic electrical wiring), and increased rates of childhood leukaemia."

However, the epidemiological evidence is weakened by various methodological problems such as potential selection bias and confounding. Furthermore this association is not supported by laboratory or animal studies and no credible theoretical mechanism has been proposed."

These findings are consistent with the views of other credible public health authorities. For example the World Health Organisation (WHO) advises that:

"Despite the feeling of some people that more research needs to be done, scientific knowledge in this area is now more extensive than for most chemicals. Based on a recent in-depth review of the scientific literature, the WHO concluded that current evidence does not confirm the existence of any health consequences from exposure to low level electromagnetic fields."

Similarly, the US National Cancer Institute concludes that:

Currently, researchers conclude that there is little evidence that exposure to ELF-EMFs from power lines causes leukemia, brain tumors, or any other cancers in children."

"No mechanism by which ELF-EMFs could cause cancer has been identified. Unlike high-energy (ionizing) radiation, ELF-EMFs are low energy and non-ionizing and cannot damage DNA or cells directly."

"Studies of animals exposed to ELF-EMFs have not provided any indications that ELF-EMF exposure is associated with cancer, and no mechanism has been identified by which such fields could cause cancer."

EMF GUIDELINES FOR ESTABLISHED HEALTH EFFECTS

The two internationally recognised exposure guidelines are:

- » International Commission in Non-Ionizing Radiation Protection (ICNIRP) 2010; and
- » International Committee on Electromagnetic Safety, Institute of Electrical and Electronics Engineers (IEEE) 2002.

ARPANSA's advice is:

- » *"The ICNIRP ELF guidelines are consistent with ARPANSA's understanding of the scientific basis for the protection of the general public (including the foetus) and workers from exposure to ELF EMF."*
- » Under the ICNIRP guidelines of 2010 the recommended magnetic field public exposure limit is 200 microtesla.

Under the IEEE Standard of 2002 the recommended magnetic field public exposure limit is 904 microtesla.

FIGURE 1: TYPICAL MAGNETIC FIELD MEASUREMENT RANGES

Magnetic Field Source	Range of Measurements in μT^*
Electric stove	0.2 – 3
Refrigerator	0.2 – 0.5
Electric kettle	0.2 – 1
Toaster	0.2 – 1
Television	0.02 – 0.2
Personal computer	0.2 – 2
Electric blanket	0.5 – 3
Hair dryer	1 – 7
Pedestal fan	0.02 – 0.2
Substation	
» substation fence	0.1 - 0.8
Distribution line	
» under line	0.2 – 3
» 10m away	0.05 – 1
Transmission Line	
» under line	1 – 20
» edge of easement	0.2 - 5

* Note: Levels of magnetic fields may vary from the range of measurements shown. Appliance measurements at normal user distance.

Source: ARPANSA, Measuring magnetic fields

GUIDE TO COMMON EMFS

It is possible to measure magnetic fields using a gaussmeter.

The fields are measured in a unit of microtesla (μT) or milligauss (mG). 1 Microtesla (μT) equals 10 milligauss (mG).

To give you an idea of the relative strengths of EMF, the following guide shows the typical magnetic fields close to appliances and under power lines.

Due to variations in the design of electrical appliances / powerlines and the power consumed or transmitted, the levels of magnetic fields will vary.

ENA'S RESPONSE?

Electricity utilities review scientific developments related to EMFs and are guided by relevant health authorities. In Australia, the Energy Networks Association (ENA) recommends that electricity utilities provide balanced and accurate information to the community and design and operate electrical power systems prudently within relevant health guidelines. This includes such actions as:

- » providing training to staff;
- » informing the community;
- » ensuring that fields are within established guidelines set by health authorities; and
- » practising "prudent avoidance" when building new electrical facilities.

Prudent avoidance involves reducing magnetic field exposure where this is practicable and can be done at no cost or very low cost.

The industry has followed this reasonable, common sense approach for many years.

INDIVIDUALS RESPONSE

There are some things you can do very easily to reduce exposure to EMF. Since EMFs drop off rapidly as you move away from their source, you can modify your use of electrical appliances such as clock radios. You can locate beds away from a wall that has a switchboard outside and you can switch off your electric blanket before you get into bed. These actions may reduce exposure to EMFs but it cannot be said that doing any of these things will have any health benefit.

For further information about EMFs:

- » your local electricity utility or the Energy Networks Association (ENA) www.ena.asn.au;
- » the Australian Radiation Protection and Nuclear Safety Agency (ARPANSA) - www.arpansa.gov.au
- » the World Health Organisation (WHO) – www.who.int

Energy Networks Association Ltd

P +61 2 6272 1555 **E** info@ena.asn.au
Level 1, 110 Giles St, Kingston ACT 2604
www.ena.asn.au

23 September 2019

The General Manager
(Attention: Natalie Stanowski)
Penrith City Council
PO Box 60
PENRITH
NSW 2751

Dear Natalie,

Planning Proposal for Lot 7-33-43 Phillip Street, ST MARYS

Based on the provided information relating to the Planning Proposal of Lot 7 DP 734738 - 33-43 Phillip Street, St Marys (AKA Station Plaza) from '32m to 61m' high and an increase of floor space ratio from 3.5:1 to 5.5:1, a review was undertaken of the area and nearby Telstra telecommunications infrastructure.

Telstra maintains existing network throughout the land marked for the proposed site. This network is currently not sufficient to meet the likely demand of this new proposal. Telstra has no objection to the change of classification and zoning of this land.

To accommodate the proposed development, the telecommunications network would require upgrade.

Any infrastructure and services provided would be determined closer to the time of development commencement, and be dependent upon any changes to the government policies on the provision of infrastructure in new developments.

You will be aware that there have been previous announcements relating to changes to the Government policies on the provision of infrastructure in new developments. These can be found on the Australian Government's Department of Communications and the Arts website at:-

<https://www.communications.gov.au/policy/policy-listing/telecommunications-new-developments>

Or open the document as a pdf file:-

<https://www.communications.gov.au/file/16381/download?token=IFaqime4>

These changes to policy will have a significant impact on the way infrastructure is provided in the proposed development.

Telstra will work with Government, NBN Co and stakeholders on the implementation of the new policy on Infill Developments.

Our key concerns during this period are to help ensure services to developers and end customers are maintained and meet our commercial and legal obligations.

Until alternative arrangements are put in place, developers are requested to remain in contact with Telstra through the normal channels.

Telstra will require the protection of/relocation of its telecommunications infrastructure that may be impacted by activities on this site. To minimise risk of liability due to any damage, the Telstra 1100 (Dial before you dig) inquiry number should be contacted to obtain location of Telstra plant before commencement of construction work.

Further discussions regarding details for network expansion are strongly encouraged once detailed planning for the development is in progress. To inform Telstra of likely commencement of this development, we requested the developer/builder/project manager to register this development on the [Telstra Smart Community](#) website.

Please note that Telstra reserves the right to change its decision in relation to network deployment within the development without prior notice.

For future correspondence and enquiries regarding this matter, please contact the undersigned on 0249188527 or email me.

Yours faithfully,

Jordan Whiteford
LD Intelligence Specialist Planner
Land Development Infrastructure Provisioning
jordan.whiteford@team.telstra.com
0249188527

Madison Foster

From: UrbanGrowth <UrbanGrowth@sydneywater.com.au>
Sent: Wednesday, 13 November 2019 4:30 PM
To: Madison Foster
Subject: RE: Planning Proposal for 33-43 Phillip Street, St Marys - request for comment

EXTERNAL EMAIL: This email was received from outside the organisation. Use caution when clicking any links or opening attachments.

Hi Madison

My sincere apologies Sydney Water missed the second deadline. Enrique's last day was 6 November 2019 and he was still awaiting comments from internal stakeholders at the time. Can I please confirm if there is still opportunity to make a submission? If not, Sydney Water are satisfied that the development proposal will be able to obtain servicing requirements at the section 73 stage.

Sydney Water Servicing

A Section 73 Compliance Certificate under the Sydney Water Act 1994 must be obtained from Sydney Water. The proponent is advised to make an early application for the certificate, as there may be water and wastewater pipes to be built that can take some time. This can also impact on other services and buildings, driveways or landscape designs.

Applications must be made through an authorised Water Servicing Coordinator. For help either visit www.sydneywater.com.au > Plumbing, building and developing > Developing > Land development or telephone 13 20 92.

Building Plan Approval

The approved plans must be submitted to the Sydney Water Tap in™ online service to determine whether the development will affect any Sydney Water sewer or water main, stormwater drains and/or easement, and if further requirements need to be met.

The Sydney Water Tap in™ online self-service replaces our Quick Check Agents as of 30 November 2015.

The Tap in™ service provides 24/7 access to a range of services, including:

- building plan approvals
- connection and disconnection approvals
- diagrams
- trade waste approvals
- pressure information
- water meter installations
- pressure boosting and pump approvals
- changes to an existing service or asset, e.g. relocating or moving an asset.

Sydney Water's Tap in™ online service is available at: <https://www.sydneywater.com.au/SW/plumbing-building-developing/building/sydney-water-tap-in/index.htm>

Kind regards

Ishtar Malki
Growth Intelligence Specialist

City Growth and Development, Liveable City Solutions
Sydney Water, 1 Smith Street, Parramatta NSW 2150



Ph: 02 8849 5922

ishtar.malki@sydneywater.com.au

Madison Foster

From: Darryl Tolentino <darryl.tolentino@jemena.com.au>
Sent: Thursday, 16 January 2020 1:43 PM
To: Madison Foster; Liana Tran
Cc: Neale Hilton
Subject: RE: Planning Proposal for 33-43 Phillip Street, St Marys - request for comment

EXTERNAL EMAIL: This email was received from outside the organisation. Use caution when clicking any links or opening attachments.

Dear Madison

The Capacity planner has assessed the proposal based on data provided by J. Wyndham prince in 2016 and confirmed the existing main there has sufficient capacity to support the new load.

With Kind Regards,

Darryl Tolentino
Engineer – Gas Distribution

Jemena

Level 14, 99 Walker Street, North Sydney, NSW 2060
+61 2 9867 7237

darryl.tolentino@jemena.com.au | www.jemena.com.au
www.gonaturalgas.com.au



Manage your gas, your way at
mygasservices.jemena.com.au



Starting from 30 October 2019 all external works requests related to asset relocation, adjustment or protection will be directed to the My Gas Services self service portal. The portal provides scoping, quotations and payment options in one convenient location.

As of the go live date (30 October 2019) you will be able to create a new account and take advantage of this new service for all your projects.

From: Madison Foster <madison.Foster@penrith.city>
Sent: Wednesday, 15 January 2020 11:41
To: Darryl Tolentino <darryl.tolentino@jemena.com.au>
Subject: RE: Planning Proposal for 33-43 Phillip Street, St Marys - request for comment

CAUTION: This email originated from outside of the organisation. Do not click links or open attachments unless you recognise the sender and are expecting the content or attachment from the sender.

Hi Darryl,

Thank you for your response. Just to clarify, any development within 300mm of Jemena's main, the relocation would be at the developer's expense as the applicant of the proposal.

Jemena: Yes you are correct. In addition, if the design of the development is such we would need to install new isolation valves, we would also need your support on this as well.

As this Planning Proposal is seeking to increase the existing building height and floor space ratio controls under Penrith Local Environmental Plan (2010), Council are seeking comments on the increase in capacity and availability of Jemena services to support these controls at Station Plaza.

Jemena: For issues on capacity, we need to consult on the capacity planner for this.

Kind Regards,

Madison Foster
Planner

E madison.Foster@penrith.city
T +612 4732 8577 | F +612 4732 7958 | M
PO Box 60, PENRITH NSW 2751
www.visitpenrith.com.au
www.penrithcity.nsw.gov.au

PENRITH
CITY COUNCIL



Follow us

From: Darryl Tolentino <darryl.tolentino@jemena.com.au>

Sent: Wednesday, 15 January 2020 11:25 AM

To: Madison Foster <madison.Foster@penrith.city>

Subject: RE: Planning Proposal for 33-43 Phillip Street, St Marys - request for comment

EXTERNAL EMAIL: This email was received from outside the organisation. Use caution when clicking any links or opening attachments.

Hi Madison

Just to keep it simple, if your works are within 300mm of our main, the mains need to be relocated at Council's expense.

With Kind Regards,

Darryl Tolentino

Engineer – Gas Distribution

Jemena

Level 14, 99 Walker Street, North Sydney, NSW 2060

+61 2 9867 7237

darryl.tolentino@jemena.com.au | www.jemena.com.au

www.gonaturalgas.com.au



Manage your gas, your way at
mygasservices.jemena.com.au



Starting from 30 October 2019 all external works requests related to asset relocation, adjustment or protection will be directed to the My Gas Services self service portal. The portal provides scoping, quotations and payment options in one convenient location.

As of the go live date (30 October 2019) you will be able to create a new account and take advantage of this new service for all your projects.

From: Darryl Tolentino

Sent: Tuesday, 14 January 2020 10:36

To: Madison Foster <madison.Foster@penrith.city>

Subject: RE: Planning Proposal for 33-43 Phillip Street, St Marys - request for comment

Hi Madison

Thanks for your reply.

The reason I asked for the below so I can assess if your works will have an impact on our assets.

With Kind Regards,

Darryl Tolentino

Engineer – Gas Distribution

Jemena

Level 14, 99 Walker Street, North Sydney, NSW 2060

+61 2 9867 7237

darryl.tolentino@jemena.com.au | www.jemena.com.au

www.gonaturalgas.com.au



From: Madison Foster <madison.Foster@penrith.city>

Sent: Tuesday, 14 January 2020 10:27

To: Darryl Tolentino <darryl.tolentino@jemena.com.au>

Subject: RE: Planning Proposal for 33-43 Phillip Street, St Marys - request for comment

CAUTION: This email originated from outside of the organisation. Do not click links or open attachments unless you recognise the sender and are expecting the content or attachment from the sender.

Hi Darryl,

Thank you for your response, could I clarify with you if this response is no objection or an objection to the planning proposal from Jemena?

Kind Regards,

Madison Foster
Planner

E madison.Foster@penrith.city

T +612 4732 8577 | F +612 4732 7958 | M

PO Box 60, PENRITH NSW 2751

www.visitpenrith.com.au

www.penrithcity.nsw.gov.au

PENRITH
CITY COUNCIL



Follow us

From: Darryl Tolentino <darryl.tolentino@jemena.com.au>
Sent: Monday, 6 January 2020 3:14 PM
To: Madison Foster <madison.Foster@penrith.city>
Subject: RE: Planning Proposal for 33-43 Phillip Street, St Marys - request for comment

EXTERNAL EMAIL: This email was received from outside the organisation. Use caution when clicking any links or opening attachments.

Hi Madison,

Generally from an encroachment perspective, we have the following guidelines

As per DBYD procedures, could you please do the following:

1. Perform DBYD for each location, where your construction project would be in the vicinity of a gas main
2. Prepare a clash register highlighting each area where you'll be working within 1m of an existing gas main
3. Prepare protection or relocation proposals if your construction will be within 1m of a Primary Pressure Gas Main, 500mm of a Secondary Pressure gas Main or 300mm of a Medium / Low Pressure Gas main
4. Once you gather all the information please forward us a copy for review
5. If relocation/adjustment or protection is required, you need to forward your query to the gas portal at <https://mygasservices.jemena.com.au/>.
6. If your proposed construction is within 3metres of Trunk/Primary/secondary and critical medium pressure mains, standby is required. To book Jemena resources you'll need to contact Jemena Infrastructure Protection department on 1300 665 380 or our gas portal <https://mygasservices.jemena.com.au/>. Please allow at least 3 weeks notice as they have a high volume of jobs in the back log.
7. You will be required to register with a valid email address. For organisations we advise to consolidate all future notifications register with an Admin or Group email address to ensure communications are always available regardless of who is managing the job on your Companies behalf.

If you are seeking a new connection to this apartment complex, I would suggest you email our commercial department at Neale Hilton Neale.Hilton@jemena.com.au.

With Kind Regards,

Darryl Tolentino
Engineer – Gas Distribution
Jemena
Level 14, 99 Walker Street, North Sydney, NSW 2060
+61 2 9867 7237
darryl.tolentino@jemena.com.au | www.jemena.com.au
www.gonaturalgas.com.au

